

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE NEW DELHI-110001**

No. F6/DFS/MS/2021/School/WZ/ 813

Dated: 5/10/21

FIRE SAFETY CERTIFICATE

Certified that **The Heritage School, Plot No.8, Sectro-23, Rohini, Delhi-110085**, comprised of **Basement + Ground + Three upper floors** owned/occupied by **The Heritage School**, has already been issued FSC by this department vide letter No. **F.6/DFS/MS/2018/443** dated **16.03.2018**. The premises was re-inspected by the officer concerned of this department on **03.07.2021** in the presence of **Smt. Yakshi Gulati, Prinicipal** and observed that all the fire prevention and fire safety arrangements as provided in the premise found in good working condition. The premises have therefore deemed complied with the requirements under Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy under **Educational "Group B"** with effect from 5/10/21 for a period of **three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subjected to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 5/10/21 at New Delhi by


(Dhrampal Bhardwaj)
Dy.Chief Fire Officer
Tel;-01123414250

Copy to :-

1. The Principal, The Heritage School, Plot No.8, Sectro-23, Rohini, Delhi-110085.
2. The Director of Education, Old Secretariat, Delhi

Conditions for validity of Fire Safety Certificate;

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The basement shall only be used as per BBL 1983.
7. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director along with a copy of this Certificate, six months prior to its expiry".
8. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form "K" is available on

http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/
http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms

11/27

INSPECTION REPORT

1. Name & address of the building : The Heritage School, Plot No.8, Sectro-23, Rohini, Delhi-110085.
2. Type of Occupancy : Educational (**Basement +Gr.+3 upper floors**)
3. Type of Case : Renewal
4. Details of Previous NOC : F.6/DFS/MS/2018/443 dated 16.03.2018
5. Fire Safety directives letter No : NBC Part-IV
6. Date of inspection : 03.07.2021
7. Name of Inspecting Officer : A.K.Sharma ADO(Rohini)
8. Name and designation of officers
From the building side : Smt. Yakshi Gulati, Prinicipal
9. Year of Construction : 2003
10. Applicant's letter No. : Online e-mail dated 10.06.2021

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	NBC Part-4	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none">• Road width	Accessible	Accessible	MR
	<ul style="list-style-type: none">• Gate width	Accessible	4.5m	MR
	<ul style="list-style-type: none">• Width of internal road	NA	NA	NA
2.	Number, Width, Type & Arrangement of Exits			
	d. Number of staircases			
	<ul style="list-style-type: none">• Upper Floors	04	04	MR
	<ul style="list-style-type: none">• Basements	04	04	MR
	e. Width of staircases			
	<ul style="list-style-type: none">• Upper Floor	1.5m	1.5m	MR
	<ul style="list-style-type: none">• Basements	1.5m	1.5m	MR
	f. Protection of exits			
	Fire check door	Required in basement	Provided	MR
	<ul style="list-style-type: none">• Pressurization	NA	NA	NA
	d. No. of continuous staircases to terrace	02	02	MR
	e. Width of Corridor	NA	NA	NA
	f. Door Size	Required	Provided	MR
3.	Compartmentation			
	<ul style="list-style-type: none">• Fire check door	Required	Provided	MR
	<ul style="list-style-type: none">• Sealing of electrical shafts	NA	NA	NA
	<ul style="list-style-type: none">• Fire Rating of shaft door	NA	NA	NA
	<ul style="list-style-type: none">• Water Curtain	NA	NA	NA
	<ul style="list-style-type: none">• Fire Dampers	NA	NA	NA
4.	Smoke Management System			
	<ul style="list-style-type: none">• Basements	30 a/c per hour	Exhaust fan	MR
	<ul style="list-style-type: none">• Upper floors	12 a/c per hour	Natural ventilation	MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none">• Total numbers	28	28	MR
	<ul style="list-style-type: none">• Types	ABC/CO2	ABC	MR
	<ul style="list-style-type: none">• IS marking	ISI marked	Yes	MR
6.	First-Aid Hose Reels			
	<ul style="list-style-type: none">• Total numbers on each floor	03	03	MR
	<ul style="list-style-type: none">• Length of hose reel hose	30m	Provided	MR
	<ul style="list-style-type: none">• Nozzle diameter	5mm	Provided	MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none">• Type of detectors	NA	NA	NA
	<ul style="list-style-type: none">• Location of Main Panel	NA	NA	NA
	<ul style="list-style-type: none">• Location of Repeater Panel	NA	NA	NA


	<ul style="list-style-type: none"> • Alternate source of power • Hooters' Location 	NA	NA	NA
8.	MOEFA	NA	NA	NA
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System	Required	Provided	MR
	<ul style="list-style-type: none"> • Basement • Ground & Upper Floors • Sprinkler above false ceiling 	Required	Provided	MR
11.	Internal Hydrants	NA	NA	NA
		NA	NA	NA
	<ul style="list-style-type: none"> • Size of riser/down-comer • Number of hydrants per floor • Hose Box 	100mm	Provided	MR
12.	Yard Hydrants	03	Provided	MR
		03	Provided	MR
	<ul style="list-style-type: none"> • Total number of hydrants • Hose Box 	Required	Provided	MR
13.	Pumping Arrangements	Required	Provided	MR
	<ul style="list-style-type: none"> • Ground Level ➤ Discharge of main Pump ➤ Head of Main pump ➤ Number of main pumps ➤ Jockey Pump out put ➤ Jockey pump head ➤ Standby Pump out put ➤ Standby Pump Head ➤ Auto Starting/Manual Stopping ➤ Pump House Access 	NA	1620 LPM	MR
		NA	40m	MR
		NA	NA	NA
		NA	180 LPM	MR
		NA	40m	MR
		NA	NA	MR
		NA	NA	MR
		Required	Provided	MR
		Required	Provided	MR
	<ul style="list-style-type: none"> • Terrace level ➤ Discharge of pump ➤ Head of the pump ➤ Power Supply ➤ Auto Starting of pump 			
		450lpm	450lpm	MR
		40m	40m	
		Required	Provided	MR
		Required	Provided	MR
14.	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> • Underground tank capacity ➤ Draw-off connection ➤ Fire service inlet ➤ Access to tank • Overhead Tank capacity 	NA	20,000ltr	MR
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		15,000ltr	25000ltr	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication In lift Car • Fireman's Grounding Switch • Lift Signage 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
17.	Standby power supply	NA	NA	NA
18.	Refuge Area.			
	<ul style="list-style-type: none"> ➤ Total Area ➤ Location 	NA	NA	NA
		NA	NA	NA
19.	Fire Control Room			
	<ul style="list-style-type: none"> • Detector System Panel • Flow Switch Panel • PA System Panel • Battery backup 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA

N/29

• Building Floor Plans	NA	NA	NA
Special Fire Protection System for Protection of special Risks, if any:	NA	NA	NA


The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. F.6 DFS/MS/2018/443 dated 16.03.2018 is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010. The shortcoming issued vide letter no. 194 dated 07.04.2021 have been rectified whereas, pump requirement for school building are adjudged under section 35 (6) of DFS Rules 2010 as per Noting N/2 may kindly be accepted.

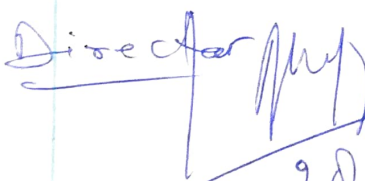

24/8/21

Signature of the Inspecting Officer
Name Ajay Kumar Sharma
Designation ADO(Rohini)


DO (NW) - on M/R
DCFO (WZ)

for seen pt.

28/9/2021

CFO - on M/R

Director

20/9/2021


D/R/WL



28/9/2021

ADO Rohini

FT letter is put up for kind
perusal and signature please.

DCFO (WZ)


4/10/2021


30/9/21

msd cell