

FORM 'H': FORM FOR ISSUING FIRE SAFETY CERTIFICATE

[See sub-rule (1) of rule 35]

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI

HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

No. F6/DFS/MS/Hospital/2021/SZ/ 548

Dated: 2 / 11 / 2021

FIRE SAFETY CERTIFICATE

Certified that the "H" Block located at Safdarjung Hospital Complex, Ring Road, New Delhi-110029, building comprised of Ground plus Three Upper Floors only owned / occupied by Ministry of Health, Govt. of India, have complied with the Fire prevention and Fire Safety requirements in accordance with rule 33 of the Delhi Fire Service Rule, 2010 and verified by the officers concerned of this department on 20/10/2021 in the presence of Sh. Vishwas Kumar (A.E.) and found that the building / premises is fit for the occupancy class "**Institutional Building**" (Group - 'C') with effect from 2 / 11 / 2021..... for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 2 / 11 / 2021 at New Delhi by.

(ATUL GARG)
DIRECTOR.

Copy to :-

1. Executive Engineer (E), PWD, Safdarjung Hospital Complex, New Delhi-110029.
2. Medical Superintendent, Safdarjung Hospital Complex, New Delhi-110029.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided their in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. "The owner / Occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on WWW.dfs.Delhigovt.nic.in

MF9
INSPECTION REPORT

1. Name & address of the building: **"H" Block Safdarjung Hospital Complex, Ring Road, New Delhi-110029.**
2. Type of Occupancy : **Institutional building "C" (Hospital)**
3. Building comprised of : **Ground plus Three Upper Floors.**
4. Type of Case : **New Case**
5. Details of previous NOC : **Nil**
6. Fire Safety directives Letter No.: **F6/MS/DFS/85/Hospital/828 dated 23/9/1985**
7. Date of inspection : **20/10/2021**
8. Name of the Inspecting Officer : **D.O. (S.D.) & A.D.O. (S.J.)**
9. Name and designation of Officer from the building side : **Sh. Vishwas Kumar (AE)**
10. Year of Construction : **Around 1965**

11. Applicant's letter received through Email

S No	Minimum standards on fire prevention and fire safety U/R 33	Requirements as per recommendation dated 23/09/1985	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	6m After interring in Hospital Complex	6m After interring in Hospital Complex	MR (Old building)
	• Gate width	N/A	N/A	N/A
	• Width of internal road	N/A	N/A	N/A
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	8	8	MR (Old building)
	• Basements	N/A	N/A	N/A
	b. Width of staircases			
	• Upper floors	1.40m / 0.90m	1.40m, 1.35m & 1.05m x 6	MR(Old building)
	• Basements	N/A	N/A	N/A
	c. Protection of exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	N/A	N/A	N/A
	d. No of continuous staircase to terrace	2	2	MR
	e. Width Of Corridor	N/A	N/A	N/A
	f. Door Size	N/A	N/A	N/A
3.	Compartmentation			
	• Fire check door	Required	Provided	MR
	• Sealing of electrical shafts	Required	Provided	MR
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4.	Smoke managements System			
	• Basements	N/A	N/A	N/A
	• Ground Floor	12 ACPR	Natural Ventilation	MR
5.	Fire Extinguishers			
	• Total numbers	40	40	M/R
	• Types	ABC/CO ₂	Provided	M/R
	• ISI marking	Required	Provided	M/R

4/10

6.	First – Aid Hose Reels			
	• Total numbers on each floor	4	Provided found functional	MR
	• Length of hose reel hose	30 Mtr.	Provided	MR
	• Nozzle diameter	5 mm	Found provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detector	Smoke & Heat	Provided	MR
	• Location of Main Panel	GF	GF	MR
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	Required	Provided	MR
	• Hooters' Location	All Areas	All Areas	MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	• Basement	N/A	N/A	N/A
	• Upper Floor	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	• Size of riser/down- comer	100 mm	Provided found functional	MR
	• Number of hydrants per floor	7	Provided	MR
	• Hose Box	7	Provided	MR
12.	Yard Hydrants			
	• Total number of hydrants	8	Provided	MR
	• Hose Box	8	Provided	MR
3.	Pumping Arrangements Fire fighting pumps and UGWST are common for entire Hospital (Old building)			
	• Ground Level			
	➤ Discharge of main pump	2850 LPM	2850 LPM	MR
	➤ Head of main pump	90 MH	90 MH	MR
	➤ Number of main pumps	1	1	MR
	➤ Jockey pump out put	220 LPM	220 LPM	MR
	➤ Jockey pump head	90 MH	90 MH	MR
	➤ Standby Pump out put	2850 LPM	2850 LPM	MR
	➤ Standby Pump Head	90 MH	90 MH	MR
	➤ Auto Staring/Manual stopping	Required	Provided	MR
	➤ Pump House Access	Required	Provided	MR
	• Terrace level			
	➤ Discharge of pump	N/A	N/A	N/A
	➤ Head of the pump	N/A	N/A	N/A
	➤ Power supply	N/A	N/A	N/A
	➤ Auto starting of pump	N/A	N/A	N/A
	Captive water Storage for fire fighting			
	Fire fighting pumps and UGWST are common for entire Hospital (Old building)			
	• Underground tank capacity	2,00,000 ltr	2,00,000 ltr	MR
	➤ Draw of connection	Required	Provided	MR
	➤ Fire service inlet	Required	Provided	MR
	➤ Access to tank	Required	Provided	MR
	• Overhead Tank capacity	N/A	N/A	N/A


[Signature]


2/11


15	Exit Signage	Required	Found Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	N/A	N/A	N/A
	➤ Pressurization of lift lobby	N/A	N/A	N/A
	➤ Communication in lift Car	Required	Provided	MR
	➤ Fireman's Grounding Switch	Required	Provided	MR
	➤ Lift Signage	Required	Provided	MR
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area	N/A	N/A	
	➤ Total area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19.	Fire control room			
	➤ Detector system panel	Required	Provided	MR
	➤ Flow Switch Panel	N/A	N/A	N/A
	➤ PA System Panel	Required	Provided	MR
	➤ Battery backup	Required	Provided	MR
	➤ Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection Systems for Protection of special Risks, if any;	ABC & Co2	Provided in electric panel	MR

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

Keeping in view of the substantial compliance of the minimum standards of fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010 is recommended.

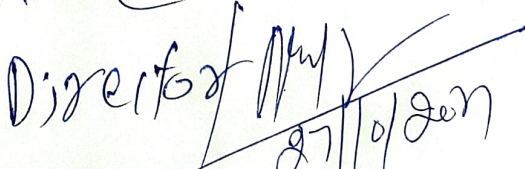

Signature of the Inspecting Officer
Name : S.K. Dua
Designation : D.O. (S.D.)



Signature of the Inspecting Officer
Name : A.K. Jaiswal
Designation : A.D.O. (S.J.)



DCFO (S.D.)


26/10

CFO (D. off)


Director of Fire
27/10/2021




DLR/S2