

E-15

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI – 110001


No F 6/DFS/MS/2021/WZ/School/983

Dated: 05/11/2021

FIRE SAFETY CERTIFICATE

Certified that the **D A V Public School** located at **Sector-07, Rohini, Delhi-110085** comprised of **Ground + Three Upper floors** owned/ occupied by **D A V Public School** was issued Fire Safety Certificated vide this office letter no. **F-6/DFS/MS/2018/School/7375** dated **17.07.2018**. The premise was re-inspected by the officer concerned of this department on **26.10.2021** in the presence of **Mr. Chiraj Chugh (Accountant)** and observed that all the fire prevention and fire safety arrangements as provided in the premise found in good working condition. The premise have therefore deemed complied with the requirements under rule 33 of the Delhi Fire Service Rules, 2010 and the building premise is fit for occupancy under **Educational "Group B"** with effect from **05/11/2021** for a period of **three years** in accordance with the rule 36 unless renewed under rule 37 or sooner cancelled under rule 40, subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010,

Issued on **05/11/2021** at New Delhi


(Dhrampal Bhardwaj)
Dy.Chief Fire Officer
Tel;-01123414250

Copy to :-

1. The Director, Education, Government of N.C.T of Delhi. Old Sectt. Delhi - 110054.
2. The Principal, DAV Public School, Sec-07, Rohini, Delhi-110085.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on **WWW.dfs.Delhigovt.nic.in**

INSPECTION REPORT

1. Name & address of the building : D A V Public School, Sec-07, Rohini, Delhi-110085.
 2. Type of Occupancy : Educational
 3. Type of Case : Renewal (Ground + 03 Upper floor)
 4. Details of previous NOC : F-6/D/S/MS/2018/School/7375 dated 17.07.2018
 5. Fire Safety directives letter No : NBC Part-04
 6. Date of inspection : 26.10.2021
 7. Name of the Inspecting Officers : A.K.Sharma ADO (Rohini)
 8. Name and designation of officers from the building side : Mr. Chiraj Chugh (Accountant)
 9. Year of Construction : 1994-2006
 10. Applicant's letter No. : Online e-mail dated 15.09.2021

	Minimum Standards on fire prevention and fire safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	Accessible	Accessible	MR
	• Gate width	Accessible	5 m	MR
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	04	04	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floors	1.50m	1.75m, 1.36m, 1.41 m, 1.80 m & 1.41- 142	MR
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No. of continuous staircases to terrace	02	2	MR
	e. Width of Corridor	NA	NA	NA
	f. Door Size	1 m	1 m	MR
3	Compartmentation.			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4	Smoke Management System.			
	• Basements	30 a/c per hour	NA	NA
	• Upper floors	12 a/c per hour	Natural Ventilated	MR
5	Fire Extinguishers			
	• Total numbers	30 nos	30 nos	MR
	• Types	ABC/Co2	ABC-26 / Co2- 4	MR
	• ISI marking	ISI Marked	Yes	MR
6	First-Aid Hose Reels.			
	• Total numbers on each floor	03 each floor	03	MR
	• Length of hose reel hose	30m	30m	MR
	• Nozzle diameter	5mm	5mm	MR
7	Automatic fire detection and alarming system.			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA


	<ul style="list-style-type: none"> • Alternate source of power • Hooters' Location 	NA	NA	NA
8	MOEFA	Required	Provided	MR
9	Public Address System.	NA	NA	NA
10	Automatic Sprinkler System.			
	<ul style="list-style-type: none"> • Basement • Upper Floor • Sprinkler above false ceiling 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
11	Internal Hydrants			
	<ul style="list-style-type: none"> • Size of riser/down-comer • Number of hydrants per floor • Hose Box 	100mm	Provided	MR
		03	Provided	MR
		03	Provided	MR
12	Yard Hydrants.			
	<ul style="list-style-type: none"> • Total number of hydrants • Hose Box 	03	03	MR
		03	03	MR
13	Pumping Arrangements.			
	<ul style="list-style-type: none"> • Ground Level <ul style="list-style-type: none"> ➤ Discharge of main Pump ➤ Head of Main pump ➤ Number of main pumps ➤ Jockey Pump out put ➤ Jockey pump head ➤ Standby Pump out put ➤ Standby Pump Head ➤ Auto Starting/ Manual stopping ➤ Pump House Access • Terrace level <ul style="list-style-type: none"> ➤ Discharge of pump ➤ Head of the pump ➤ Power Supply ➤ Auto Starting of pump 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		900 lpm	900 lpm	MR
		36m	36m	MR
		Required	Provided	MR
		Required	Provided	MR
14	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> • Underground tank capacity ➤ Draw-off connection ➤ Fire service inlet ➤ Access to tank • Overhead Tank capacity 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		10,000 ltrs	20,000ltrs	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	<ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication In lift Car • Fireman's Grounding Switch • Lift Signage 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
17	Standby power supply	N/A	125 KVA	MR
18	Refuge Area.			
	<ul style="list-style-type: none"> ➤ Total Area ➤ Location 	N/A	N/A	N/A
		N/A	N/A	N/A
19	Fire Control Room			
	<ul style="list-style-type: none"> • Detector System Panel • Flow Switch Panel • PA System Panel • Batter backup 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A


N/12

	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. F-6/DFS/MS/2018/School/7375 dated 17.07.2018 is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.


 Signature of the Inspecting Officer
 Name Ajay Kumar Sharma
 Designation ADO (Rohini)

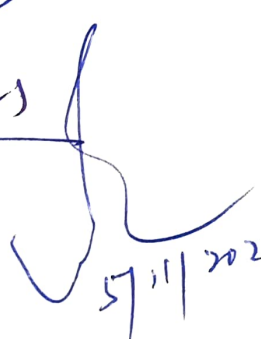
DO (NW) 
 Dy CFO (SZ)


 11/11/2021

~~ADO~~ Rohini

Fi letter is put up for kind perusal and signature please.


 31/11/21

~~Dy CFO (SZ)~~ 
 12/11/2021

31/11/21