

C-38

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE**  
**CONNAUGHT PLACE: NEW DELHI-110001**


No. F.6/DFS/MS/EH/2021/SZ/ 324

Dated: 02/11/2021

**FIRE SAFETY CERTIFICATE**

Certified that the Restaurant in the name & style of M/s **Haldiram Marking Pvt. Limited** located at Shop No-31 Ground Floor & Shop No-103 First Floor, Multilevel Car Parking cum Commercial Complex, DLF South Square Mall, Sarojini Nagar, New Delhi-110023, comprised of **Basement, Ground + Eight Upper Floors** but the restaurant running at ground & first floor only was issued FSC by this department vide letter No F.6/DFS/MS/EH/2018/SZ/388 dated 09/03/2018. The premise was re-inspected by the officer concerned of this department on 29/10/2021 in the presence of Mr. Bijender (Manager) and found that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the said premises is fit for occupancy class "**Group-D Assembly**" (Restaurant) with effect from 02/11/2021 for a period of **Three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 02/11/2021 at New Delhi by



(Sunil Chawdhary)  
Dy. Chief Fire Officer (SZ)  
Delhi Fire Service

Copy to: -

1. Auth. Signatory, M/s Haldiram Marketing Pvt. Limited at Shop No-31 (Ground Floor) & Shop No-103 (1<sup>st</sup> Floor), Multilevel Car Parking cum Commercial Complex, DLF South Square Mall, Sarojini Nagar, New Delhi-110023
2. The Medical Officer of the Health, Health Licensing Unit, New Delhi Municipal Council, Palika Kendra, New Delhi-110001

**Conditions for the validity of Fire Safety Certificate**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire-fighting system.
4. The owner/occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry."

## INSPECTION REPORT

1	Name & Address of the Building	M/s <b>Haldiram Marketing Private Limited</b> at Shop No-31 (Ground Floor) & Shop No-103 (First Floor), Multilevel Car Parking cum Commercial Complex, DLF South Square Mall, Sarojini Nagar, New Delhi-110023		
2	Type of Occupancy	Assembly "Group-D" (Eating House)		
3	Building comprised of	Basements, Ground + Eight Upper floors but the <b>Restt located at GF &amp; 1<sup>st</sup> Floor of the Bldg.</b>		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/EH/2018/SZ/388 dated 09/03/2018		
6	Fire Safety Directives Letter No	F.6/DFS/MS/BP/2008/3507 dated 22/12/2008 & F.6/DFS/MS/BP/2014/17 dated 17/01/2014		
7	Date of Inspection	29/10/2021		
8	Name of the Inspecting Officers	DO (SD) & ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Bijender (Manager)		
10	Year of construction	2011		
11	Applicant letter No.	Email dated 26/10/2021		
<b>S. No.</b>	<b>Minimum standards on Fire Prevention and Fire Safety U/R 33</b>	<b>Old FSC Requirement</b>	<b>Provided at Site</b>	<b>Remarks MR/NMR</b>
<b>1</b>	<b>Access to Building.</b>			
	<ul style="list-style-type: none"> <li>Road width</li> <li>Gate width</li> <li>Width of internal road</li> </ul>	Restt within Multilevel Car Parking	9m 4.5m 6m from two sides	MR MR MR
<b>2</b>	<b>Number, width, type &amp; arrangement of exits</b>			
	<b>a. Number of Staircase</b>			
	<ul style="list-style-type: none"> <li>Upper floors</li> <li>Basement floor</li> </ul>	Required -NA-	03+01 (1 inside the Restt) -NA-	MR -NA-
	<b>b. Width of Staircase</b>			
	<ul style="list-style-type: none"> <li>Upper floors</li> <li>Basement floor</li> </ul>	1.50 m -NA-	1.50m each -NA-	-NA- -NA-
	<b>c. Protection of exits</b>			
	<ul style="list-style-type: none"> <li>Fire check door</li> <li>Pressurization</li> </ul>	Required Required	Provided Provided	MR MR
	<b>d. No. of continuous staircase to terrace</b>	Required	03 Nos Provided	MR
	<b>e. Width of corridor</b>	1.5m /2.0m	Provided	MR
	<b>f. Door size</b>	2m & 1.5m	Provided	MR
<b>3</b>	<b>Compartmentation.</b>			
	<ul style="list-style-type: none"> <li>Fire check door.</li> <li>Sealing of electrical shafts.</li> <li>Fire rating of shaft door.</li> <li>Water curtain</li> <li>Fire dampers.</li> </ul>	Required Required Required -NA- Required	Provided Provided 2 hrs -NA- Provided	MR MR MR -NA- MR
<b>4</b>	<b>Smoke Management system.</b>			
	<ul style="list-style-type: none"> <li>Basement</li> <li>Upper floors/Restt. Area</li> </ul>	30 ACPH 12 ACPH	-NA- Exhaust fan provided	-NA- MR
<b>5</b>	<b>Fire Extinguishers.</b>			
	<ul style="list-style-type: none"> <li>Total numbers</li> <li>Types</li> <li>ISI Marking</li> </ul>	06 Nos. ABC / CO <sub>2</sub> ISI marked	10 Nos Provided Provided	MR MR MR
<b>6</b>	<b>First Aid Hose Reels.</b>			
	<ul style="list-style-type: none"> <li>Total numbers on each floor.</li> <li>Length of hose-reel hose.</li> <li>Nozzle Diameter</li> </ul>	Two 30m 5mm	Provided Provided Provided	MR MR MR


7	<b>Automatic fire detection &amp; alarming system.</b>			
	• Type of detectors	Required	Smoke & Heat	MR
	• Location of Main Panel	Required	Ground Floor	MR
	• Location of Repeater Panel	Ground Floor	Ground Floor	MR
	• Alternate source of power	Required	Provided	MR
	• Hooper's location	Required	Each floor	MR
8	<b>MOEFA</b>	Required	Provided	MR
9	<b>Public Address System</b>	Required	Provided	MR
10	<b>Automatic Sprinkler System</b>			
	• Basement	-NA-	-NA-	-NA-
	• Upper floors	Required	Provided	MR
	• Sprinkler above false ceiling	Required	Provided	MR
11	<b>Internal Hydrants.</b>			
	• Size of Riser/Down-comer	Required	150mm	MR
	• Number of Hydrant per floor	Required	2 Nos	MR
	• Hose box.	Required	2 Nos	MR
12	<b>Yard Hydrants.</b>			
	• Total number of hydrants.	Required	4 Nos	MR
	• Hose box.	Required	4 Nos	MR
13	<b>Pumping arrangements.</b>	<b>Common pumping arrangement for entire complex</b>		
	• <b>Ground Level</b>			
	➤ Discharge of main pump.	2850 LPM x 2	2850 LPM x 2	MR
	➤ Head of main pump.	60m	60m	MR
	➤ Number of main pumps.	Two	Two	MR
	➤ Jockey Pump output.	180 LPM	180 LPM	MR
	➤ Jockey Pump head.	60m	60m	MR
	➤ Standby Pump output.	2850 LPM	2850 LPM	MR
	➤ Standby Pump head.	60m	60m	MR
	➤ Auto Starting/Manual Stopping.	Required	Provided	MR
	➤ Pump House Access	Required	Provided	MR
	• <b>Terrace Level</b>			
	➤ Discharge of pump.	900 LPM	Provided	MR
	➤ Head of pump.	40m	Provided	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14	<b>Captive water storage for Fire Fighting.</b>	<b>Common UG &amp; OHS tank for entire complex</b>		
	• Underground tank capacity.	1,50,000 Ltrs	1,50,000 Ltrs	MR
	➤ Draw-off connection.	Required	Provided	MR
	➤ Fire Service Inlet.	Required	Provided	MR
	➤ Access to tank.	Required	Provided	MR
	• Overhead tank capacity.	25,000 Ltrs	25,000 Ltrs	MR
15	<b>Exit Signage.</b>	Required	Provided	MR
16	<b>Provision of Lifts.</b>	Provided & Maintained by Bldg. Mgmt		
	• Pressurization of lift shaft.	-NA-	As above	-NA-
	• Pressurization of lift lobby.	-NA-	As above	-NA-
	• Communication in lift car.	-NA-	As above	-NA-
	• Fireman's switch.	-NA-	As above	-NA-
	• Lift signage.	-NA-	As above	-NA-
17	<b>Standby Power Supply</b>	Required	Provided	MR
18	<b>Refuge Area</b>			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-

19	<b>Fire Control Room.</b>	• Detector System Panel.	-NA-	Provided	-NA-
		• Flow Switch Panel.	-NA-	-NA-	-NA-
		• PA system Panel.	-NA-	-NA-	-NA-
		• Battery backup	-NA-	Provided	-NA-
		• Building floor plan	-NA-	-NA-	-NA-
20	<b>Special Fire Protection System for the Protection of special Risk, if any :</b>	Required	CO <sub>2</sub> flooding system for LT & HT Panel	MR	

The Fire protection systems provided in the building/premises were checked, tested at random and found functional at the time of inspection. The shortcoming communicated by this department vide letter No. F.6/DFS/MS/EH/2021/301 dated 16/07/2021.


Keeping in view of the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, the fire safety certificate issued vide letter No. F.6/DFS/MS/EH/2018/SZ/388 dated 09/03/2018, renewal under Rule 37 of the Delhi Fire Service Rules, 2010 is recommended.

Accordingly, DFA is put up for approval and signature please.

  
 Signature of the Inspecting Officer  
 Name : S. K. Dua  
 Designation: DO (SD)


DCFO (SZ)


F.T.


  
 29/10


D.O. S.D.

F.T. is put up for sig. pl.

  
 01/11/21

  
 DCFO (SZ)

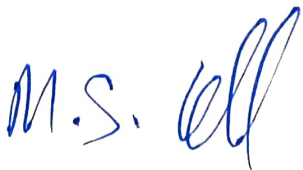

  
 M.S. ell

Unbundled MHA online Portal  
 Uwell  
 08/11/2021