

C-18

FORM 'H': FORM FOR ISSUING FIRE SAFETY CERTIFICATE
[See sub-rule (1) of rule 35]
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

No.F.6/DFS/MS/School/2021/SZ/ 952

Dated: 23 / 11 /2021

FIRE SAFETY CERTIFICATE

Certified that the S.D.M.C. Primary Model Boys School located at Shahpur Jat, New Delhi-110049 comprised of Ground + One Upper Floor only owned / Occupied by S.D.M.C. have been issued Fire Safety Certificate vide letter No. F.6/DFS/MS/School/2018/SZ/1451 dated 20/06/2018. The premises was re-inspected by the officer concerned of this department on 06.10.2021 in the presence of Sh.Vinod Kumar Mishra (Principal) all the Fire prevention and Fire Safety arrangements provided in the premises found in good working condition. The premises have therefore, deemed complied with circular No. F6/Estate/CC/Fire/Safety/2011/3298-3398 dated 01/03/2011 and that the building / premises is fit for occupancy class "Educational" (Group-B) with effect from 23/11/2021 for a period of three years in accordance with rule 36 unless renewal under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the DFS Rules, 2010

Issued on 23/11/2021 at New Delhi by



(SUNIL CHAUDHARY)

DY. CHIEF FIRE OFFICER (SZ)

o/c

Copy to: -

1. Principal, S.D.M.C. Primary Model Boys School, Shahpur Jat, New Delhi-110049.
2. The Director of Education, GNCT of Delhi, Old Secretariat, Delhi-110054

Conditions for the validity of Fire Safety Certificate:

1. All the means of escape / entry / exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided there in shall be maintained in good working conditions at all times.
3. Any loss of life or property due to non-functional fire safety measure shall be at the responsibility of the management.
4. All the staff members must know the correct method of operation of fire fighting system.
5. This Fire Safety Certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3. of UBBL-2016), if any.
6. "The owner / Occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner/occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.Delhigovt.nic.in.

2/- 1)

INSPECTION REPORT

1.	Name & address of the building	S.D.M.C. PRIMARY MODEL BOYS SCHOOL, SHAHPUR JAT, NEW DELHI-110049 (1959013)		
2.	Type of Occupancy	Educational (Group-B) school		
3.	Building Comprised of	G + 01 upper floor		
4.	Type of Case	Renewal		
5.	Details of previous NOC	F.6/DFS/MS/School/2018/SZ/1451 dated 20/06/2018		
6.	Fire Safety directives Letter No	F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011		
7.	Date of Inspection	06.10.2021		
8.	Name of the Inspecting Officer	ADO (SJ)		
9.	Name and Designation of Officer from the building side	Sh. Vinod Kumar Mishra (Principal)		
10.	Year of Construction	2009		
11.	Applicant's letter received Email	mcpriyshpurjatboys@gmail.com dated 27.09.2021		
S. No	Minimum standards on fire prevention and fire safety U/R 33	Old NOC Requirements	Provided at site	Remarks MR/NM R
1.	Access of building			
	• Road width	Required	6m	MR
	• Gate width	NA	4m	NA
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	Required	2Nos	M R
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper floors	1.50 m / 0.75m	2m & 1.25m	MR
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	Required	One provided	MR
	e. Width Of Corridor	NA	NA	NA
	f. Door Size	1m	Provided	MR
3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke managements System			
	• Basements	30 ACPH	NA	NA
	• Upper floors	12 ACPH	NA	NA
5.	Fire Extinguishers			
	• Total numbers	Required	06 Nos.	MR
	• Types	ABC	Provided	MR
	• ISI marking	ISI Marked	Provided	MR
6.	First - Aid Hose Reels			
	• Total numbers on each floor	NA	NA	NA
	• Length of hose reel hose	NA	NA	NA
	• Nozzle diameter	NA	NA	NA

7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detector Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	NA	NA	NA
8.	MOEFA	NA	NA	NA
9.	Public Address System	NA	NA	NA
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basements Upper Floor Sprinkler above false ceiling 	NA	NA	NA
11.	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor 	NA	NA	NA
12.	Yard Hydrants			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	NA	NA	NA
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> Ground Level Discharge of main pump Head of main pump Number of main pumps Jockey pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Staring/Manual stopping Pump House Access Terrace level Discharge of pump Head of the pump Power supply Auto starting of pump 	NA	NA	NA
14.	Captive water Storage for fire fighting			
	<ul style="list-style-type: none"> Underground tank capacity <ul style="list-style-type: none"> Draw of connection Fire service inlet Access to tank Overhead Tank capacity 	NA	NA	NA
15.	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	<ul style="list-style-type: none"> Pressurization of Lift Shaft Pressurization of lift lobby Communication in lift Car Fireman's Grounding Switch Lift Signage 	NA	NA	NA
17.	Standby power supply	NA	NA	NA
18.	Refuge Area			
	<ul style="list-style-type: none"> Total area Location 	NA	NA	NA

19.	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans	NA	NA	NA
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA


The fire protection systems provided in the building were tested, checked at random and found functional at the time of inspection.

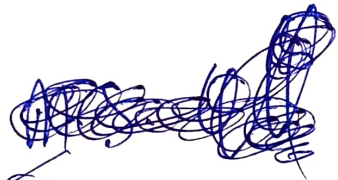
In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the FSC issued vide letter No. F.6/DFS/MS/School/2018/SZ/1451 dated 20/06/2018, renewal under Rule 37 of the Delhi Fire Service Rules 2010 is recommended.

DO(SJ) ?
 Live


Ak Jaiswal
 21/11/2021

Signature of the Inspecting Officer
 Name : Ashok Kumar Jaiswal
 Designation : A.D.O. (S.J.)

DUFO(SJ)


~~DUFO(SJ)~~


ADO(SJ) F.T. is added for sign. P.P.

By CFO(SZ)


Ak
 15/11/2021

M.S. all