

29

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**

No. F6/DFS/MS/EH/WZ/2021/ 354

Dated: 2/12/21

FIRE SAFETY CERTIFICATE

Certified that the M/s. Tom & Jerry restaurant is running at Shop No. 219, 220, 222, SF, DLF City Center Mall building comprised of two tier Basement, ground plus five upper floors, located at A-Block, Shalimar Bagh, New Delhi- 110088, The premises was inspected by the officer concerned of this department on 26.11.2021 in presence of Sh. Pawan Kumar (owner/occupier) and found that the owner have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy Class Assembly Group- D (restaurant) with effect from 2/12/21 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules 2010, printed overleaf.

Issued on 2/12/21 at New Delhi by.


(Atul Garg)
Director

Copy to:-

1. The Owner/occupier, M/s. Tom & Jerry running, Shop No. 219, 220, 222, SF DLF City Center Mall, A-Block, Shalimar Bagh, New Delhi- 110088.
2. The Deputy Health Officer, North Delhi Municipal Corporation, Keshav Puram Zone, Kesav Puram, New Delhi.
3. The Joint Commissioner of Police, Licensing Unit, 1st Floor, Police Station Defence Colony, New Delhi.

CONDITIONS

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non-functional of fire safety measures shall be at the risk & responsibility of the management.
3. The trained firefighting staffs should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. All the means of escapes /exits shall not be locked/bolted/blocked at any time for safe evacuation of the occupants in case of any emergency.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form "J" [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in

24-1

INSPECTION REPORT

1. Name & address of the building: M/s. Tom & Jerry running at Shop No. 219, 220, 222, SF, DLF City Center Mall, A-Block, Shalimar Bagh, New Delhi- 110088
2. Type of Occupancy : Assembly
3. Type of Case : New Case
4. Details of previous NOC : N/A
5. Fire Safety directives Letter No. : N/A
6. Date of inspection : 26-11-2021
7. Name of the Inspecting Officer : M.K. Chattopadhyay, DO (West)
8. Name and designation of Officer
From the building side : Sh. Pawan Kumar, Owner/occupier
9. Year of Construction : 2006
10. Applicant's email date : Online ID 2021091621602

The restaurant is running on second floor of DLF City Center Mall which is already issued FSC vide letter No. F.6/DFS/MS/WZ/Mercantile/2021/549 dated 03.11.2021.

S No	Minimum standards on fire prevention and fire safety U/R 33	NBC/BBL Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	12 mtrs	Provided	MR
	• Gate width	4.5 mtr	Provided	MR
	• Width of internal road	6 mts	Provided	MR
2.	Number, width, Type & Arrangements of exits: common with the mall			
	a. Number of staircases			
	• Upper floors	2	Provided by mall	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper floors	1.5 mts	Provided by mall	MR
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	NA	NA	NA
	e. Width Of Corridor	1.5 mts	Provided	MR
	f. Door Size	1.5 mts each	Provided	MR
3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke managements System			
	• Basements	NA	NA	NA
	• Upper floors	12 a/c per hour	Provided	MR



5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types IS marking 	06 nos. DCP & CO ₂ ISI marked	Provided Provided Provided	MR MR MR
6.	First – Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	01 30 m 5 mm	Provided Provided Provided	MR MR MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	Smoke Required NA Required Required	Provided Provided NA Provided Provided	MR MR NA MR MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	NA	Provided	NA
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basements Upper Floor Sprinkler above false ceiling 	NA Required NA	NA Provided NA	NA MR NA
11.	Internal Hydrants: Common with the mall			
	<ul style="list-style-type: none"> Size of riser/down- comer Number of hydrants per floor Hose Box 	150 mm 01 Required	Provided Provided Provided	MR MR MR
12.	Yard Hydrants			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	NA NA	NA NA	NA NA
13.	Pumping Arrangements: Common with the mall			
	<ul style="list-style-type: none"> Ground Level Discharge of main Pump ➤ Head of main pump ➤ Number of main pumps ➤ Jockey pump out put ➤ Jockey pump head ➤ Standby Pump out put ➤ Standby Pump Head ➤ Auto Staring/Manual stopping ➤ Pump House Access Terrace level ➤ Discharge of pump ➤ Head of the pump ➤ Power supply ➤ Auto starting of pump 	NA NA	4500 LPM 60 mt 03 180 LPM(02) 60 mt 4500 LPM 60 mt provided provided NA NA NA NA NA NA NA NA NA NA	NA NA
14.	Captive water Storage for firefighting: Common with the mall			
	<ul style="list-style-type: none"> Underground tank capacity ➤ Draw off connection ➤ Fire service inlet ➤ Access to tank Overhead Tank capacity 	NA NA Required NA 30, 000 litres	3,00,000 litres Provided Provided Provided provided	NA NA MR NA MR MR
15.	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			




	➤ Pressurization of Lift Shaft	Required	Provided	MR
	➤ Pressurization of lift lobby	NA	NA	NA
	➤ Communication in lift Car	Required	Provided	MR
	➤ Fireman's Grounding Switch	Required	Provided	MR
	➤ Lift Signage	Required	Provided	MR
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans	NA	NA	NA
20.	Special Fire Protection Systems for Protection of special Risks, if any;	Required in Kitchen hood	DCP Flooding system provided	MR

The fire protection systems provided in the building were checked and found functional at the time of inspection.


In view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules, it is recommended to grant fire safety certificate under Delhi Fire Service Act- 2007 & Rules- 2010.

DFA is put up for approval & signature please.


27/11/2021

Signature of the Inspecting Officer
Name: M.K.Chattopadhyay
Designation: DO (West)

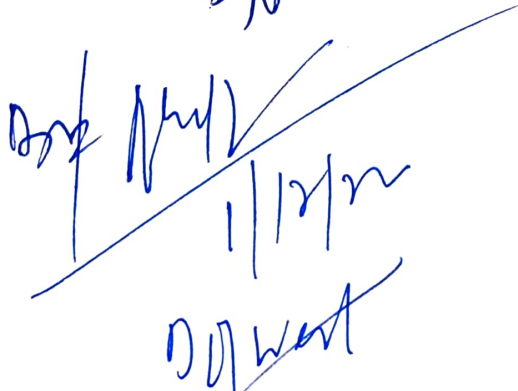
~~DCFO (West Zone)~~


27/11/2021

30/1/20/WD
27/11/2021




30/11


11/12/21
DO West

