

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE**

**NEW DELHI- 110001**


No.F6/DFS/MS/School/2021/SZ / 1003

Dated: 10/12/21

**FIRE SAFETY CERTIFICATE**

Certified that the **Bholi Ram Public school** is running at ground & first floor only in a building of two blocks Old Block & New Block, Both blocks comprised of ground plus two upper floors located at E-57 To 69, Indira Park, Najafgarh, New Delhi- 110043, owned/occupied by Bholi Ram Public School was issued FSC vide letter no. F6/DFS/MS/School/2018/SZ/1591 dated 09/07/2018. The school building was inspected by the officer concerned of this department on dated 07/12/2021 in the presence of Sh. Pardeep Kumar (Principal). The school building have deemed complied with the fire prevention and fire safety requirements in accordance with the Circular No.F.16/Estate/CC/Fire Safety/2011/3298 dated 01.03.2011 issued by Directorate of Education, Govt.of NCT of Delhi, and found that the building (ground & first floor) is fit for occupancy class B 'Educational Building' with effect from 10/12/21.... for a period of three years, subject to conditions printed overleaf.

Issued on.....10/12/21.....at New Delhi by

  
**(Sunil Chawdhary)**  
Dy.Chief Fire Officer  
*9/12*

To,

The principal,  
Bholi Ram Public School,E-57 to 69,  
Indira Park, Najafgarh, New Delhi-110043.

Copy to:-

Director of Education  
Govt. of NCT of Delhi, Old Secretariat,  
New Delhi-110054.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate. six months prior to its expiry.

N/S  
**INSPECTION REPORT**

- 1 Name & address of the building : Bholi Ram Public school, E-57 To 69, Indira Park, Najafgarh, New Delhi-43.
2. Building is comprised of : Two blocks (Old & New) each block having ground plus two upper floors & both blocks are interconnected at all floors. But school is running at Ground & First floor only.
3. Type of Occupancy : Educational
4. Type of Case : Renewal
5. Details of Previous NOC : F.6/DFS/MS/school/2018/SZ/1591 Dt.- 09/07/2018 (G+1)
6. Fire Safety direction letter No : F.16/Estate/CC/Fire Safety/2011/3298 dated 01.03.2011
7. Date of Inspection : 07/12/2021
8. Name of the Inspecting Officers: : ADO R.K. YADAV
9. Name of the designation of Officer from the building side : Sh. Pardeep Kumar (Principal)
10. Year of Construction : Old Block (Before 2008) & New Block (2015)
11. Applicant's letter No : Nil Dated -18/11/2021

S.No	Minimum Standards on fire prevention and fire safety requirements U/R 33	DOE Dated 1.3.2011	Provided at Site	Remarks MR/NMR
1	<b>Access to building</b>			
	Road width	6 m	06 m	MR
	Gate width	4.5	Direct accessible from road	MR
	Width of internal road	N.A.	N.A.	N.A.
2	<b>Number, Width, Type and Arrangement of Exits</b>			
	a. Number of Staircases			
	Upper Floor	2 nos.(Old Blk) 01 no. (New Blk)	2 nos. (Old Blk) 01 no. (New Blk)	MR
	Basement	N.A.	N.A.	N.A.
	B. Width of Staircases			
	Upper Floor	1.5 & 1.31 m (old Blk)	1.5 & 1.31 m (old Blk) &	MR
	Basement	& 1.54 m (New blk)	1.54 m (New blk)	
	c. Protection of exits			
	Fire check door	N.A.	N.A.	N.A.
	Pressurization	N.A.	N.A.	N.A.
	e. No. of continuous staircases to terrace	2 no.	2 no.	MR
g. Width of Corridor	1.5 m	1.50 m	MR	
h. Door Size	1 m	.90 to 1.19 m	MR being old case	
3	<b>Compartmentation.</b>			
	Fire check door	N.A.	N.A.	N.A.
	Sealing of electrical shafts	N.A.	N.A.	N.A.
	Fire rating of shaft door	N.A.	N.A.	N.A.
	Water curtain	N.A.	N.A.	N.A.
	Fire Dampers	N.A.	N.A.	N.A.
4	<b>Smoke Management System.</b>			
	Basement	N.A.	N.A.	N.A.
	Upper floor	Required	Natural ventilation	MR


5.	<b>Fire Extinguisher</b>			
	Total numbers	08 Nos.	16 Nos.	MR
	types	CO <sub>2</sub> & ABC	CO <sub>2</sub> & ABC	MR
	IS marking	ISI marked	ISI marked	MR
6	<b>First-aid-Hose Reels.</b>			
	Total numbers of each floor	N.A.	N.A.	N.A.
	Length of hose reel hose	N.A.	N.A.	N.A.
	Nozzle diameter	N.A.	N.A.	N.A.
7	<b>Automatic fire detection and alarming system.</b>			
	Type of detectors	N.A.	N.A.	N.A.
	Location of main panel	N.A.	N.A.	N.A.
	Location of repeater panel	N.A.	N.A.	N.A.
	Alternate source of power	N.A.	N.A.	N.A.
	Hooters	N.A.	N.A.	N.A.
8	<b>MOEFA</b>		N.A.	N.A.
9	<b>Public address System.</b>		N.A.	N.A.
10	<b>Automatic Sprinkler System.</b>			
	basement	N.A.	N.A.	N.A.
	upper floor	N.A.	N.A.	N.A.
	sprinkler above false ceiling	N.A.	N.A.	N.A.
11	<b>Internal Hydrants</b>			
	size of riser/down-comer	N.A.	N.A.	N.A.
	Number of hydrants per floor	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
12	<b>Yard Hydrants.</b>			
	Total number of hydrants	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
13	<b>Pumping Arrangements.</b>			
	• Ground Level	N.A.	N.A.	N.A.
	➤ Discharge of main Pump	N.A.	N.A.	N.A.
	➤ Head of Main Pump	N.A.	N.A.	N.A.
	➤ Number of main pumps	N.A.	N.A.	N.A.
	➤ Jockey pump out put	N.A.	N.A.	N.A.
	➤ Jockey pump head	N.A.	N.A.	N.A.
	➤ Standby pump out put	N.A.	N.A.	N.A.
	➤ Standby pump Head	N.A.	N.A.	N.A.
	➤ Auto Starting /Manual stopping	N.A.	N.A.	N.A.
	➤ Pump House Access	N.A.	N.A.	N.A.
	• Terrace Level	N.A.	N.A.	N.A.
	➤ Discharge of pump	N.A.	N.A.	N.A.
	➤ Head of the Pump	N.A.	N.A.	N.A.
➤ Power supply	N.A.	N.A.	N.A.	
➤ Auto Starting of pump	N.A.	N.A.	N.A.	

14	<b>Captive Water Storage for Fire Fighting.</b>			
	Underground tank capacity	N.A.	N.A.	N.A.
	Draw-off connection	N.A.	N.A.	N.A.
	Fire service inlet	N.A.	N.A.	N.A.
	Access to tank	N.A.	N.A.	N.A.
	Overhead Tank capacity	N.A.	N.A.	N.A.
15	<b>Exit Signage.</b>	Required	Provided	MR
16	<b>Provision of Lifts.</b>			
	Pressurization of Lift Shaft	N.A.	N.A.	N.A.
	Pressurization of Lift lobby	N.A.	N.A.	N.A.
	Communication in lift car	N.A.	N.A.	N.A.
	Firemen's grounding switch	N.A.	N.A.	N.A.
	Lift Signage	N.A.	N.A.	N.A.
17	<b>Standby power supply</b>	N.A.	N.A.	N.A.
18	<b>Refuge Area.</b>			
	Total area	N.A.	N.A.	N.A.
	Location	N.A.	N.A.	N.A.
19	<b>Fire Control Room</b>			
	Detector system panel	N.A.	N.A.	N.A.
	Flow switch panel	N.A.	N.A.	N.A.
	PA system panel	N.A.	N.A.	N.A.
	Batter backup	N.A.	N.A.	N.A.
	Building Floor Plans	N.A.	N.A.	N.A.
20	<b>Special Fire Protection systems for protection of special Risks, if any:</b>	N.A.	N.A.	N.A.


The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

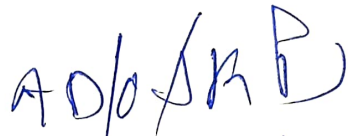
In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the NOC issued vide letter number F.6/DFS/MS/school/2018/SZ/1591 Dt.-09/07/2018 renewal under rule 35 of the Delhi Fire Service Rules 2010 is recommended.

Note: As per submitted undertaking by Principal placed at (C-25,) School building is comprised of ground plus two upper floors but school is running at ground & first floor only and there are less than 45 students in each class room.

  
 Signature of the Inspecting Officer  
 Name RK YADAV  
 Designation ADO (JKP)


DO (South West) on leave  
DYCFOS(2)


F.T.  
  
 9/12

  
 ADO (JKP)

F-T Letter is put up for signature please

DYCFOS(2)

  
 M.S. cell

  
 10/12/2021