

C-26

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110001**

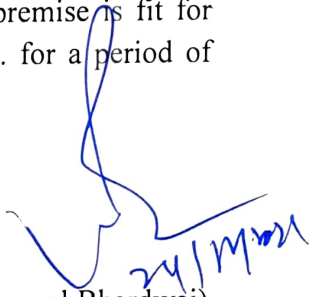
No F6/DFS/MS/School/2021/ w2/1069

Dated: 24/12/2021

**FIRE SAFETY CERTIFICATE**

Certified that the **Venus Public School** located at **Plot No. 01, Opp. Outram Line GTB Nagar, Delhi-110009** comprised of **Ground + 01 upper floor only** owned/ occupied by **Venus Public School** was issued Fire Safety Certificated by this department vide letter no. **No.F6/DFS/MS/2018/2640 dated 07.12.2018** The premises was re-inspected by the officer concerned of this department on **16.12.2021** in presence of **Mr. Sameer Kumar (Manager)** and observed that all the fire safety arrangements as provided in the premises found in good working condition. The premises have deemed complied with requirements of circular issued by Director of Education vide letter no 3298-3398 dated 01.03.2011 and the building/ premise is fit for occupancy class **Group B Educational** with effect from 24/12/2021 for a period of **three years**, subject to compliance of the conditions mentioned below:

Issued on 24/12/2021 at New Delhi by..

  
(Dharampal Bhardwaj)  
Dy.Chief Fire Officer  
Ph:-011-25156707

24/12/2021  
Dy. C.F.O.

Copy to :-

1. The Director, Education, Government of N.C.T of Delhi. Old Sectt. Delhi - 110054.
2. The Manager, Venus Public School located at Plot No. 01, Opp. Outram Line GTB Nagar, Delhi-110009.

**Conditions for the validity of Fire Safety Certificate:**

- 1 All the means of escape/entry/exit shall be kept free from any obstruction.
- 2 All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
- 3 All the staff members must know the correct method of operation of firefighting system.
- 4 The owner / occupier shall submit a declaration **every year** in **Form "K"** provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on <http://delhi.gov.in/wps/wcm/connect/doi/fire/FIRE/Home/Forms>.
- 5 This fire safety certificate may not in any way be treated as regularization ( Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration ( Clause 1.4.3 of UBBL-2016), if any.
- 6 "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in **Form 'J'** [sub rule (1) of rule 37] along with a copy of this Certificate, **six months** prior to its expiry".

**INSPECTION REPORT**

1. Name & address of the building : Venus Public School, Plot No-1, Opp. 1457, Outram Lane, G.T.B Nagar, Delhi-110009.
2. Composition of building : Ground + 01 upper floor Only
3. Type of Occupancy : Educational
4. Type of Case : Renewal
5. Details of previous NOC : F6/DFS/MS/2018/2640 Dated : 07/12/2018
6. Fire Safety directives letter No : Director of Education Letter dated 01.03.2011
7. Date of inspection : 16.12.2021
8. Name of the Inspecting Officers : ADO (RN)
9. Name and designation of officers  
from the building side : Mr. Sameer Kumar (Manager)
10. Year of Construction : 1997
11. Applicant's letter No. : Online E-mail id dated 12.12.2021

Plot Area-1018 Sqm		Covered area ----600sqm ,		No of student—125 nos,		Total class room --11 nos	
Minimum Standards on fire prevention and fire safety U/R 33		Dir. Of Education	Provided at site		Remarks MR/NMR		
1	<b>Access to building</b>						
	• Road width		06m	06m		MR	
	• Gate width		Directly Accessible	Directly Accessible		MR	
	• Width of internal road		NA	NA		NA	
2	<b>Number, Width, Type &amp; Arrangement of Exits</b>						
	a. Number of staircases						
	• Upper Floors		01	01		MR	
	• Basements		NA	NA		NA	
	b. Width of staircases						
	• Upper Floors		1.50 m	1.55m, since 1997		MR(Old Case)	
	• Basements		NA	NA		NA	
	c. Protection of exits						
	• Fire check door		NA	NA		NA	
	• Pressurization		NA	NA		NA	
d. No. of continuous staircases to terrace		NA	NA		NA		
e. Width of Corridor		NA	NA		NA		
f. Door Size		1.m	1.m		MR		
3	<b>Compartmentation.</b>						
	• Fire check door		NA	NA		NA	
	• Sealing of electrical shafts		NA	NA		NA	
	• Fire Rating of shaft door		NA	NA		NA	
	• Water Curtain		NA	NA		NA	
	• Fire Dampers		NA	NA		NA	
4	<b>Smoke Management System.</b>						
	• Basements		30 a/c per hour	No basement		NA	
	• Upper floors		12 a/c per hour	Natural Ventilated		MR	

5	<b>Fire Extinguishers</b>			
	<ul style="list-style-type: none"> <li>Total numbers</li> </ul>	5nos	6nos	MR
	<ul style="list-style-type: none"> <li>Types</li> </ul>	ABC/Co2	ABC--6	MR
	<ul style="list-style-type: none"> <li>ISI marking</li> </ul>	Yes	Yes	MR
6	<b>First-Aid Hose Reels.</b>			
	<ul style="list-style-type: none"> <li>Total numbers on each floor</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Length of hose reel hose</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Nozzle diameter</li> </ul>	NA	NA	NA
7	<b>Automatic fire detection and alarming system</b>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Location of Main Panel</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Location of Repeater Panel</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Alternate source of power</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Hooters' Location</li> </ul>	NA	NA	NA
8	<b>MOEFA</b>	NA	NA	NA
9	<b>Public Address System.</b>	NA	NA	NA
10	<b>Automatic Sprinkler System.</b>			
	<ul style="list-style-type: none"> <li>Basement</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Upper Floor</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Sprinkler above false ceiling</li> </ul>	NA	NA	NA
11	<b>Internal Hydrants</b>			
	<ul style="list-style-type: none"> <li>Size of riser/down-comer</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Number of hydrants per floor</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Hose Box</li> </ul>	NA	NA	NA
12	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Hose Box</li> </ul>	NA	NA	NA
13	<b>Pumping Arrangements.</b>			
	<ul style="list-style-type: none"> <li>Ground Level <ul style="list-style-type: none"> <li>Discharge of main Pump</li> <li>Head of Main pump</li> <li>Number of main pumps</li> <li>Jockey Pump out put</li> <li>Jockey pump head</li> <li>Standby Pump out put</li> <li>Standby Pump Head</li> <li>Auto Starting/ Manual stopping</li> <li>Pump House Access</li> </ul> </li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>Terrace level <ul style="list-style-type: none"> <li>Discharge of pump</li> <li>Head of the pump</li> <li>Power Supply</li> <li>Auto Starting of pump</li> </ul> </li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
14	<b>Captive Water Storage for fire fighting.</b>			
	<ul style="list-style-type: none"> <li>Underground tank capacity</li> </ul>	NA	NA	NA

	<ul style="list-style-type: none"> <li>➤ Draw-off connection</li> <li>➤ Fire service inlet</li> <li>➤ Access to tank</li> <li>• Overhead Tank capacity</li> </ul>	NA	NA	NA
15	Exit Signage.	NA	NA	NA
16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested/ checked randomly and found in good working condition at the time of inspection.

Keeping in view the satisfactory compliance of the minimum standards on fire prevention and fire safety required as stipulated in director of education Circular dated 01.03.2011, it is recommended to renewal of fire safety certificate issued vide this department letter of even no. 2640 dated 07.12.2018.

DO(AW)

22/12/2021  
24/12/2021 (W2)

22/12/2021

Signature of the Inspecting Officer  
Name :-C.L. Meena  
Designation:- ADO/RN

ADO/RN

As approved, F.T. letter is put up for your signature pl.

23/12/2021

Conf ---