

C-16

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, CONNAUGHTPLACE
NEW DELHI- 110001


No.F6/DFS/MS/School/SZ/2021/1074

Dated: 24/12/2021

FIRE SAFETY CERTIFICATE

Certified that the English Foundation School, C-4 Block, Nangli Vihar Extn., (Baprola), Najafgarh, New Delhi-110043, comprised of ground plus two upper floors, owned/occupied by English Foundation School was granted FSC vide letter no. F.6/DFS/MS/School/2018/SZ/55 dated 05/01/2018 (For G+1). The school building was re-inspected by the officer concerned of this department on 14/12/2020 in the presence of Sh. Shail Gambhir (Manager) of the school and found that the school building have deemed complied with the fire prevention and fire safety requirements in accordance with the rule 33 of the Delhi Fire Service Rules 2010 and found that the building is fit for occupancy Group "B" "Educational Building" with effect from ..24/12/2021.. for a period of **three** years, in accordance with the rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010, printed below.

Issued on ..24/12/2021..... at New Delhi by

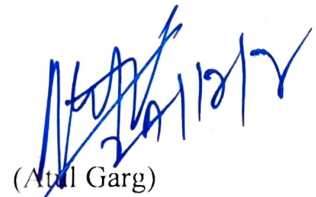

(Atul Garg)

Director

Delhi Fire Service



To,

The Principal, English Foundation School, C-4 Block, Nangli Vihar Extn., (Baprola), Najafgarh, New Delhi-110043.

Copy to:-

The Director of Education, GNCT of Delhi, Old secretariat, Delhi -54.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. All the means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
6. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in
8. The owner / occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' (Sub rule 1 of the rule 37) along with a copy of this certificate, six month prior to its expiry.

INSPECTION REPORT

1. Name & address of the building : English Foundation School, C-4 Block, Nangli Vihar Extn., (Baprola), Najafgarh, New Delhi-110043.
2. Building comprised of : ground plus two upper floors
3. Type of Occupancy : Educational
4. Type of Case : Addition/alteration
5. Details of Previous NOC : F.6/DFS/MS/School/2018/SZ/55 dated 05/01/2018 (For GF & FF Only)
6. Fire Safety directives letter No : N/A
7. Date of inspection : 14/12/2021
8. Name of Inspecting Officer : A.D.O R.K.Yadav
9. Name and designation of officers
From the building side : Sh. Shail Gambhir (Manager)
10. Year of Construction : Before 2006 (GF & FF) & Before 2014 (SF)
11. Applicant's letter No. : Nil dated 06/12/2021

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirements	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	Accessible 06 mtrs 4.5 mtrs N/A	06 mtrs Directly accessible from road N/A	M/R M/R N/A
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> Upper Floors Basements 	02 No.'s N/A	03 No.'s N/A	M/R N/A
	b. Width of staircases			
	<ul style="list-style-type: none"> Upper Floor Basements 	1.5 m & .75 m N/A	1.5, 1.25 & 1.0 m N/A	MR N/A
	c. Protection of exits			
	<ul style="list-style-type: none"> Fire check door Pressurization 	N/A N/A	N/A N/A	N/A N/A
	d. No. of continuous staircases to terrace			
		N/A	One	N/A
	e. Width of Corridor	1.5M	1.5 M	M/R
	f. Door Size	1 M	.90 M (double door)	M/R old accepted
3.	Compartmentation			
	<ul style="list-style-type: none"> Fire check door Sealing of electrical shafts Fire Rating of shaft door Water Curtain Fire Dampers 	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
4.	Smoke Management System			
	<ul style="list-style-type: none"> Basements Upper floors 	N/A Required	N/A Natural ventilation provided	N/A M/R
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types IS marking 	06 no's ABC/CO ₂ type ISI marked	Provided Provided Provided	M/R M/R M/R


6.	First-Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	1 No. 30 m 05mm	Provided Provided Provided	M/R M/R M/R
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Ground Floor Sprinkler above false ceiling 	N/A N/A N/A	N/A N/A N/A	N/A N/A N/A
11.	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box 	N/A N/A N/A	N/A N/A N/A	N/A N/A N/A
12.	Yard Hydrants			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	N/A N/A	N/A N/A	N/A N/A
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/Manual Stopping 	N/A N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A
	<ul style="list-style-type: none"> Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 	N/A 450 LPM 40 M Required Required	N/A Provided Provided Provided Provided	N/A M/R M/R M/R M/R
14.	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> Underground tank capacity <ul style="list-style-type: none"> Draw-off connection Fire service inlet Access to tank Overhead Tank capacity 	N/A N/A N/A N/A 10,000 Liters	N/A N/A N/A N/A Provided	N/A N/A N/A N/A M/R
15.	Exit Signage.	Required	Provided	M/R

N/10

		No Lift		
16.	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17.	Standby power supply	N/A	N/A	N/A
18.	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19.	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection System for Protection of special Risks, if any:	N/A	N/A	N/A


The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules. The FSC was issued vide letter no. F.6/DFS/MS/School/2018/SZ/55 dated 05/01/2018 (For GF & FF Only) is recommended to issue Fire Safety Certificate.


 Signature of the Inspecting Officer
 Name R K YADAV
 Designation ADO (JKP)


Divisional Officer (South West)

22/12/21
1056


 15/12/2021
 Dy C.O. (S2)


 18/12

C.F.O.


 22/12/21

ADP 22/12/21