

C-28

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE

NEW DELHI

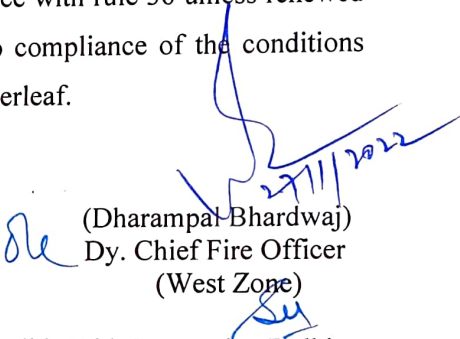
No. F6/DFS/MS/School/WZ/2022/ 71

Dated: 27/1/2022

FIRE SAFETY CERTIFICATE

Certified that the **Kulachi Hansraj Model School**, Located at **Ashok Vihar, Phase-III, Delhi-110052**, comprised of **Basement + Ground + 03 Upper Floors** was issued FSC by this department Vide Letter No. F6/DFS/MS/School/2017/WZ/1828 dated 15.12.2017. The said premises was re-inspected by the officer concerned of this department on 24.01.2022 in the presence of Sh. Rakesh Kumar (Maintenance Supervisor) and found that the premises / building have deemed complied with the fire prevention and fire safety requirements in accordance with NBC/rule 33 of the Delhi Fire Service rules 2010 and that the premises/building is fit for occupancy class "Educational Building" Group B with effect from 27/1/22 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40, subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010, printed overleaf.

Issued on 27/1/22 at New Delhi by.


(Dharampal Bhardwaj)
Dy. Chief Fire Officer
(West Zone)

Copy to: -

1. The Director, Directorate of Education, GNCT of Delhi, Old Secretariat Delhi – 110054.
2. The Principal, Kulachi Hansraj Model School, Located at, Ashok Vihar, Phase-III, Delhi-110052.

Following fire safety directives must be adhered to:-

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional if fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupation, electric installation etc. may be got verified from the concerned authorities.
5. The Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction / unauthorized use of land if any.
6. Basement shall not be used for school activity or any other purpose.
7. All comments / directions of licensing Department shall always be permitted and followed.
8. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in
9. The owner / occupier shall apply for renewal of this Fire Safety Certificate to the Director in 'Form J' (sub Rule (1) of Rule 37) along with copy of the certificate, six months prior to its expiry.

1478

INSPECTION REPORT

1. Name & address of the building: **Kulachi Hansraj Model School**, Located at **Ashok Vihar, Phase-III, Delhi -110052**
2. Type of Occupancy : Educational (Basement +Ground + 3 Upper Floor)
3. Type of Case : Renewal
4. Details of previous NOC: F6/DFS/MS/SCHOOL/2017/WZ/1828 dated 15.12.2017
5. Fire Safety directives Letter No. : NBC
6. Date of inspection : 24.01.2022
7. Name of the Inspecting Officer : S.P. Bhardwaj, DO
8. Name and designation of Officer from the building side : Sh. Rakesh Kumar (Maintenance Supervisor)
9. Year of Construction : 1985
10. Applicant's letter No. : email dated 17.01.2022

S No	Minimum standards on fire prevention and fire safety U/R 33	NBC Requirements/letter dated 15.12.2017	Provided at site	Remarks MR/NMR
1.	Access of building			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	12mtrs 4.5 mtrs Required	16 m Provided 5.20 mtrs Provided Provided	MR MR MR
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	4nos	05 Provided	MR
	• Basements	3nos	03 Provided	MR
	b. Width of staircases			
	• Upper floors	1.5mtrs. Each	4x152cm&1x135cm	MR
	• Basements	NA	1x110cm,1x138cm & 1x145cm	NA (Basement shall not be used)
	c. Protection of exits			
	• Fire check door	NA	Provided	NA (Basement shall not be used)
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	2 nos	02 Provided	MR
	e. Width Of Corridor	NA	217 cm Provided	NA
	f. Door Size	1 mtr.	110 cm Provided	MR
3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke managements Syst.			
	• Basements	NA	Provided	NA (Basement shall not be used)
	• Upper floors	NA	NA	NA
5.	Fire Extinguishers			
	• Total numbers	40 nos.	52 Provided	MR
	• Types	ABC & CO ₂	Provided	MR
	• IS marking	ISI marked	Provided	MR

6.	First - Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor 	4 nos	04 Provided	MR
	<ul style="list-style-type: none"> Length of hose reel hose 	30m	Provided	MR
	<ul style="list-style-type: none"> Nozzle diameter 	5mm	Provided	MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detectors 	NA	NA	NA
	<ul style="list-style-type: none"> Location of Main Panel 	NA	NA	NA
	<ul style="list-style-type: none"> Location of Repeater Panel 	NA	NA	NA
	<ul style="list-style-type: none"> Alternate source of power 	NA	NA	NA
	<ul style="list-style-type: none"> Hooters' Location 	NA	NA	NA
8.	MOEFA	NA	NA	NA
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basements 	Required	Provided	MR
	<ul style="list-style-type: none"> Upper Floor 	NA	NA	NA
	<ul style="list-style-type: none"> Sprinkler above false ceiling 	NA	NA	NA
11.	Internal Hydrants:			
	<ul style="list-style-type: none"> Size of riser/down-comer 	150mm	Provided	MR
	<ul style="list-style-type: none"> Number of hyd/floor 	NA	Provided at Ground Floor	NA
	<ul style="list-style-type: none"> Hose Box 	NA	Provided at Ground Floor	NA
12.	Yard Hydrants			
	<ul style="list-style-type: none"> Total number of hydrants 	NA	NA	NA
	<ul style="list-style-type: none"> Hose Box 	NA	NA	NA
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> Ground Level 	NA	NA	NA
	<ul style="list-style-type: none"> Discharge of main pump 	NA	NA	NA
	<ul style="list-style-type: none"> Head of main pump 	NA	NA	NA
	<ul style="list-style-type: none"> Number of main pumps 	NA	NA	NA
	<ul style="list-style-type: none"> Jockey pump out put 	NA	NA	NA
	<ul style="list-style-type: none"> Jockey pump head 	NA	NA	NA
	<ul style="list-style-type: none"> Standby Pump out put 	NA	NA	NA
	<ul style="list-style-type: none"> Standby Pump Head 	NA	NA	NA
	<ul style="list-style-type: none"> Auto Staring/Manual stopping 	NA	NA	NA
	<ul style="list-style-type: none"> Pump House Access 	NA	NA	NA
	<ul style="list-style-type: none"> Terrace level 			
	<ul style="list-style-type: none"> Discharge of pump 	900 lpm	Provided	MR
	<ul style="list-style-type: none"> Head of the pump 	40Mtrs	Provided	MR
	<ul style="list-style-type: none"> Power supply 	Required	Provided	MR
	<ul style="list-style-type: none"> Auto starting of pump 	Required	Provided	MR
14.	Captive water Storage for firefighting:			
	<ul style="list-style-type: none"> Underground tank capacity 	NA	NA	NA
	<ul style="list-style-type: none"> Draw off connection 	NA	NA	NA
	<ul style="list-style-type: none"> Fire service inlet 	NA	NA	NA
	<ul style="list-style-type: none"> Access to tank 	NA	NA	NA
	<ul style="list-style-type: none"> Overhead Tank capacity 	20000Ltrs	Provided	MR
15	Exit Signage	Required	Removed	MR
16.	Provision of Lifts			
	<ul style="list-style-type: none"> Pressurization of Lift Shaft 	NA	NA	NA
	<ul style="list-style-type: none"> Pressurization of lift lobby 	NA	NA	NA
	<ul style="list-style-type: none"> Communication in lift Car 	NA	NA	NA

55

	Switch ➤ Lift Signage	NA	NA	NA
17.	Standby power supply	NA	NA	NA
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans	NA	NA	NA
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA

Fire protection systems provided in the building were checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards on fire prevention and fire safety requirements under the rules, renewal of Fire Safety Certificate issued vide letter no. F6/DFS/MS/SCHOOL/2017/WZ/1828 dated 15.12.2017 is recommended under rules 37 of the Delhi Fire Service Rules 2010 under the DFS Act 2007.

[Signature]
S.P. Bhardwaj
Divisional Officer

~~Do/went DTH~~
~~Defot WZ~~

[Signature]
25/11/2022

~~Do/SP - Bhardwaj~~

FT is put up for signat ph

~~Defot WZ~~
[Signature]
27/11/2022

[Signature]
27/11/22

next all