

C-21

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001**

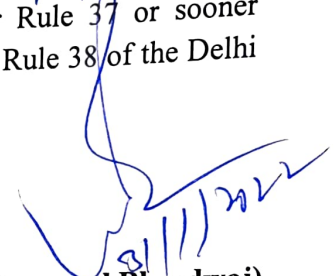
No. F6/DFS/MS/2022/School/WZ/ 91

Dated: 01/2/22

**FIRE SAFETY CERTIFICATE**

Certified that the **Deep Modern Public School, Prem Nagar-III, Part-1, Kirari, Delhi-86**, comprised of **Ground + 02 upper floors** has already been issued FSC by this department vide letter No. **F.6/DFS/MS/2018/School/2012 dated 31.08.2018**. The premises was re-inspected by the officer concerned of this department on **18.01.2022** in the presence of **Sh. Anil Kumar (Owner)** and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy class **Educational 'Group B'** with effect from 01/2/22 for a period of **three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subjected to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on ..... 01/2/22 ..... at New Delhi by

  
**(Dhrampal Bhardwaj)**  
**Dy.Chief Fire Officer**  
**Tel;-01123414250**

Copy to :-

1. The Principal, Deep Modern Public School, Prem Nagar-III, Part-1, Kirari, Delhi-86.
2. The Director, Education, Government of N.C.T of Delhi. Old Sect. Delhi - 54.

**Conditions for the validity of fire safety certificate:**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection.
3. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
4. All the staff members must know the correct method of operation of firefighting system.
5. The owner/ occupier shall submit a declaration **every year in Form 'K'** [sub rule (2) of Rule 38] provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [http://delhi.gov.in/wps/wcm/connect/doiit\\_fire/FIRE/Home/Forms](http://delhi.gov.in/wps/wcm/connect/doiit_fire/FIRE/Home/Forms)
6. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction (Clause 2.9.2 of UBBL-2016) or Alteration (Clause 1.4.3 of UBBL-2016), if any.
7. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in **Form 'J'** [sub rule (1) of Rule 37] along with a copy of this Certificate, **six months** prior to its expiry."

**INSPECTION REPORT**

1. Name & address of the building : Deep Modern Public School, Prem Nagar-III, Part-1, Kirari, Delhi-86
2. Type of Occupancy : Educational
3. Type of Case : Renewal (**Ground + 02 upper floors**)
4. Details of Previous NOC : F.6/DFS/MS/2018/School/2012 dated 31.08.2018
5. Fire Safety directives letter No : NBC Part -IV
6. Date of inspection : 18.01.2022
7. Name of Inspecting Officer : A.K.Sharma ADO(Rohini)
8. Name and designation of officers  
From the building side : Sh. Anil Kumar (Owner)
9. Year of Construction : 2010
10. Applicant's letter No. : Online e-mail dated 20.12.2021.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1.	<b>Access to building</b>			
	<ul style="list-style-type: none"> <li>• Road width</li> <li>• Gate width</li> <li>• Width of internal road</li> </ul>	<ul style="list-style-type: none"> <li>Accessible</li> <li>Accessible</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>Accessible</li> <li>4.5m</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> <li>NA</li> </ul>
2.	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	a. Number of staircases			
	<ul style="list-style-type: none"> <li>• Upper Floors</li> <li>• Basements</li> </ul>	<ul style="list-style-type: none"> <li>01</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>01</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>NA</li> </ul>
	b. Width of staircases			
	<ul style="list-style-type: none"> <li>• Upper Floor</li> <li>• Basements</li> </ul>	<ul style="list-style-type: none"> <li>1.5m</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>1.5m</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>NA</li> </ul>
	c. Protection of exits			
	Fire check door			
	<ul style="list-style-type: none"> <li>• Pressurization</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> </ul>
	d. No. of continuous staircases to terrace			
	e. Width of Corridor			
	f. Door Size			
		01	01	MR
		NA	NA	NA
		1.0m	1.10m	MR
3.	<b>Compartmentation</b>			
	<ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Sealing of electrical shafts</li> <li>• Fire Rating of shaft door</li> <li>• Water Curtain</li> <li>• Fire Dampers</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>
4.	<b>Smoke Management System</b>			
	<ul style="list-style-type: none"> <li>• Basements</li> <li>• Upper floors</li> </ul>	<ul style="list-style-type: none"> <li>30 a/c per hour</li> <li>12 a/c per hour</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>Natural ventilated</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>MR</li> </ul>
5.	<b>Fire Extinguishers</b>			
	<ul style="list-style-type: none"> <li>• Total numbers</li> <li>• Types</li> <li>• IS marking</li> </ul>	<ul style="list-style-type: none"> <li>07nos.</li> <li>ABC/CO2</li> <li>ISI marked</li> </ul>	<ul style="list-style-type: none"> <li>08nos.</li> <li>ABC-8</li> <li>Yes</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> <li>MR</li> </ul>
6.	<b>First-Aid Hose Reels</b>			
	<ul style="list-style-type: none"> <li>• Total numbers on each floor</li> <li>• Length of hose reel hose</li> <li>• Nozzle diameter</li> </ul>	<ul style="list-style-type: none"> <li>01</li> <li>30mm</li> <li>5m</li> </ul>	<ul style="list-style-type: none"> <li>Provided</li> <li>Provided</li> <li>Provided</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> <li>MR</li> </ul>
7.	<b>Automatic fire detection and alarming system</b>			
	<ul style="list-style-type: none"> <li>• Type of detectors</li> <li>• Location of Main Panel</li> <li>• Location of Repeater Panel</li> <li>• Alternate source of power</li> <li>• Hooters' Location</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>

8.	MOEFA	NA	NA	NA
9.	Public Address System	NA	NA	NA
10.	Automatic Sprinkler System	NA	NA	NA
	• Basement	NA	NA	NA
	• Ground & Upper Floors	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants	NA	NA	NA
	• Size of riser/down-comer	NA	NA	NA
	• Number of hydrants per floor	NA	NA	NA
	• Hose Box	NA	NA	NA
12.	Yard Hydrants	NA	NA	NA
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13.	Pumping Arrangements	NA	NA	NA
	• Ground Level	NA	NA	NA
	➤ Discharge of main Pump	NA	NA	NA
	➤ Head of Main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey Pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Starting/Manual Stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level			
	➤ Discharge of pump	450lpm	450lpm	MR
	➤ Head of the pump	40m	40m	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14.	Captive Water Storage for fire fighting			
	• Underground tank capacity	NA	NA	NA
	➤ Draw-off connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	10,000ltr	10,000ltr	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of Lift Shaft	NA	NA	NA
	• Pressurization of Lift lobby	NA	NA	NA
	• Communication In lift Car	NA	NA	NA
	• Fireman's Grounding Switch	NA	NA	NA
	• Lift Signage	NA	NA	NA
17.	Standby power supply	NA	NA	NA
18.	Refuge Area.			
	➤ Total Area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire Control Room			
	• Detector System Panel	NA	NA	NA
	• Flow Switch Panel	NA	NA	NA
	• PA System Panel	NA	NA	NA
	• Battery backup	NA	NA	NA
	• Building Floor Plans	NA	NA	NA
20.	Special Fire Protection System for Protection of special Risks, if any:	NA	NA	NA

11-19

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. **F.6/DFS/MS/2018/School/2012 dated 31.08.2018** is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.

*Ajay K*  
19/11/22

Signature of the Inspecting Officer  
Name **Ajay Kumar Sharma**  
Designation **ADO(Rohini)**

~~DO (NW)~~

*Ajay K*  
20/10/2022

Dy cfo (S2)

*FT*  
*[Signature]*  
27/11/2022

*[Signature]*

~~ADO Rohini~~

FT letter is put up for kind perusal and signature please.

*[Signature]*  
28/11/22

~~DeFO (w2)~~

*[Signature]*  
31/11/2022

~~MS/UP~~