

3677/AD/1/2022

C-28

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE**  
**NEW DELHI**

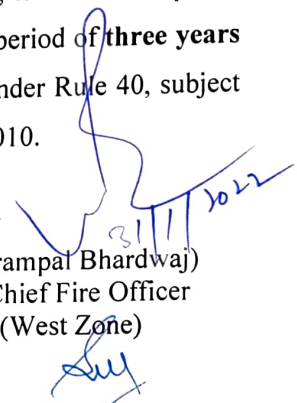
No. F6/DFS/MS/School/WZ/2022/ 84

Dated: 01/12/2022

**FIRE SAFETY CERTIFICATE**

Certified that the **Rajan D S Public School** Located at **Ground and 1<sup>st</sup> Floor, A-762, Shastri Nagar, Delhi- 110052** in a building comprised of Ground + 03 Upper Floors was issued Fire Safety Certificate by this department Vide Letter No. F6/DFS/MS/WZ/2019/90 dated 10.01.2019. The said premise was re-inspected by the officer concerned of this department on 19.01.2022 in the presence of Sh. Rajan Dhiman (Director) and found that the premises/building have deemed complied with the fire prevention and fire safety requirements in accordance with D.O.E., GNCT of Delhi, Circular no.3298-3398 dated 01-03-2011 and that the premises/building is fit for occupancy class "Educational Building" Group B with effect from 01/12/22 for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40, subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on .....01/12/22... at New Delhi.

  
(Dharampal Bhardwaj)  
Dy. Chief Fire Officer  
(West Zone)

Copy to:

1. The Principal, Rajan D S Public School, Ground and 1<sup>st</sup> Floor, A-762, Shastri Nagar, Delhi- 110052
2. The Director, Directorate of Education Old Secretariat Delhi – 110054.

**Following fire safety directives must be adhered to:-**

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional if fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupation, electric installation etc. may be got verified from the concerned authorities.
5. The Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction / unauthorized use of land if any.
6. All comments / directions of licensing Department shall always be permitted and followed.
7. The owner /occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
8. The owner / occupier shall apply for renewal of this Fire Safety Certificate to the Director in 'Form J' (sub Rule (1) of Rule 37) along with copy of the certificate, six months prior to its expiry.

INSPECTION REPORT

1. Name & address of the building: **Rajan D S Public School** Located at **Ground and 1<sup>st</sup> Floor. A-762, Shastri Nagar, Delhi- 110034.**
2. Details of previous NOC : F6/DFS/MS/WZ/2019/90 dated 10.01.2019
3. Type of Occupancy : Educational (Ground+1 Upper Floor in School and Residence on Second & 3rd Upper Floor)
4. Type of Case : Renewal
5. Fire Safety directives Letter No. : DOE 3298-3398 dated 01-03-2011.
6. Date of inspection : 19.01.2022
7. Name of the Inspecting Officer ; S.P. Bhardwaj, DO
8. Name and designation of Officer  
from the building side : Sh. Rajan Dhiman (Director)
9. Year of Construction : 1988-89
10. Applicant's letter No. : Nil dated 03.01.2022

S No	Minimum standards on fire prevention and fire safety U/R 33	DOE 3298-3398 dated 01-03-2011/letter dated 03.01.2022	Provided at site	Remarks MR/NMR
1.	Access of building			
	<ul style="list-style-type: none"> <li>• Road width</li> <li>• Gate width</li> <li>• Width of internal road</li> </ul>	<ul style="list-style-type: none"> <li>Accessible</li> <li>Accessible</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>Provided</li> <li>Provided</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> <li>NA</li> </ul>
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> <li>• Upper floors</li> <li>• Basements</li> </ul>	<ul style="list-style-type: none"> <li>01</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>02</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>NA</li> </ul>
	b. Width of staircases			
	<ul style="list-style-type: none"> <li>• Upper floors</li> <li>• Basements</li> </ul>	<ul style="list-style-type: none"> <li>1x150cm</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>2x94cm</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>MR(Old Case)</li> <li>NA</li> </ul>
	c. Protection of exits			
	<ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Pressurization</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>
	d. No of continuous staircase to terrace	NA	NA	NA
	e. Width Of Corridor	NA	144cm	NA
	f. Door Size	1 mtr	1m Provided Include door frame	MR
3.	Compartmentation			
	<ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Sealing of electrical shafts</li> <li>• Fire Rating of shaft door</li> <li>• Water Curtain</li> <li>• Fire Dampers</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>
4.	Smoke managements System			
	<ul style="list-style-type: none"> <li>• Basements</li> <li>• Upper floors</li> </ul>	<ul style="list-style-type: none"> <li>30 a/c per hrs</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> </ul>
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> <li>• Total numbers</li> <li>• Types</li> <li>• IS marking</li> </ul>	<ul style="list-style-type: none"> <li>6 nos.</li> <li>ABC &amp; CO<sub>2</sub></li> <li>ISI marked</li> </ul>	<ul style="list-style-type: none"> <li>Provided</li> <li>Provided</li> <li>Provided</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> <li>MR</li> </ul>

6.	First – Aid Hose Reels			
	• Total numbers on each floor	NA	NA	NA
	• Length of hose reel hose	NA	NA	NA
	• Nozzle diameter	NA	NA	NA
7.	Automatic fire detection and alarming system			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8.	MOEFA	NA	NA	NA
9.	Public Address System	NA	NA	NA
10.	Automatic Sprinkler System			
	• Basements	NA	NA	NA
	• Upper Floor	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants:			
	• Size of riser/down-comer	NA	NA	NA
	• Number of hydrants per floor	NA	NA	NA
	• Hose Box	NA	NA	NA
12.	Yard Hydrants			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13.	Pumping Arrangements:			
	• Ground Level			
	• Discharge of main pump	NA	NA	NA
	➤ Head of main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Staring/Manual stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level			
	➤ Discharge of pump	NA	NA	NA
	➤ Head of the pump	NA	NA	NA
	➤ Power supply	NA	NA	NA
	➤ Auto starting of pump	NA	NA	NA
14.	Captive water Storage for firefighting:			
	• Under ground tank capacity	NA	NA	NA
	➤ Draw off connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	NA	NA	NA

		Required	Provided	MR
15	Exit Signage			
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	NA	NA	NA
	➤ Pressurization of lift lobby	NA	NA	NA
	➤ Communication in lift Car	NA	NA	NA
	➤ Fireman's Grounding Switch	NA	NA	NA
	➤ Lift Signage	NA	NA	NA
17.	Standby power supply	NA	NA	NA
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans	NA	NA	NA
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA

Fire protection systems provided in the building were checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards on fire prevention and fire safety requirements as per D.O.E. Circular no. 3298-3398 dated 01.03.2011, renewal of Fire Safety Certificate issued vide letter no. F6/DFS/MS/WZ/2019/90 dated 10.01.2019 is recommended.

*S.P. Bhardwaj*  
 S.P. Bhardwaj 19/11/2022  
 Divisional Officer

~~DO/west~~

What is the use of 2nd & 3rd floor ?

~~DO (SPB)~~

Sir, 2nd & 3rd floor are

being used as residence.

*S.P. Bhardwaj*  
 19/11/2022

~~DO/west~~

*S.P. Bhardwaj*  
 19/11/2022

*S.P. Bhardwaj*  
 19/11/22  
 27/11/2022

~~DO (WZ)~~

~~DO/west~~

D.O. (WEST) 337  
 DATED: 19/11/2022