

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**


No. F6/DFS/MS/EH/SZ/2022/ 30

Dated: 08/02/2022

FIRE SAFETY CERTIFICATE

Certified that the **M/s. Sagar Ratna Restaurant** running at Ground Floor of a building comprised of basement, stilt, ground plus three upper floors located at Property No. E-8, Naraina Vihar, Naraina, New Delhi, owned/occupied by Sagar Ratna Restaurants Pvt. Ltd. have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officers concerned of Fire Service on 27.01.2022 in presence of Mr. Rajesh (Manager) and the building/premises is fit for occupancy class Assembly **(Restaurant)** running at **Ground Floor Only** with effect from 08/02/2022 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules 2010, mentioned below.

Issued on 08/02/2022 at New Delhi by.

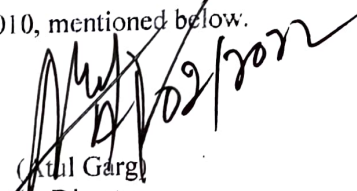
(Atul Garg)
Director
Delhi Fire Service

Copy to:-

1. The Owner/Occupier, M/s. Sagar Ratna Resturant located at E-8, 1st Floor, Naraina Vihar, New Delhi - 110028.

Conditions for the validity of Fire Safety Certificate: -

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non-functional of fire safety measures shall be at the risk & responsibility of the management.
3. The trained firefighting staffs should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. All the means of escapes /exits shall not be locked/bolted/blocked at any time for safe evacuation of the occupants in case of any emergency.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form "J" [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in

N-37
INSPECTION REPORT

1. Name & address of the building : Sagar Ratna restaurant located at E-8, 1st Floor, Naraina Vihar, New Delhi
2. Type of Occupancy : Assembly (Restaurant - running at ground floor)
3. Type of Case : New Case
4. Details of previous NOC : N/A
5. Fire Safety directives letter No : N/A
6. Date of inspection : 27.01.2022
5. Name of the Inspecting Officers : D.B. Mukharjee, DO (SW) & P.V. Rathee, ADO (SRD)
7. Name and designation of officers from the building side : Sh. Rajesh, Manager
9. Year of Construction : 2014
10. Applicant's letter No. : Online application ID 2022011900977 dated 19.01.2022

The said restaurant is running at ground floor of a building comprised of basement, stilt, ground plus three upper floors.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement as per NBC part-IV/UBBL	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	06 mts	Provided	MR
	• Gate width	4.5 mts	Provided	MR
	• Width of internal road	N/A	N/A	N/A
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	-	-	-
	• Upper Floors	02	Provided	Restaurant running at GF only
	• Basements	N/A	N/A	Restaurant running at GF only
	b. Width of staircases	-	-	-
	• Upper Floors	1.5 mts (2 Nos)	2.0, 1.50 & 0.95 mts	Restaurant running at GF only
	• Basements	N/A	N/A	Restaurant running at GF only
	c. Protection of exits	-	-	-
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
		--	----	---
	e. No. of continuous staircases to terrace	N/A	N/A	N/A
	g. Width of Corridor	2.0, 1.5 mts	2.0, 1.50 & 0.92 mts	MR
	h. Door Size			
3	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	Smoke Management System.			
	• Basements	30 a/c per hour	N/A	N/A
	• Upper floors	12 a/c per hour	Natural ventilation	MR
5	Fire Extinguishers			
	• Total numbers	08	Provided	MR
	• Types	CO ₂ , ABC type	Provided	MR
	• IS marking	ISI marked	Provided	MR

DB

6	First-Aid Hose Reels.			
	• Total numbers on each floor	01	Provided	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7	Automatic fire detection and alarming system.			
	• Type of detectors	Smoke	Provided	MR
	• Location of Main Panel	Required With in restaurant area	Provided	MR
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	Required	Provided	MR
	• Hooters' Location	N/A	N/A	N/A
8	MOEFA	Required	Provided	MR
9	Public Address System.	Required	Provided	MR
10	Automatic Sprinkler System.			
	• Basement	N/A	N/A	N/A
	• Entire Restaurant	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	• Size of riser/down-comer	100 mm	Provided	MR
	• Number of hydrants per floor	01	Provided	MR
	• Hose Box	01	Provided	MR
12	Yard Hydrants.			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13	Pumping Arrangements.			
	• Ground Level	---	---	---
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey Pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/ Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level	-----	-----	-----
	➤ Discharge of pump	450 LPM	450 LPM (2)	MR
	➤ Head of the pump	40 mts	40 mts each	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	20,000 lts	Provided	MR
15	Exit Signage.	Required	Provided	MR

10

16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	Required	Provided	MR
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	Required	Provided	MR
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	Required	Two ABC type fire extinguisher found provided near elect. panel	MR

The fire protection systems provided in the building were checked and found functional at the time of inspection.


Note:- The total covered area of restaurant as per MHA CAF portal is 184 Sq mtr., so sitting capacity comes (184/1.8 = 102) 102 persons.

In view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules, it is recommended to grant fire safety certificate under Delhi Fire Service Act-2007 & Rules-2010.

DFA is put up for approval & signature please.

[Signature]
 28/11/2022
 Name of inspecting officer
 D.B. Mukharjee
 Divisional Officer (SW)

[Signature]
 28/11/22
 Name of inspecting officer
 P.V. Rathee
 Asstt. Div. Officer (SRD)



[Handwritten notes and signatures]
 Dy chg / 22
 F. I.
 1/2
 C.F.O.
 2/2
 put up on 26/11
 of FT
 DD/SW