

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No. F6/DFS/MS/ WZ/2022/ 67

Dated: 11/02/2022

FIRE SAFETY CERTIFICATE

Certified that the **Multipurpose Community Hall, Plot No.9, 10 & 11 at LCS/OCF-3, in Pocket A-1, Sector-8, Rohini, Delhi**, comprised of **Ground + Two upper floors** owned/occupied by **DDA** have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officer concerned of fire service on dated **08.12.2021** in the presence of **Sh. S. S. Zaidi AE(Civil) DDA**, and that the building/ premise is fit for occupancy **Assembly Building** with effect from 11/02/2022 for a period of **three years**, in accordance with the rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 11/02/2022 at New Delhi by


(Anil Garg)
DIRECTOR
Ph; 011-23414000

Copy to:

1. Executive Engineer (E)/ Elect. Division-09, 6th floor, DDA Zonal Building, Near Madhuban Chowk, Rohini, Delhi.
2. Multipurpose Community Hall, Plot No.9, 10 & 11 at LCS/OCF-3, in Pocket A-1, Sector-8, Rohini, Delhi-85.

Conditions for validity of Fire Safety Certificate;

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director along with a copy of this Certificate, six months prior to its expiry”.
7. The owner / occupier shall submit a declaration every year in form “K” provided in the first schedule of Delhi Fire Service Rules 2010. The form ”K” is available on

http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/
http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms

INSPECTION REPORT

1. Name & address of the building : Multipurpose Community Hall, Plot No.9, 10 & 11 at LCS/OCF-3 in Pocket A-1, Sector-8, Rohini, Delhi.
2. Type of Occupancy : Assembly
3. Type of Case : New Case (**Ground + Two upper floors**)
4. Details of Previous NOC : N/A
5. Fire Safety directives letter No : F.6/DFS/MS/BP/2018/228 dated 20.07.2018
6. Date of inspection : 08.12.2021
7. Name of Inspecting Officer : A. K. Sharma, ADO (Rohini) & D.B Mukherjee, DO (NW)
8. Name and designation of officers
From the building side : Sh. S. S. Zaidi AE(Civil), DDA
9. Year of Construction : 2015
10. Applicant's letter No. : Online e-mail dated 08.11.2021

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	BBL/NBC Requirement	Provided at site	Remarks MR/NMR
1.	Access to building			
	• Road width	18.0m & 7.5m	Provided	MR
	• Gate width	4.5m	6.0m	MR
	• Width of internal road	NA	NA	NA
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	02	02	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floor	2.0m & 1.5m	2 x 2.05m	MR
	• Basements	NA	NA	NA
	c. Protection of exits			
	Fire check door	NA	Provided	MR
	• Pressurization	NA	NA	NA
	d. No. of continuous staircases to terrace	02	02	MR
	e. Width of Corridor	02m	Provided	MR
	f. Door Size	02 m	Provided	MR
3.	Compartmentation			
	• Fire check door	Required	Provided	MR
	• Sealing of electrical shafts	Required	Provided	MR
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke Management System			
	• Basements	NA	NA	NA
	• Upper floors	12 a/c per hour	Natural ventilated	MR
5.	Fire Extinguishers			
	• Total numbers	09	Provided	MR
	• Types	ABC/CO2	ABC/CO2	MR
	• IS marking	ISI marked	Yes	MR
6.	First-Aid Hose Reels			
	• Total numbers on each floor	01	Provided	MR
	• Length of hose reel hose	30mm	Provided	MR
	• Nozzle diameter	5m	Provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detectors	Smoke	Provided	MR
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA

N/1

20.

	• Hooters' Location	NA	NA	NA
8.	MOEFA	Required	Provided	MR
9.	Public Address System	NA	NA	NA
10.	Automatic Sprinkler System			
	• Basement	NA	NA	NA
	• Ground & Upper Floors	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants			
	• Size of riser/down-comer	100 mm	Provided	MR
	• Number of hydrants per floor	01	Provided	MR
	• Hose Box	01	Provided	MR
12.	Yard Hydrants			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13.	Pumping Arrangements			
	• Ground Level			
	➤ Discharge of main Pump	2280lpm	2280lpm	MR
	➤ Head of Main pump	50 m	Provided	MR
	➤ Number of main pumps	01	01	MR
	➤ Jockey Pump out put	180lpm	180lpm	MR
	➤ Jockey pump head	50 m	Provided	MR
	➤ Standby Pump out put	2280lpm	2280lpm	MR
	➤ Standby Pump Head	50 m	Provided	MR
	➤ Auto Starting/Manual Stopping	Required	Provided	MR
	➤ Pump House Access	Required	Provided	MR
	• Terrace level			
	➤ Discharge of pump	450lpm	450lpm	MR
	➤ Head of the pump	40m	40m	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14.	Captive Water Storage for fire fighting			
	• Underground tank capacity	10,000ltr	Provided	MR
	➤ Draw-off connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	5000ltr	Provided	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of Lift Shaft	NA	NA	NA
	• Pressurization of Lift lobby	NA	NA	NA
	• Communication In lift Car	NA	NA	NA
	• Fireman's Grounding Switch	NA	NA	NA
	• Lift Signage	NA	NA	NA
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area.			
	➤ Total Area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire Control Room			
	• Detector System Panel	NA	NA	NA
	• Flow Switch Panel	NA	NA	NA
	• PA System Panel	NA	NA	NA
	• Battery backup	NA	NA	NA
	• Building Floor Plans	NA	NA	NA

NA
MR
NA

N/7

Special Fire Protection System for Protection of special Risks, if any:


NA


NA


NA


The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rule 2010.



Signature of the Inspecting Officer
Name (D.B. Mukherjee)
Designation DO (NW)


Signature of the Inspecting Officer
Name Ajay Kumar Sharma
Designation ADO(Rohini)


Dy cfo 10/23



27/11/22


CFO


2/2

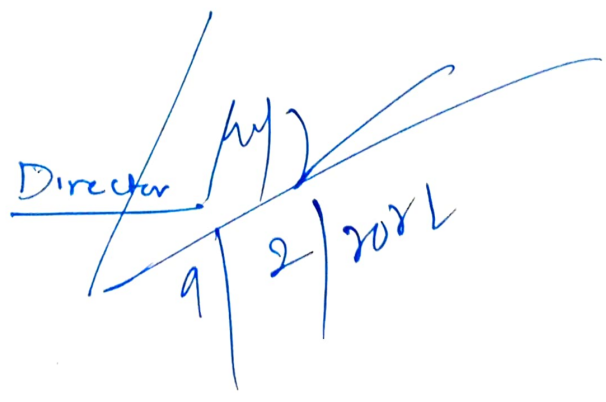

3/2/2022



DO/NW

Pt. put-up F.T. letter

04/02/2022

Asst (R)

Fi letter is put up for kind perusal and signature please.


Director
9/2/2022


9/2/22



