

E-24

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI


No. F6/DFS/MS/EH/WZ/2022/ 45

Dated: 21 / 02 / 2022

FIRE SAFETY CERTIFICATE

Certified that the M/s. **Mad Cafe, (A unit of Honey Comb Hospitality Pvt. Ltd.)** located at plot no 39, Vishal Enclave, Rajouri Garden Delhi -110027 running at Ground Floor only in a building comprised of Basement + Ground + 02 Upper Floors, Owned/Occupied by **M/s. Mad Cafe, (A unit of Honey Comb Hospitality Pvt. Ltd.)** was inspected by the officers concerned of this department on 27/01/2022 in the presence of Sh. Dhiren Partap Singh (Manager) and found that the owner have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class "Assembly" Group D (**Ground Floor Only**) with effect from 21/02/2022 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010. Conditions Mentioned Below.

Issued on 21/02/2022 at New Delhi by.

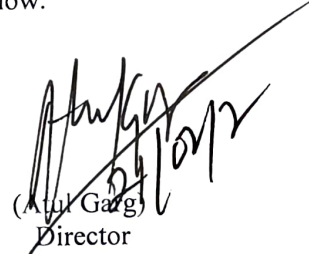
(Anil Garg)
Director
Delhi Fire Service

Copy to: -

1. The owner/occupier, M/s. Mad Cafe, (A unit of Honey Comb Hospitality Pvt. Ltd.), A 39, Ground Floor, Vishal Enclave, Rajouri Garden New Delhi-110026.
Online Application ID no. 2021112627258 dated 26/11/2021
2. The Joint Commissioner of Police, Licensing Unit, 1st floor, Police Station, Defence Colony, New Delhi.
3. The Dy. Health Officer, SDMC, West Zone, Vishal Enclave, Rajouri Garden, New Delhi 110027.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall be used as per Building Bye Laws.
7. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
8. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
9. **The NOC is valid for ground floor only.**

INSPECTION REPORT

1. Name & address of the building : Mad Café (A unit of Honey comb Hospitality) A-39,
Ground Floor, Vishal Enclave, Rajouri Garden, New Delhi.
2. Type of Occupancy : Assembly (Restaurant)
3. Type of Case : New
4. Details of previous NOC : NIL
5. Fire Safety directives letter No : NIL
6. Date of inspection : 27/01/2022
7. Name of the Inspecting Officers : D.O.(West) & ADO (MN)
8. Name and designation of officers
from the building side : Sh. Dhiren Partap Singh (Manager)
9. Year of Construction : 2002 (As per MHA portal)
10. Applicant's letter No. : Online Application ID no. 2021112627258 dated 26/11/2021

The said restaurant is running at Ground floor in Building comprised of Basement + Ground + 02 upper floors

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	BBL /NBC Requirement	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	06 m	On main road	MR
	• Gate width	4.5m	On main road	MR
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	NA	Located at G.F.	NA
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floors	NA	Located at G.F	NA
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	e. No. of continuous staircases to terrace	NA	NA	NA
	f. Width of Corridor	1.5m X 2	1.5m X 2(Provided)	MR
	g. Door Size			
3	Compartmentation.			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4	Smoke Management System			
	• Basements	NA	NA	NA
	• Upper floors	Required	Provided	MR
5	Fire Extinguishers			
	• Total numbers	4	Provided	MR
	• Types	ABC, CO ₂	Provided	MR
	• IS marking	ISI marked	Provided	MR

6	First-Aid Hose Reels.			
	• Total numbers on each floor	1	Provided	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7	Automatic fire detection and alarming system.			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8	MOEFA	Required	Provided	MR
9	Public Address System.	NA	NA	NA
10	Automatic Sprinkler System.			
	• Basement	NA	NA	NA
	• Upper Floor	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11	Internal Hydrants			
	• Size of riser/down-comer	100mm	Provided	MR
	• Number of hydrants per floor	01	Provided	MR
	• Hose Box	01	Provided	MR
12	Yard Hydrants.			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13	Pumping Arrangements.			
	• Ground Level			
	➤ Discharge of main Pump	NR	NR	NR
	➤ Head of Main pump	NR	NR	NR
	➤ Number of main pumps	NR	NR	NR
	➤ Jockey Pump out put	NR	NR	NR
	➤ Jockey pump head	NR	NR	NR
	➤ Standby Pump out put	NR	NR	NR
	➤ Standby Pump Head	NR	NR	NR
	➤ Auto Starting/ Manual stopping	NR	NR	NR
	➤ Pump House Access	NR	NR	NR
	• Terrace level			
	➤ Discharge of pump	450 lpm	Provided	MR
	➤ Head of the pump	40 m	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	NR	NR	NR
	➤ Draw-off connection	NR	NR	NR
	➤ Fire service inlet	NR	NR	NR
	➤ Access to tank	NR	NR	NR
	• Overhead Tank capacity	20,000 ltrs	Provided	MR
15	Exit Signage.	Required	Provided	MR

16	Provision of Lifts.			
	• Pressurization of Lift Shaft	NA	NA	NA
	• Pressurization of Lift lobby	NA	NA	NA
	• Communication In lift Car	NA	NA	NA
	• Fireman's Grounding Switch	NA	NA	NA
	• Lift Signage	NA	NA	NA
17	Standby power supply	Required	Provided	MR
18	Refuge Area.			
	➤ Total Area	NA	NA	NA
	➤ Location	NA	NA	NA
19	Fire Control Room			
	• Detector System Panel	NA	NA	NA
	• Flow Switch Panel	NA	NA	NA
	• PA System Panel	NA	NA	NA
	• Batter backup	NA	NA	NA
	• Building Floor Plans	NA	NA	NA
20	Special Fire Protection Systems for Protection of special Risks, if any:	NA	NA	NA

The fire protection systems provided in the building were checked and found functional at the time of inspection. The Shortcomings issued by this department vide Letter no. F6/DFS/MS/EH/2020/412 Dated- 22/04/2020 have been compiled.


Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010 is recommended.

M.K. Chattopadhyay
 01/02/2022
 Signature of the Inspecting Officer
 Name: M.K.Chattopadhyay
 Designation: DO (WZ)

Sarabjeet Singh
 03/02/2022
 Signature of the Inspecting Officer
 Name: Sarabjeet Singh
 Designation: ADO (MN)

348/ADO/MN
 03/02/2022
 B.O. (WEST)/322
 DATED...4/02/2022
 DFS (WZ)

Sarabjeet Singh
 01/02/2022



Sarabjeet Singh
 01/02

1- what is the occy of above floor
 what is the area

2- If lift is out on G floor means that in FSS of 4/8/2022

01/02/2022
 ADO (MN)
Sarabjeet Singh