

C 21

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE NEW DELHI

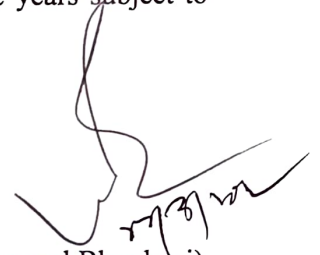
No: F6/DFS/MS/School/WZ/2022/305

Dated: 23/03/2022

FIRE SAFETY CERTIFICATE

Certified that the **S.D.M.C. Primary Co-Ed School** located at **J. J. No.-02, Raghubir Nagar, New Delhi-110027. (School ID- 1556073)** comprised Ground plus One Upper floors, Owned/Occupier by **S.D.M.C. Primary Co-Ed School**, was issued FSC vide letter No. F6/DFS/MS/School/WZ/2019/570 dated 15/03/2019. The premises was re-inspected by the officer concerned by this department on 08/03/2022 in the presence of Sh. Mahavir Chaudhary (Principal) and observed that all the fire prevention & fire safety arrangements provided in the premises found in good working condition. The premises have deemed complied with fire prevention & fire safety requirements in accordance with Circular No. F16/Estate/CC/Fire safety/2011/3298 to 3398 dated 01/03/2011 issued by the Directorate of education and found that the premises is fit for occupancy class "Educational" Group B **(Except Hall)** with effect from 23/03/2022 for a period of three years subject to the compliance of the conditions mentioned below:-

Issued on 23/03/2022 at New Delhi.


(Dharampal Bhardwaj)
Dy. Chief Fire Officer,
Delhi Fire Service

Copy to:

1. The Principal/Incharge, S.D.M.C. Co-Ed School, J.J. No-2, Raghubir Nagar, New Delhi – 110027. **(School ID- 1556073)**.
2. Director of Education, Old Sectt. Delhi-110054.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

N-4

1. Name & address of the building : **S.D.M. C. Primary Co- Ed School** located at **J.J No-2, Raghubir Naagar, New Delhi - 110027**
2. Type of Occupancy : Educational (Ground + 1 Upper Floor)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/SCHOOL/WZ/2019/570 dated 15/03/2019
5. Fire Safety directives letter No : DOE 3298-3398 dated 01/03/2011
6. Date of inspection : 08/03/2022
7. Name of the Inspecting Officers : Sarabjeet Singh ADO (MN)
8. Name and designation of officers from the building side : Sh. Mahavir Chaudhary(Principal).
9. Year of Construction : 2018 (As per prev insp. report dated 19/02/2019)
10. Applicant's letter No. : Email dated 19/02/2022

No. of Students = 262
 No. of Class rooms = 18
 Plot area = 11061.48 sqm
 Covered area = 1656.2 sqm

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Cr. No 3298 – 3398 dated 01/03/2011 As per prev insp. report dtd. 19/02/2019	Provided at site	Remarks MR/NMR
1	Access to building			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	06 mtr	Provided	MR
		Accessible	500cm Provided	MR
		NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> • Upper Floors • Basements 	01	02 Provided	MR
		NA	NA	NA
	b. Width of staircases			
	<ul style="list-style-type: none"> • Upper Floors • Basements 	1.5 mts	2 x 145cm Provided	MR (old Case)
		NA	NA	NA
	c. Protection of exits			
	<ul style="list-style-type: none"> • Fire check door • Pressurization 	NA	NA	NA
		NA	NA	NA
	e. No. of continuous staircases to terrace	NA	NA	NA
	f. Width of Corridor	1.5 mts	200cm Provided	MR
	g. Door Size	1 mtr	2 X 120cm Provided	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
4	Smoke Management System.			
	<ul style="list-style-type: none"> • Basements • Upper floors 	NA	NA	NA
		NA	NA	NA
5	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers • Types • IS marking 	08 nos.	Provided	MR
		CO ₂ , ABC type	Provided	MR
		ISI marked	Provided	MR

St

6	First-Aid Hose Reels.			
	• Total numbers on each floor	NA	NA	NA
	• Length of hose reel hose	NA	NA	NA
	• Nozzle diameter	NA	NA	NA
7	Automatic fire detection and alarming system.			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8	MOEFA	NA	NA	NA
9	Public Address System.	NA	NA	NA
10	Automatic Sprinkler System.			
	• Basement	NA	NA	NA
	• Upper Floor	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11	Internal Hydrants			
	• Size of riser/down-comer	NA	NA	NA
	• Number of hydrants per floor	NA	NA	NA
	• Hose Box	NA	NA	NA
12	Yard Hydrants.			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13	Pumping Arrangements.			
	• Ground Level			
	➤ Discharge of main Pump	NA	NA	NA
	➤ Head of Main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey Pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Starting/ Manual stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level		NA	
	➤ Discharge of pump	NA	NA	NA
	➤ Head of the pump	NA	NA	NA
	➤ Power Supply	NA	NA	NA
	➤ Auto Starting of pump	NA	NA	NA
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	NA	NA	NA
	➤ Draw-off connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	NA	NA	NA
15	Exit Signage.	NA	NA	NA

16	Provision of Lifts.			
	<ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication In lift Car • Fireman's Grounding Switch • Lift Signage 	NA	NA	NA
17	Standby power supply	NA	NA	NA
18	Refuge Area.			
	<ul style="list-style-type: none"> ➤ Total Area ➤ Location 	NA	NA	NA
19	Fire Control Room			
	<ul style="list-style-type: none"> • Detector System Panel • Flow Switch Panel • PA System Panel • Batter backup • Building Floor Plans 	NA	NA	NA
20	Special Fire Protection Systems for Protection of special Risks, if any:	NA	NA	NA

n-6

The Fire protection systems in the building were test checked and found functional at the time of inspection.

Keeping in view of the deemed compliance of minimum standards of fire prevention and fire safety measures as required under the rules, the NOC vide letter no F6/DFS/MS/School/WZ/2019/570 Dated- 15/03/2019 renewal under the circular no. 3298-3398 dated 01/03/2011 is recommended.

78/ ADO/MN
11/03/2022
20 (GWD)

Signature of the Inspecting Office
Name: Sarabjeet Singh
Designation: ADO (MN)

D.O. (WEST) 14/2/2022
DATED 14/2/2022
14/3/2022
15/3/2022

ADP/M.N

F.I. letter is put-up for signature

DCFO (WZ)

27/3/2022

11/11/22
78/3/22
ADO (GWP)

MST all