

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110 001.

No.F.6/DFS/MS/School/2022/SZ/292

Dated: 17/03/2022

FIRE SAFETY CERTIFICATE

Certified that the **Nutan Bal Vidyalaya**, J-Block, West Sagar Pur, New Delhi-110046 comprised of ground plus two upper floors, having total 25 rooms (Including Class rooms, Offices, Store, Library & Staff room etc.), owned/occupied by Nutan Bal Vidyalaya was issued Fire Safety Certificate by this department vide letter no. F.6/DFS/MS/School/2018/SZ/1522 dated 29/06/2018. The school building was re-inspected by the officer concerned of this department on 03/03/2022 in the presence of Smt. Lata Gupta (Head Mistress) and found that school building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the building/ premises is fit for occupancy class "Educational" for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule-38 of the Delhi Fire Service Rules, 2010 printed as below.

Issued on.....17/03/2022..... at New Delhi.



(SUNIL CHAUDHARY)
DY.CHIEF FIRE OFFICER



Copy to:-

1. The Manager,
Nutan Bal Vidyalaya,
J-Block, West Sagar Pur, New Delhi-110046
2. Director of Education,
Govt. of NCT of Delhi, Old Secretariat,
New Delhi - 110054.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

N/6

INSPECTION REPORT

1. Name & address of the building : Nutan Bal Vidyalaya, J-Block, West Sagar Pur, New Delhi-110046
 2. Building comprised of : Ground plus two upper floors.
 3. Type of Occupancy : Educational
 4. Type of Case : Renewal
 5. Details of Previous NOC : F.6/DFS/MS/School/2018/SZ/1522 dated 29/06/2018
 6. Fire Safety directives letter No : N/A
 7. Date of inspection : 28/02/2022
 8. Name of Inspecting Officer : A.D.O. R.K.Yadav
 9. Name and designation of officers : Smt. Lata Gupta (Head Mistress)
 From the building side : 2003
 10. Year of Construction : Nil dated 22/02/2022
 11. Applicant's letter No.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	Accessible 06 m 4.5 m N/A	Provided Directly accessible from road N/A	M/R MR N/A
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> Upper Floors Basements 	02 No's N/A	02 No's N/A	M/R N/A
	b. Width of staircases			
	<ul style="list-style-type: none"> Upper Floor Basements 	1.50 & .75 m N/A	1.18 m & .80 m N/A	M/R N/A
	c. Protection of exits			
	<ul style="list-style-type: none"> Fire check door Pressurization 	N/A N/A	N/A N/A	N/A N/A
	d. No. of continuous staircases to terrace	N/A	N/A	N/A
	e. Width of Corridor	1.50 m	2.0 m	M/R
	f. Door Size	1.0 m	1.12 m (double door) few rooms with single doors	M/R
3.	Compartmentation			
	<ul style="list-style-type: none"> Fire check door Sealing of electrical shafts Fire Rating of shaft door Water Curtain Fire Dampers 	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
4.	Smoke Management System			
	<ul style="list-style-type: none"> Basements Upper floors 	N/A Required	N/A Natural ventilation	N/A M/R
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types IS marking 	10 no's ABC/CO ₂ type ISI marked	Provided Provided Provided	M/R M/R M/R

←

2/7

6.	First-Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	01 no. 30 M 5 mm	Provided Provided Provided	M/R M/R M/R
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Ground Floor Sprinkler above false ceiling 	N/A N/A N/A	N/A N/A N/A	N/A N/A N/A
11.	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box 	N/A N/A N/A	N/A N/A N/A	N/A N/A N/A
12.	Yard Hydrants			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	N/A N/A	N/A N/A	N/A N/A
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/Manual Stopping 	N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A
	<ul style="list-style-type: none"> Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 	N/A 450 LPM 30 m Required Required	N/A Provided Provided Provided Provided	N/A M/R M/R M/R M/R
14.	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> Underground tank capacity <ul style="list-style-type: none"> Draw-off connection Fire service inlet Access to tank Overhead Tank capacity 	N/A N/A N/A N/A 10,000 ltrs Required	N/A N/A N/A N/A Provided Provided	N/A N/A N/A N/A MR M/R
15.	Exit Signage.			

1


3/2022

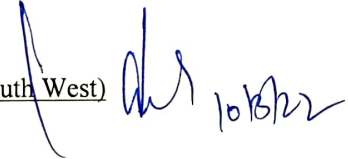
N/8




16.	Provision of Lifts.	No Lift		
	<ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication In lift Car • Fireman's Grounding Switch • Lift Signage 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
17.	Standby power supply	N/A	N/A	N/A
18.	Refuge Area.			
	<ul style="list-style-type: none"> ➤ Total Area ➤ Location 	N/A	N/A	N/A
		N/A	N/A	N/A
19.	Fire Control Room			
	<ul style="list-style-type: none"> • Detector System Panel • Flow Switch Panel • PA System Panel • Battery backup • Building Floor Plans 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
20.	Special Fire Protection System for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the FSC issued vide letter number F.6/DFS/MS/School/2018/SZ/1522 dated 29/06/2018 renewal in accordance with the Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by the Director of Education is recommended.



 Signature of Inspecting Officer
 Name:- R.K.Yadav
 Designation:- Asstt. Divisional Officer

D.O. (South West) 

 (SZ)
 F.T.
 M.S.

F T letter is put up for sign please

 (SZ)
 M.S.


 19/3/2022