



E-68

FORM 'H'  
FORM FOR ISSUING FIRE SAFETY CERTIFICATE  
[Refer sub - rule (1) of rule 35]  
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE  
NEW DELHI

No.F6/DFS/MS/School/SZ/2022/ 385

Dated: 06/04/2022

**FIRE SAFETY CERTIFICATE**

Certified that the Building Maxfort School Dwarka Located at Plot No 9, Sector – 7, Dwarka, New Delhi – 110075 comprised of Basement, Ground + 4 Upper Floor was issued FSC vide Letter No. F6/DFS/MS/School/2019/SZ/866 dated 22/04/2019. The premises was re inspected by the officers concerned of this department on 29/03/2022 in the presence of Sh. Jaiveer Singh ( Employee) and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rule, 2010 and that the premises is fit for occupancy class-B “Educational” with effect from 06/04/2022 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 06/04/2022 at New Delhi by.

  
(Atul Garg)  
Director

Delhi Fire Service.

Copy to:

1. Directorate of Education Old Secretariat Delhi – 110054.
2. The Principal, Maxfort School Dwarka Located at Plot No 9, Sector – 7, Dwarka, New Delhi – 110075.

**Following fire safety directives must be adhered to:-**

- 1 All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
- 2 Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
- 3 The trained staff should be available round the clock.
- 4 Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
- 5 The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
- 6 The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
- 7 Basement shall be used strictly as per building bye laws.
- 8 The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).

1121  
**INSPECTION REPORT**

1. Name & address of the building: Maxfort School Dwarka Located at Plot No 9, Sector – 7, Dwarka, New Delhi – 110075.
2. Type of Occupancy : Educational (Basement + Ground+ 4Upper Floors)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/School/2019/SZ/866 Dated 22/04/2019
5. Fire Safety directives L.No. : F6/DFS/MS/BP/2003/84 dated 09/01/2003 (B+G+3) & F6/DFS/MS/BP/2015/03 dated 02/01/2015 (B+G+4)
6. Date of inspection : 29/03/2022
7. Name of the Inspecting Officer :Udai vir singh, ADO (DWK)
8. Name and designation of Officer  
from the building side : Sh. Jaiveer Singh
9. Year of Construction : 2006 & 2018
10. Applicant's letter No. Email Dated 23/03/2022

S No	Minimum standards on fire prevention and fire safety U/R 33	As per N/17, N/18, N/19	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	09 mtr	Provided	MR
	• Gate width	4.5 mtr	Provided	MR
	• Width of internal road	06 mtr	Provided	MR
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	4 Nos.	4 Nos.	MR
	• Basements	4 Nos.	4 Nos.	MR
	b. Width of staircases			
	• Upper floors	1.5 m	Provided	MR (old case)
	• Basements	1.5 m	2x1.5m & 2x1.35m (Old Case)	MR (old case)
	c. Protection of exits			
	• Fire check door			
	• Pressurization	Required	Provided	MR
	d. No of continuous staircase to terrace	NA	NA	NA
	e. Width Of Corridor	04 Nos	Provided	MR
	f. Door Size	1.5 mtr	Provided	MR
		01mtr & 1.20 mtr	Provided	MR
3.	Compartmentation			
	• Fire check door	Required	Provided	MR
	• Sealing of electrical shafts	Required	Provided	MR
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke managements System			
	• Basements	30 a/c charge	Exhaust fan provided	MR
	• Upper floors	12 a/c charge	Natural ventilation	MR

*JS*

M/22

5.	Fire Extinguishers			
	<ul style="list-style-type: none"> <li>Total numbers</li> <li>Types</li> <li>IS marking</li> </ul>	08 nos. each floor ABC & CO <sub>2</sub> ISI marked	Provided CO <sub>2</sub> , ABC ISI marked	MR MR MR
6.	First – Aid Hose Reels			
	<ul style="list-style-type: none"> <li>Total numbers on each floor</li> <li>Length of hose reel hose</li> <li>Nozzle diameter</li> </ul>	02 Nos. each floor 30 m 05 mm	04 nos. Provided Provided	MR MR MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooters' Location</li> </ul>	NA NA NA Required NA	Provided (Smoke) Ground Floor NA Battery Backup Provided (Near Staircase)	NA NA NA MR NA
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10	Automatic Sprinkler System			
	<ul style="list-style-type: none"> <li>Basements</li> <li>Upper Floor</li> <li>Sprinkler above false ceiling</li> </ul>	Required NA NA	Provided NA NA	MR NA NA
11	Internal Hydrants:			
	<ul style="list-style-type: none"> <li>Size of riser/down- comer</li> <li>Number of hydrants per floor</li> <li>Hose Box</li> </ul>	100 mm 02 Nos. Required	Provided 04 Nos. Provided	MR MR MR
12	Yard Hydrants			
	<ul style="list-style-type: none"> <li>Total number of hydrants</li> <li>Hose Box</li> </ul>	03 Nos. Required	Provided Provided	MR MR
13	Pumping Arrangements:			
	<ul style="list-style-type: none"> <li>Ground Level</li> <li>Discharge of main pump</li> <li>Head of main pump</li> <li>Number of main pumps</li> <li>Jockey pump out put</li> <li>Jockey pump head</li> <li>Standby Pump out put</li> <li>Standby Pump Head</li> <li>Auto starting/Manual stopping</li> <li>Pump House Access</li> <li>Terrace level</li> <li>Discharge of pump</li> <li>Head of the pump</li> <li>Power supply</li> <li>Auto starting of pump</li> </ul>	2280 lpm 60 mtr 01 180 LPM 60 mtr 2280 LPM 60 mtr Required Required 900 LPM 40 mtr Required Required	Provided Provided Provided Provided Provided Provided Provided Provided Provided 2 X 900 lpm & 1x180 lpm Provided Provided Provided	MR MR MR MR MR MR MR MR MR MR MR MR MR
14	Captive water Storage for fire fighting:			
	<ul style="list-style-type: none"> <li>Under ground tank capacity</li> <li>Draw off connection</li> <li>Fire service inlet</li> <li>Access to tank</li> <li>Overhead Tank capacity</li> </ul>	75,000 ltr Required Required Required 25,000 ltrs	Provided Provided Provided Provided	MR MR MR MR MR
15	Exit Signage	Required	Provided	MR








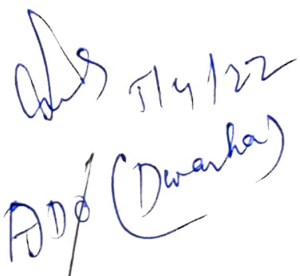
N/23

16	Provision of Lifts			
	➤ Pressurization of Lift Shaft	NA	NA	NA
	➤ Pressurization of lift lobby	NA	NA	NA
	➤ Communication in lift Car	NA	NA	NA
	➤ Fireman's Grounding Switch	Required	Provided	MR
	➤ Lift Signage	Required	Provided	MR
17	Standby power supply	Required	Provided	MR
18	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	Required	Provided	MR
	➤ Battery backup	Required	Provided	MR
	➤ Building Floor Plans	NA	NA	NA
20	Special Fire Protection Systems for Protection of special Risks, if any;	Required	CO2, Fire extinguisher provided near electric panel	MR

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rules the NOC issued vide letter F6/DFS/MS/School/2019/SZ/866 Dated 22/04/2019 renewal under Rule 37 of the Delhi Fire Service Rules 2010 is recommended.

  
 Signature of the Inspecting Officer  
 Name Udai Vir Singh  
 Designation ADO/DWK

  
 30/3/22  
 Dy. Insp (S/Z)  
  
 G.F.O. on leave  
 Director  
  
 31/3/22  
 Add (Dwarka)