

INSPECTION REPORT

31/C

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE

No. F6/DFS/MS/School/WZ/2022

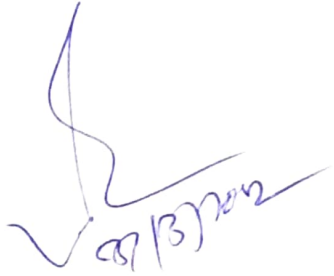
351

Dated: 31/03/2022

FIRE SAFETY CERTIFICATE

Certified that the **Montfort Nursery School** located at **NS-29, Kela Godown Road Shalimarbagh, Delhi- 110088**, comprised of Ground + 02 Upper Floors was issued FSC vide letter No. F6/DFS/MS/School/2019/842 dated 16/04/2019 the premises re-inspected by the officer concerned of this department on 07/03/2022 in the presence of Sh. Bro. William and observed that all the fire prevention and fire arrangements provided in the premises found good working condition. The premises have deemed complied with the fire prevention and fire safety requirements in accordance with the DOE Circular 262-362 dated 17/01/2005 issued by the Directorate of Education and found that the premises is fit for the occupancy class **"Educational" Group B** with effect from 31/03/2022 for a period of three years subject to the compliance of the conditions mentioned below.

Issued on 31/03/2022 at New Delhi.


(Dharampal Bhardwaj)
Dy. Chief Fire Officer
West Zone

Copy to:

1. The Principal, Montfort Nursery School, NS-29, Kela Godown Road Shalimarbagh, Delhi- 110088.
2. Director of Education, GNCT of NCT of Delhi, Old Secretariat.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1. Name & address of the building : Montfort Nursery School Located at NS-29, Kela Godown Road Shalimar Bagh, Delhi 110088.
2. Type of Occupancy : Educational (Ground + 02 upper floor)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/School/2019/842 dated 16/04/2019
5. Fire Safety directives letter No : 262 - 362 dated 17/01/2005
6. Date of inspection : 07/03/2022
7. Name of the Inspecting Officers : Sarabjeet Singh , ADO(MN)
8. Name and designation of officers from the building side : Bro. Villiam
9. Year of Construction : 2005 (As per prv. insp. report dtd. 29/03/2019)
10. Applicant's letter No. : letter dated 11/02/2022

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	BBL /NBC Requirement/(As per prv. insp. report dtd. 29/03/2019)	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	6 mtr	Provided	MR
	• Gate width	4.5 mtr	Provided	MR
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	01	02 Provided	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floors	1.50 mtr	1.58mtr & 130 mtr	MR
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NR	NR	NR
	• Pressurization	NR	NR	NR
	e. No. of continuous staircases to terrace			
	f. Width of Corridor	NA	NA	NA
	g. Door Size	1 mtr	1 x 1.10 mtr	MR
3	Compartmentation.			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4	Smoke Management System.			
	• Basements	NR	NR	NR
	• Upper floors	NR	NR	NR
5	Fire Extinguishers			
	• Total numbers	20 nos	Provided	MR
	• Types	CO ₂ , ABC type	Provided	MR
	• IS marking	ISI marked	Provided	MR

N/11

6	First-Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	01 at each floor	Provided	MR
		30 mtr	Provided	MR
		5 mm	Provided	MR
7	Automatic fire detection and alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
8	MOEFA			
		NA	NA	NA
9	Public Address System.			
		NA	Provided	NA
10	Automatic Sprinkler System.			
	<ul style="list-style-type: none"> Basement Upper Floor Sprinkler above false ceiling 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
11	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box 	Required	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
12	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	NA	NA	NA
		NA	NA	NA
13	Pumping Arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/ Manual stopping Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		450 lpm & 180 lpm	Provided	MR
		40 mtr	Provided	MR
		Required	Provided	MR
	Required	Provided	MR	
14	Captive Water Storage for fire fighting.			
	<ul style="list-style-type: none"> Underground tank capacity Draw-off connection Fire service inlet Access to tank Overhead Tank capacity 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		5,000 ltrs	Provided	MR
15	Exit Signage.			
		Required	Provided	MR

88

n-9

NA

n/12

16	Provision of Lifts.			
	• Pressurization of Lift Shaft	NA	NA	NA
	• Pressurization of Lift lobby	NA	NA	NA
	• Communication In lift Car	NA	NA	NA
	• Fireman's Grounding Switch	NA	NA	NA
	• Lift Signage	NA	NA	NA
17	Standby power supply	NA	NA	NA
18	Refuge Area.			
	➤ Total Area	NA	NA	NA
	➤ Location	NA	NA	NA
19	Fire Control Room			
	• Detector System Panel	NA	NA	NA
	• Flow Switch Panel	NA	NA	NA
	• PA System Panel	NA	NA	NA
	• Batter backup	NA	NA	NA
	• Building Floor Plans	NA	NA	NA
20	Special Fire Protection Systems for Protection of special Risks, if any:	NA	NA	NA

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of minimum standards on fire prevention and fire safety required under the rule the NOC issued vide letter No. F6/DFS/MS/School/2019/842 dated 16/04/2019 renewal under rule 35 of the Delhi Fire Service Rules 2010 is recommended.

56/ADO/MN
27/03/2022

(Signature)
20/03/2022

(Signature)
27/03/2022

Signature of the Inspecting Name: - Sarabjeet Singh
Designation: - ADO (MN)

D.O. (WEST) 356
DATED 16/3/2022

(Signature)
14/03/2022

DCFO (W2)

(Signature)
24/3/2022

ADO (MN) F.T is put up for your personal & signature please

(Signature)
28/3/2022

(Signature)
31/3/2022

(Signature)
28/3/2022

mst/alf