

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001**

No. F.6/DFS/MS/2022/CNG/WZ/ 182

Dated: 21/04/2022

**FIRE SAFETY CERTIFICATE**

Certified that the CNG Filling Station (IGL) at Site No.45, Mangolpuri Industrial Area, Phase-II, Outer Ring Road, Delhi-110086, comprised of Single Story building has already been issued FSC by this department vide letter No. F.6/DFS/MS/2019/CNG/303 dated 06.02.2019. The premises was re-inspected by the officer concerned of this department on 04.04.2022 in the presence of Mr. Prashant Kumar Saini (Deputy Manager) and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy 'CNG Filling Station Group 'J' with effect from 21/04/2022 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subjected to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 21/04/2022 at New Delhi by

  
(Dhrampal Bhardwaj)  
Dy.Chief Fire Officer  
Tel;-01123414250

Copy to :-

1. Sh. Alok Sharma (Vice President (Fire & Safety) IGL Bhawan Plot No.4, Community Centre, R.K. Puram, Sector-9, New Delhi-110022.

**Conditions for the validity of fire safety certificate:**

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on
8. All the means of escape shall be kept free of any obstruction all the time to evacuate the occupant, in a safe manner, in the event of emergency.

[http://www.delhi.gov.in/wps/wcm/connect/doit\\_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/](http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/)  
[http://www.delhi.gov.in/wps/wcm/connect/doit\\_fire/FIRE/Home/Forms](http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms)

N/2

**INSPECTION REPORT**

- Name & address of the building : CNG Filling Station (IGL) at Site No.45, Mangolpuri Industrial Area, Phase-II, Outer Ring Road, Delhi-110086.
2. Type of Occupancy : CNG Filling Station Group 'J'
3. Type of Case : Renewal (Single Story Building)
4. Details of Previous NOC : F.6/DFS/Ms/2019/CNG/303 dated 06.02.2019
5. Fire Safety directives letter No : NBC Part-IV
6. Date of inspection : 04.04.2022
7. Name of Inspecting Officer : A.K.Sharma ADO(Rohini)
8. Name and designation of officers  
From the building side : Mr. Prashant Kumar Saini (Deputy Manager)
9. Year of Construction : 2000
10. Applicant's letter No. : Online e-mail dated 14.02.2022.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1.	<b>Access to building</b>			
	• Road width	8.m	30m	MR
	• Gate width	NA	NA	NA
	• Width of internal road	NA	NA	NA
2.	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	a. Number of staircases			
	• Upper Floors	NA	NA	NA
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floor	NA	NA	NA
	• Basements	NA	NA	NA
	c. Protection of exits			
	Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No. of continuous staircases to terrace	NA	NA	NA
	e. Width of Corridor			
	f. Door Size	1.0m	1.0m	MR
3.	<b>Compartmentation</b>			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	<b>Smoke Management System</b>			
	• Basements	30 a/c per hour	NA	NA
	• Upper floors	12 a/c per hour	NA	NA
5.	<b>Fire Extinguishers</b>			
	• Total numbers	26nos.	26 nos.	MR
	• Types	ABC/CO2	07 trol 75 kg each, 16 CP & 03 CO2	MR
	• IS marking	ISI marked	Yes	MR
6.	<b>First-Aid Hose Reels</b>			
	• Total numbers on each floor	NA	NA	NA
	• Length of hose reel hose	NA	NA	NA
	• Nozzle diameter	NA	NA	NA
7.	<b>Automatic fire detection and alarming system</b>			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA


	<ul style="list-style-type: none"> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooters' Location</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
8.	<b>MOEFA</b>	Required	Provided	MR
9.	<b>Public Address System</b>	NA	NA	NA
10.	<b>Automatic Sprinkler System</b>			
	<ul style="list-style-type: none"> <li>Basement</li> <li>Ground &amp; Upper Floors</li> <li>Sprinkler above false ceiling</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
11.	<b>Internal Hydrants</b>			
	<ul style="list-style-type: none"> <li>Size of riser/down-comer</li> <li>Number of hydrants per floor</li> <li>Hose Box</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
12.	<b>Yard Hydrants</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants</li> <li>Hose Box</li> </ul>	NA	NA	NA
		NA	NA	NA
13.	<b>Pumping Arrangements</b>			
	<ul style="list-style-type: none"> <li>Ground Level               <ul style="list-style-type: none"> <li>Discharge of main Pump</li> <li>Head of Main pump</li> <li>Number of main pumps</li> <li>Jockey Pump out put</li> <li>Jockey pump head</li> <li>Standby Pump out put</li> <li>Standby Pump Head</li> <li>Auto Starting/Manual Stopping</li> <li>Pump House Access</li> </ul> </li> <li>Terrace level               <ul style="list-style-type: none"> <li>Discharge of pump</li> <li>Head of the pump</li> <li>Power Supply</li> <li>Auto Starting of pump</li> </ul> </li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
14.	<b>Captive Water Storage for fire fighting</b>			
	<ul style="list-style-type: none"> <li>Underground tank capacity               <ul style="list-style-type: none"> <li>Draw-off connection</li> <li>Fire service inlet</li> <li>Access to tank</li> </ul> </li> <li>Overhead Tank capacity</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
15.	<b>Exit Signage.</b>	NA	NA	NA
16.	<b>Provision of Lifts.</b>			
	<ul style="list-style-type: none"> <li>Pressurization of Lift Shaft</li> <li>Pressurization of Lift lobby</li> <li>Communication In lift Car</li> <li>Fireman's Grounding Switch</li> <li>Lift Signage</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
17.	<b>Standby power supply</b>	NA	NA	NA
18.	<b>Refuge Area.</b>			
	<ul style="list-style-type: none"> <li>Total Area</li> <li>Location</li> </ul>	NA	NA	NA
		NA	NA	NA
19.	<b>Fire Control Room</b>			
	<ul style="list-style-type: none"> <li>Detector System Panel</li> <li>Flow Switch Panel</li> <li>PA System Panel</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA

N/2B

• Battery backup	NA	NA	NA
• Building Floor Plans	NA	NA	NA
<b>Special Fire Protection System for Protection of special Risks, if any:</b>	NA	NA	NA


The fire protection systems provided in the building were test checked and found functional at the time of inspection.

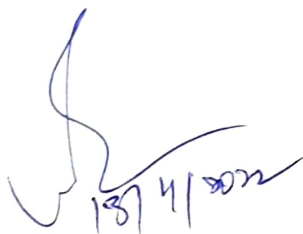
In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. F.6/DFS/MS/2019/CNG/303 dated 06.02.2019 is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.

  
5/4/22

Signature of the Inspecting Officer  
Name Ajay Kumar Sharma  
Designation ADO(Rohini)


DO (NW)

  
06/04/2022  
AFO (W2)


  
18/4/2022

~~ADO Rohini~~

FT letter is put up for kind perusal and signature please.

  
AFO (W2)

  
18/4/2022

  
18/4/22

~~ADO Rohini~~

MS Cell