

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110001

No F 6 / DFS / MS / 2022 / School / WZ / 437

Dated: 22/04/2022

FIRE SAFETY CERTIFICATE

Certified that the **Rishikul Vidyapeeth** located at **Alipur, Delhi-110036** comprised of **Ground and three upper floors** owned/occupied by **Rishikul Vidyapeeth** was issued FSC by this department vide letter No **F-6/DFS/MS/2018/WZ/1760** dated 27.07.2018. The building was inspected by the officer concerned of this department on 08.04.2022 in the presence of Sh. Surender Chhabra (Vice Principal), and observed that all the fire prevention and fire safety arrangements as provided in the building found in good working condition. The premises have deemed complied with the requirements under rule 33 of the Delhi Fire Service Rules,2010 and the building/ premise is fit for occupancy **Group B Educational** with effect from ...22/04/2022 for a period of **three years** in accordance with the rule 36 unless renewed under rule 37 or sooner cancelled under rule 40, subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules,2010.

Issued on ..22/04/2022 at New Delhi

Yours faithfully


Dharampal Bhardwaj
Dy. CHIEF FIRE OFFICER
WEST ZONE

ou R

Copy to :-

1. The Director of Education, Govt. of NCT of Delhi, Old Secretariat ,Delhi-54.
2. The Principal,Rishikul Vidyapeeth, Alipur, Delhi-36.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on WWW.dfs.Delhigovt.nic.in

INSPECTION REPORT

1. Name & address of the building : Rishikul Vidyapeeth located at Alipur, Delhi-36.
2. Type of Occupancy : Educational
3. Building Comprised : Ground + Three Upper Floors
4. Type of Case : Renewal
5. Details of Previous NOC : F6/DFS/MS/2018/WZ/1760 dated- 27/07/2018
6. Fire Safety directives letter No : NBC Part-IV
7. Date of inspection : 08/04/2022
8. Name of Inspecting Officer : ADO, R.K.Sinha
9. Name and designation of officers
From the building side : Sh. Surender Chhabra (Vice-Principal)
10. Year of Construction : 2004
11. Applicant's letter No. : E Mail ID , Dated-30/03/2022

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1.	Access to building			
	• Road width	6.0 m	6.0 m	MR
	• Gate width	4.5 m	4.5 m	MR
	• Width of internal road	NA	NA	NA
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	02	02	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floor	1.50 m each	1.50 m each	MR
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No. of continuous staircases to terrace	02	02	MR
	e. Width of Corridor	NA	NA	NA
	f. Door Size	1.00 m	1.13 m & 1.08 m	MR
3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke Management System			
	• Basements	30 a/c per hour	NA	NA
	• Upper floors	12 a/c per hour	Natural Ventilated	MR



N/22

N/21

5.	Fire Extinguishers			
	• Total numbers	18	24	MR
	• Types	ABC/Co2	ABC/Co2	MR
	• IS marking	Yes	Yes	MR
6.	First-Aid Hose Reels			
	• Total numbers on each floor	02 Nos.	02 Nos.	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8.	MOEFA	Required	Provided	MR
9.	Public Address System	NA	NA	NA
10.	Automatic Sprinkler System			
	• Basement	NA	NA	NA
	• Ground Floor	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants			
	• Size of riser/down-comer	100 mm	Provided	MR
	• Number of hydrants per floor	02	02	MR
	• Hose Box	02	02	MR
12.	Yard Hydrants			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13.	Pumping Arrangements			
	• Ground Level			
	➤ Discharge of main Pump	NA	NA	NA
	➤ Head of Main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey Pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Starting/Manual Stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA

	<ul style="list-style-type: none"> • Terrace level ➤ Discharge of pump ➤ Head of the pump ➤ Power Supply ➤ Auto Starting of pump 			
		900 lpm	900 lpm	MR
		40 m	40 m	MR
		Required	Provided	MR
		-	-	-
		Required	Provided	MR
14.	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> • Underground tank capacity ➤ Draw-off connection ➤ Fire service inlet ➤ Access to tank 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
	<ul style="list-style-type: none"> • Overhead Tank capacity 	10,000 ltrs	10,000 ltrs	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication In lift Car • Fireman's Grounding Switch 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
	<ul style="list-style-type: none"> • Lift Signage 	NA	NA	NA
17.	Standby power supply	NA	NA	NA
18.	Refuge Area.			
	<ul style="list-style-type: none"> ➤ Total Area ➤ Location 	NA	NA	NA
		NA	NA	NA
19.	Fire Control Room			
	<ul style="list-style-type: none"> • Detector System Panel • Flow Switch Panel • PA System Panel 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
	<ul style="list-style-type: none"> • Battery backup 	NA	NA	NA
	<ul style="list-style-type: none"> • Building Floor Plans 	NA	NA	NA
20.	Special Fire Protection System for Protection of special Risks, if any:	NA	NA	NA

Signature


The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures under rules the FSC issued vide letter no. F6/DFS/MS/2018/WZ/1760, renewal under rule 35 of the Delhi Fire Service Rules 2010 is recommended.

Do (MS) on stoff.

Dy Cfo (WZ)


13/4/22


ADO (B.W.)
24/4/22

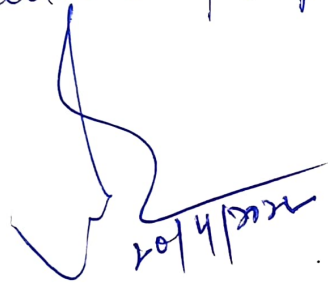
Signature of Inspecting Officer


Name : Rajeev Kumar Sinha

Designation : ADO/B.W.

ADO/B.W F-T letter is put up for perused and signed

Dy Cfo (WZ)


20/4/22


ADO (B.W.)
13/4/22

MS/ aef