

C-58

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI

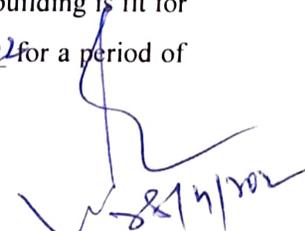
No. F6/DFS/MS/School/WZ/2022/467

Dated: 28/4/2022

FIRE SAFETY CERTIFICATE

Certified that the **Bal Bharati Public School** Located at **Parwana Road, Pitampura, Delhi-110034**, comprised of Basement + Ground + 03 Upper Floor was issued Fire Safety Certificate by this department Vide Letter No. F6/DFS/MS/School/2018/WZ/2233 Dated 04.10.2018. The said premise was re-inspected by the officer concerned of this department on 13.04.2022 in the presence of Sh. Sadan Kumar (Storekeeper) & Sh. Pranav Kumar (Estate Manager) and found that the premises / building have deemed complied with the fire prevention and fire safety requirements in accordance with D.O.E. Cr. No. 3298-3398 dated 01.03.2011 and that the premises/building is fit for occupancy class "Educational Building" Group B with effect from 28/4/2022 for a period of three years, subject to compliance of the conditions printed below.

Issued on 28/4/2022 at New Delhi by.


(Dharampal Bhardwaj)
Dy. Chief Fire Officer
(West Zone)

Copy to: -

1. The Director, Directorate of Education, GNCT of Delhi, Old Secretariat Delhi - 110054.
2. The Principal, Bal Bharati Public School Located at Parwana Road, Pitampura, Delhi-110034.

Following fire safety directives must be adhered to:-

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional if fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupation, electric installation etc. may be got verified from the concerned authorities.
5. The Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction / unauthorized use of land if any.
6. All comments / directions of licensing Department shall always be permitted and followed.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in
8. The owner / occupier shall apply for renewal of this Fire Safety Certificate to the Director in 'Form J' (sub Rule (1) of Rule 37) along with copy of the certificate, six months prior to its expiry.
9. The Basement shall be used as per BBL.

INSPECTION REPORT

N-36

1. Name and address of the building: **Bal Bharati Public School** Located at **Parwan Road, Pitampura, Delhi-110034.**
2. Type of Occupancy : Educational (Basement + G + 03 Upper Floor only)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/School/2018/WZ/2233 Dated 04.10.2018
5. Fire Safety directives Letter No. : 3298-3398 dated 01.03.2011
6. Date of inspection : 13.04.2022
7. Name of the Inspecting Officer : Aman Kumar Lathar, ADO (JWP)
8. Name and designation of Officer
from the building side : Sh. Sadan Kumar (Storekeeper) & Sh. Pranav Kumar (Estate Manager))
9. Year of Construction : 2000
10. Applicant's letter No. : email dated 08.04.2022

S No	Minimum standards on fire prevention and fire safety U/R 33	Cr. No. 3298-3398 dated 01.03.2011/as per FSC dated 04.10.2018	Provided at site	Remarks MR/NMR																									
1.	Access of building																												
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	<table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%; text-align: center;">Accessible</td> <td style="width: 50%; text-align: center;">Provided</td> </tr> <tr> <td style="text-align: center;">Accessible</td> <td style="text-align: center;">Provided</td> </tr> <tr> <td style="text-align: center;">NA</td> <td style="text-align: center;">NA</td> </tr> </table>	Accessible	Provided	Accessible	Provided	NA	NA		<table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%; text-align: center;">MR</td> <td style="width: 50%; text-align: center;">MR</td> </tr> <tr> <td style="text-align: center;">MR</td> <td style="text-align: center;">MR</td> </tr> <tr> <td style="text-align: center;">NA</td> <td style="text-align: center;">NA</td> </tr> </table>	MR	MR	MR	MR	NA	NA													
Accessible	Provided																												
Accessible	Provided																												
NA	NA																												
MR	MR																												
MR	MR																												
NA	NA																												
2.	Number, width, Type & Arrangements of exits																												
	a. Number of staircases																												
	<ul style="list-style-type: none"> • Upper floors • Basements 	<table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%; text-align: center;">04</td> <td style="width: 50%; text-align: center;">Provided</td> </tr> <tr> <td style="text-align: center;">08</td> <td style="text-align: center;">Provided</td> </tr> </table>	04	Provided	08	Provided		<table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%; text-align: center;">MR</td> <td style="width: 50%; text-align: center;">MR</td> </tr> <tr> <td style="text-align: center;">MR</td> <td style="text-align: center;">MR</td> </tr> </table>	MR	MR	MR	MR																	
04	Provided																												
08	Provided																												
MR	MR																												
MR	MR																												
	b. Width of staircases																												
	<ul style="list-style-type: none"> • Upper floors • Basements 	<table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 25%; text-align: center;">1.5 m</td> <td style="width: 50%; text-align: center;">130 cm x 3 & 126 cm x 1</td> <td style="width: 25%; text-align: center;">MR</td> </tr> <tr> <td style="text-align: center;">1.5 m</td> <td style="text-align: center;">Basement divided in 3 Parts B(i)=125cm x 2, 168 cm x 1 & 130 cm x 1 B(ii)=123 cm x 1 & 171 cm x 1 B(iii)=111 cm & 143 cm</td> <td style="text-align: center;">MR(Old Case)</td> </tr> </table>	1.5 m	130 cm x 3 & 126 cm x 1	MR	1.5 m	Basement divided in 3 Parts B(i)=125cm x 2, 168 cm x 1 & 130 cm x 1 B(ii)=123 cm x 1 & 171 cm x 1 B(iii)=111 cm & 143 cm	MR(Old Case)																					
1.5 m	130 cm x 3 & 126 cm x 1	MR																											
1.5 m	Basement divided in 3 Parts B(i)=125cm x 2, 168 cm x 1 & 130 cm x 1 B(ii)=123 cm x 1 & 171 cm x 1 B(iii)=111 cm & 143 cm	MR(Old Case)																											
	c. Protection of exits																												
	<ul style="list-style-type: none"> • Fire check door • Pressurization 	<table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%; text-align: center;">NA</td> <td style="width: 50%; text-align: center;">NA</td> </tr> <tr> <td style="text-align: center;">NA</td> <td style="text-align: center;">NA</td> </tr> </table>	NA	NA	NA	NA		<table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%; text-align: center;">NA</td> <td style="width: 50%; text-align: center;">NA</td> </tr> <tr> <td style="text-align: center;">NA</td> <td style="text-align: center;">NA</td> </tr> </table>	NA	NA	NA	NA																	
NA	NA																												
NA	NA																												
NA	NA																												
NA	NA																												
	d. No of continuous staircase to terrace	01	Provided	MR																									
	e. Width Of Corridor	1.5 m	180 cm	MR																									
	f. Door Size	1 m	122 cm	MR																									
3.	Compartmentation																												
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 	<table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 25%; text-align: center;">NA</td> <td style="width: 50%; text-align: center;">Lift Shaft in basement sealed with brick</td> <td style="width: 25%; text-align: center;">NA</td> </tr> <tr> <td style="text-align: center;">NA</td> <td style="text-align: center;">NA</td> <td style="text-align: center;">NA</td> </tr> <tr> <td style="text-align: center;">NA</td> <td style="text-align: center;">NA</td> <td style="text-align: center;">NA</td> </tr> <tr> <td style="text-align: center;">NA</td> <td style="text-align: center;">NA</td> <td style="text-align: center;">NA</td> </tr> <tr> <td style="text-align: center;">NA</td> <td style="text-align: center;">NA</td> <td style="text-align: center;">NA</td> </tr> </table>	NA	Lift Shaft in basement sealed with brick	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA		<table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%; text-align: center;">NA</td> <td style="width: 50%; text-align: center;">NA</td> </tr> <tr> <td style="text-align: center;">NA</td> <td style="text-align: center;">NA</td> </tr> </table>	NA									
NA	Lift Shaft in basement sealed with brick	NA																											
NA	NA	NA																											
NA	NA	NA																											
NA	NA	NA																											
NA	NA	NA																											
NA	NA																												
NA	NA																												
NA	NA																												
NA	NA																												
NA	NA																												

N.37

4.	Smoke managements System			
	<ul style="list-style-type: none"> Basements Upper floors 	Required NA	Provided NA	MR NA
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types IS marking 	38 nos. ABC & CO ₂ ISI marked	Provided Provided Provided	MR MR MR
6.	First - Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	04 30 m 5 mm	Provided Provided Provided	MR MR MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	NA NA NA NA NA	NA NA NA NA NA	NA NA NA NA NA
8.	MOEFA	NA	Provided	NA
9.	Public Address System	NA	Provided	NA
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basements Upper Floor Sprinkler above false ceiling 	Required NA NA	Provided NA NA	MR NA NA
11.	Internal Hydrants:			
	<ul style="list-style-type: none"> Size of riser/down- comer Number of hydrants per floor Hose Box 	Required Required Required	Provided Provided Provided	MR MR MR
12.	Yard Hydrants			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	NA NA	Provided Provided	NA NA
13.	Pumping Arrangements:			
	<ul style="list-style-type: none"> Ground Level Discharge of main pump Head of main pump Number of main pumps Jockey pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Staring/Manual stopping Pump House Access Terrace level Discharge of pump Head of the pump Power supply Auto starting of pump 	NA NA NA NA NA NA NA NA NA NA NA 2 x 450 lpm 40 m Required Required	NA NA NA NA NA NA NA NA NA NA NA Provided Provided Provided Provided	NA NA NA NA NA NA NA NA NA NA NA MR MR MR MR
14.	Captive water Storage for fire fighting:			
	<ul style="list-style-type: none"> Under ground tank capacity Draw off connection Fire service inlet Access to tank Overhead Tank capacity 	NA NA NA NA 10,000 ltrs.	NA NA NA NA Provided	NA NA NA NA MR
15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	<ul style="list-style-type: none"> Pressurization of Lift Shaft Pressurization of lift lobby Communication in lift Car Fireman's Grounding 	NA NA Required Required	NA NA Provided Provided	NA NA MR MR

Switch ➤ Lift Signage		Required	Provided	MR
17.	Standby power supply	NA	NA	NA
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans	NA	NA	NA
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA

Fire protection systems provided in the building were checked and found functional at the time of inspection. The Shortcomings issued vide letter no. F6/DFS/MS/School/WZ/2021/606 dated 11.11.2021 are rectified.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety requirements as per D.O.E. Cr. NO. 3298-3398 dated 01.03.2011, renewal of Fire Safety Certificate issued vide letter no. F6/DFS/MS/School/2018/WZ/2233 Dated 04.10.2018 is recommended.

Accordingly DFA is put up for approval please.

Aman Kumar Lathar
25/11/22

Aman Kumar Lathar
ADO (JWP)

20/11/21
D.O. (WEST)
30/11/21
DATED. 25/11/2021

dy
25/04/2022

DCFS (W2)

28/11/2022

Asst. Superintendent
Asst. West

F.T. letter is put up for Sign. please

DCFS (W2)

28/11/2022

dy
28/04/2022

ms/acc