

472

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI

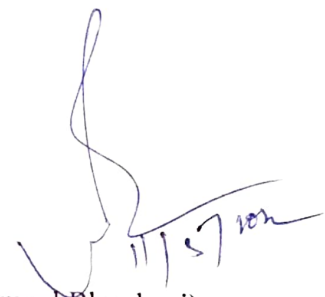
No: F6/DFS/MS/School/WZ/2022 / 511

Dated: 19/05/2022

FIRE SAFETY CERTIFICATE

Certified that the **Montfort school located at Ashok Vihar, phase-1, New Delhi – 110052** comprised of **Total four blocks (Two blocks Ground + 3 upper floor each, One block Ground + 2 upper floor & all three blocks are interconnected & one new block is G + 3)**, was issued FSC vide letter No. F6/DFS/MS/School/2019/492 dated 8/03/2019 & one new block vide letter no. F6/DFS/MS/WZ/2020/396 dated 23/04/2022. The premises was re-inspected by the officer concerned by this department on 27/04/2022 in the presence of Brother Thampy Alex (Principal). The premises have deemed complied with fire prevention & fire safety requirements in accordance with Rule 33 of Delhi Fire Service Act 2007 and Delhi Fire Service 2010, and found that the premises is fit for occupancy class “Educational” Group B with effect from 19/05/2022 for a period of three years in accordance with effect from rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010. Conditions mentioned Overleaf.

Issued on ... 19/05/2022 ... at New Delhi.


(Dharampal Bhardwaj)
Dy. Chief Fire Officer,
Delhi Fire Service

Copy to: -

1. The Principal, Mont fort school located at Ashok Vihar, phase-1, New Delhi – 110052.
2. Director of Education, Old Sectt. Delhi-110054.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. One resident block comprised of G+ 3 & one swimming pool were also seen in the premises.

N/25

INSPECTION REPORT

1. Name & address of the building : Montfort School Located at Ashok Vihar, Phase- 1, Delhi-110052.
2. Type of Occupancy : Educational (Total four blocks)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/School/2019/492 dated 18/03/2019 (03 Blocks)
5. Fire Safety directives letter No : F6/DFS/MS/WZ/2020/396 dated 23/04/2020
F6/DFS/MS/BP/98/564 dated 18/03/1998 &
F6/DFS/MS/BP/2011/541 dated 25/03/2011
6. Date of inspection : 27/04/2022
7. Name of the Inspecting Officers : Sarabjeet Singh, ADO(MN)
8. Name and designation of officers from the building side : Brother. Thampy Alex (Principal)
9. Year of Construction : 2007 (As per previous insp. report dtd. 29/03/2019)
10. Applicant's letter No. : letter dated 08/04/2022

* **There are total four blocks Two blocks G + 3, One block G + 2 all three blocks are Interconnected & one new block is G + 3.**

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	(As per previous insp. report dtd. 29/03/2019 & 25.02.2022)	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	Accessible	6m Provided	MR
	• Gate width	Accessible	Provided	MR
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	02	02 Provided	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floors	1.5 m each & 1.5 m & 1.2m for new block	BL-1= 145cm & 146cm BL-2= 2x150cm BL-3= 138cm & 140cm BL-4(New Blk) 2x 150cm	MR (Old Case)
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	e. No. of continuous staircases to terrace	01	Provided	MR
	f. Width of Corridor	1.5 m	Provided	MR
	g. Door Size	1 mtr	115cm & 90cm Provided	MR(Old case)
3	Compartmentation.			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4	Smoke Management System.			
	• Basements	NA	NA	NA
	• Upper floors	NA	NA	NA

5 Fire Extinguishers				
<ul style="list-style-type: none"> Total numbers Types IS marking 	48 nos.	54 nos. Provided	MR	
	CO ₂ , ABC type	Provided	MR	
	ISI marked	Provided	MR	
6 First-Aid Hose Reels.				
<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	01 at each floor	Provided	MR	
	30 mtr	Provided	MR	
	5 mm	Provided	MR	
7 Automatic fire detection and alarming system.				
<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	NA	NA	NA	
	NA	NA	NA	
	NA	NA	NA	
	NA	NA	NA	
	NA	NA	NA	
8 MOEFA	NA	Provided	NA	
9 Public Address System.	NA	Provided	NA	
10 Automatic Sprinkler System.				
<ul style="list-style-type: none"> Basement Upper Floor Sprinkler above false ceiling 	NA	NA	NA	
	NA	NA	NA	
	NA	NA	NA	
11 Internal Hydrants				
<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box 	Required	Provided	MR	
	Required	Provided	MR	
	Required	Provided	MR	
12 Yard Hydrants.				
<ul style="list-style-type: none"> Total number of hydrants Hose Box 	NA	NA	NA	
	NA	NA	NA	
13 Pumping Arrangements.				
<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/ Manual stopping Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 	NA	NA	NA	
	NA	NA	NA	
	NA	NA	NA	
	NA	NA	NA	
	NA	NA	NA	
	NA	NA	NA	
	NA	NA	NA	
	NA	NA	NA	
	NA	NA	NA	
	450 lpm & 180 lpm	Provided	MR	
	40 mtr	Provided	MR	
	Required	Provided	MR	
	Required	Provided	MR	
	14 Captive Water Storage for fire fighting.			
<ul style="list-style-type: none"> Underground tank capacity Draw-off connection 	NA	NA	NA	
	NA	NA	NA	

Handwritten mark

N-27

	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	10,000 ltrs	Provided	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	• Pressurization of Lift Shaft	NA	NA	NA
	• Pressurization of Lift lobby	NA	NA	NA
	• Communication In lift Car	NA	NA	NA
	• Fireman's Grounding Switch	NA	NA	NA
	• Lift Signage	NA	NA	NA
17	Standby power supply	NA	NA	NA
18	Refuge Area.			
	➤ Total Area	NA	NA	NA
	➤ Location	NA	NA	NA
19	Fire Control Room			
	• Detector System Panel	NA	NA	NA
	• Flow Switch Panel	NA	NA	NA
	• PA System Panel	NA	NA	NA
	• Batter backup	NA	NA	NA
	• Building Floor Plans	NA	NA	NA
20	Special Fire Protection Systems for Protection of special Risks, if any:	NA	NA	NA

Note: - One Resident block comprised of G + 3 upper floors & One Swimming pool were also seen in the premises being low-rise, does not falls under the purview of DFS Rule 2010 & DFS Act 2007.

The Shortcomings issued by this department vide Letter no. F6/DFS/MS/School/WZ/2022/137 dated 25.03.2022 have been complied.

The Fire Protection System provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rule the NOC issued vide letter no.F6/DFS/MS/School/2019/492 dated 08/03/2019 & ~~One~~ One new block vide Letter no.F6/DFS/MS/WZ/2020/396 dated 23.04.2022 renewal under rule 35 of the Delhi Fire Service Rules 2010 is recommended.

Do (just)

SH

Signature of the Inspecting officer
Name: - Sarabjeet Singh
Designation: - ADO (MN)

109/ADO/MN
09/05/2022

SH
09/05/2022

DO. NESTA 469
DATED: 9/5/2022

DFS (WZ)

SH
10/5/2022

ADO *SH-N* Sir B.T is put up for your personal & signature please

SH
11/5/2022