

C19

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE
NEW DELHI- 110 001**

No. F6/DFS/MS/2022/EH/NDZ/141

Dated: 24/05/2022

FIRE SAFETY CERTIFICATE

Certified that the Jubilant Food works Ltd.(Domino's Pizza) running on Ground & Mezzanine floor, Dilshad Garden Metro Station , Delhi 110095, the building is comprised of ground plus two upper floors, owned/occupied by Jubilant Food Works Ltd. (Domino's Pizza).The restaurants building was inspected by the officer concerned this department in the presence of Sh. Pradeep, Manager and found that the restaurant building have complied with the fire prevention and fire safety requirements in accordance with rules 33 of the Delhi Fire Service Rules, 2010 and observed that the eating house building is fit for ground & mezzanine floor occupancy class "Group-D" 'Assembly Building' with effect from 24/05/2022 for a period of **three** years in accordance with the rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010, printed below.

Issued on.....24/05/2022.....at New Delhi by


(Atul Garg)
Director
Delhi Fire Service

To,
The Manager
Jubilant Food Works Ltd. (Domino's Pizza)
16 seats, Ground & Mezzanine floor
Dilshad Garden Metro Station.
Delhi 110095

MHA ID No. 2022040806084 Dated-08/04/2022

Conditions for the validity of Fire Safety Certificate

1. This NOC is valid for Ground & Mezzanine floor only.
2. All the means of escape shall be kept free of all type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the fire fighting equipment shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
6. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction /unauthorized use of land if any.
7. The owner / occupier shall apply for renewal of this Fire Safety Certificate of the Director in Form 'J' [sub rule (1) of rule (37)] along with a copy of this Certificate, Six Months prior to its expiry.
8. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in

N/2

1. Name & address of the building : Jubilant Food works Ltd., (Domino's Pizza)
16 seats, G.F. & Mezzanine floor,
Dilshad Garden Metro Station, Delhi-110095
2. Building is comprised of : Ground Plus Two upper floors
(Restaurant on Ground & Mezzanine Floor)
3. Type of Occupancy : Restaurant (Assembly)
4. Type of Case : New
5. Details of Previous NOC letter : Nil
6. Fire Safety directive letter No : NBC Part IV
7. Date of Inspection : 22/03/2022
8. Name of the Inspecting officers : A.D.O. Mehmood
9. Name and designation of Officer
from the building side : Sh. Pradeep [(Manager)
10. Year of Construction : 2008
11. Applicant's letter No : 2021100523342 Dated- 03/11/2021


| Sr. No. | Minimum Standards on Fire Prevention and Fire Safety U/R33 | NBC Part- IV Requirement | Provided at Site | Remarks MR/NMR |
|---------|--|--------------------------|----------------------|----------------|
| 01 | Access to Building | | | |
| | • Road width | 12 mtr. | 28 mtr. | MR |
| | • Gate width | 4.5 mtr. | 06 mtr. | MR |
| | • Width of internal road | 06 mtr. | 06 mtr. | MR |
| 02 | Number, Width, Type and Arrangement of Exits | | | |
| | a. Number of Staircases | | | |
| | • Upper floor | 02 nos. | 02 nos. | MR |
| | • Basement | N/A | N/A | N/A |
| | B. Width of Staircases | | | |
| | • Upper floor | 1.50 mtr. | 1.50 mtr. Each | MR |
| | • Basement | N/A | N/A | N/A |
| | c. Protection of Exits | | | |
| | • Fire check door | N/A | N/A | N/A |
| | • Pressurization | N/A | N/A | N/A |
| | d. No. of Continuous Staircases to Terrace | N/A | N/A | N/A |
| | e. Width of Corridor | N/A | N/A | N/A |
| | f. Door Size | 2.0 mtr & 1.50 mtr. | 2.0 mtr & 1.50 mtr | MR |
| 03 | Compartmentation. | | | |
| | • Fire check door | N/A | N/A | N/A |
| | • Sealing of electrical shafts | Required | Provided | MR |
| | • Fire rating of shaft door | N/A | N/A | N/A |
| | • Water curtain | N/A | N/A | N/A |
| | • Fire dampers | N/A | N/A | N/A |
| 04 | Smoke Management System. | | | |
| | • Basement | N/A | N/A | N/A |
| | • Upper floor | Required | Provided | MR |
| 05. | Fire Extinguishers | | | |
| | • Total numbers | 03 nos. | 09 nos. | MR |
| | • Types | ABC /CO ₂ | ABC /CO ₂ | MR |
| | • IS marking | ISI marked | ISI marked | MR |

| | | | | |
|----|--|---------------------------|---------------|-----|
| 06 | First-Aid-Hose Reels. | | | |
| | Total numbers | 01 nos | 01 nos | MR |
| | • Length of hose reel hose | 30 mtr | 30 mtr | MR |
| | • Nozzle diameter | 05 mm | 05 mm | MR |
| 07 | Automatic Fire Detection and Alarming System | | | |
| | • Type of detectors | N/A | Smoke/Heat | MR |
| | • Location of main panel | N/A | Provided | MR |
| | • Location of repeater panel | N/A | Provided | MR |
| | • Alternate source of power | Required | Provided | MR |
| | • Hooter | Near Gate | Provided | MR |
| 08 | MOEFA | Required | Provided | MR |
| 09 | Public Address System. | N/A | N/A | N/A |
| 10 | Automatic Sprinkler System. | | | |
| | • Basement | N/A | N/A | N/A |
| | • upper floor | N/A | Provided | MR |
| | • sprinkler above false ceiling | N/A | N/A | N/A |
| 11 | Internal Hydrants | | | |
| | • size of riser/down-comer | 100 mm | Provided | MR |
| | • Number of hydrants per floor | 01 nos. | 01 nos. | MR |
| | • Hose box | 01 nos. | 01 nos. | MR |
| 12 | Yard Hydrants. | | | |
| | • Total number of hydrants | N/A | N/A | N/A |
| | • Hose box | N/A | N/A | N/A |
| 13 | Pumping Arrangements. | | | |
| | ➤ Ground Level | Common with Metro Station | | |
| | • Discharge of main pump | 1800 LPM | 1800 LPM | MR |
| | • Head of main pump | 40 mtrs | 40 mtrs | MR |
| | • Number of main pumps | 02 nos | 02 nos | MR |
| | • Jockey pump out put | 180 lpm | 180 lpm | MR |
| | • Jockey pump head | 40 mtr | 40 mtr | MR |
| | • Standby pump out put | 1800 lpm | 1800 lpm | MR |
| | • Standby pump head | 40 mtr | 40 mtr | MR |
| | • Auto starting /manual stopping | Required | Provided | MR |
| | • Pump house access | Required | Provided | MR |
| | ➤ Terrace Level | | | |
| | • Discharge of pump | N/A | N/A | N/A |
| | • Head of the pump | N/A | N/A | N/A |
| | • Power supply | N/A | N/A | N/A |
| | • Auto starting of pump | N/A | N/A | N/A |
| 14 | Captive Water Storage for Fire Fighting | | | |
| | • Underground tank capacity | 50,000 ltrs | 2,00,000 ltrs | MR |
| | • Draw-off connection | Required | Provided | MR |
| | • Fire service inlet | Required | Provided | MR |
| | • Access to tank | Required | Provided | MR |
| | • Overhead tank capacity | N/A | N/A | N/A |
| 15 | Exit Signage. | Required | Provided | MR |

| | | | | |
|----|---|----------|----------|-----|
| 16 | Provision of Lifts. | | | |
| | <ul style="list-style-type: none"> • Pressurization of lift shaft • Pressurization of lift lobby • Communication in lift car • Firemen's grounding switch • Lift signage | N/A | N/A | N/A |
| | | N/A | N/A | N/A |
| | | N/A | N/A | N/A |
| | | N/A | N/A | N/A |
| | | N/A | N/A | N/A |
| 17 | Standby Power Supply | Required | Provided | MR |
| 18 | Refuge Area. | | | |
| | <ul style="list-style-type: none"> • Total area • Location | N/A | N/A | N/A |
| | | N/A | N/A | N/A |
| 19 | Fire Control Room | | | |
| | <ul style="list-style-type: none"> • Detector system panel • Flow switch panel • PA system panel • Battery backup • Building floor plans | N/A | N/A | N/A |
| | | N/A | N/A | N/A |
| | | N/A | N/A | N/A |
| | | N/A | N/A | N/A |
| | | N/A | N/A | N/A |
| 20 | Special Fire Protection Systems for Protection of Special Risks, if Any: | N/A | N/A | N/A |

The fire protection systems provided in the building were tested/checked at the time of inspection.

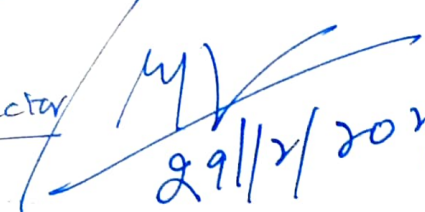
Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety required under NBC IV, it is recommended to issue Fire Safety Certificate under the rule 35 of Delhi Fire Service rules 2010.


 Signature of the Inspecting Officer
 Name : Mehmoed
 Designation : A.D.O.(T.P)


Dy. CFO (NDZ)



 27/12/21

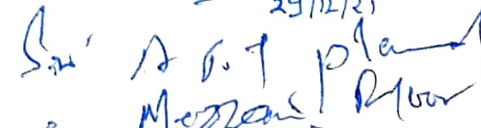
CFO (NDZ) - On leave

Director 
 29/12/2021

Kindly confirm
 MEZANINE has two
 also has two stairwells
 H

 Pl. speak & confirm.


 29/12/21

ADO (T.P)  for signature
 the Mezzanine floor & had two stair
 Case verified
 P.T.O.

