



425

FIRE SAFETY CERTIFICATE

Certified that the **Playgue Club & Lounge** located at C-7, **First Floor, Rajouri Garden New delhi-110027** running at first floor in a building comprised of Basement + Ground + 3 Upper Floors owned/ occupied by **Playgue Club & Lounge** was inspected by the officers concerned of this department on 25.04.2022 in the presence of Mrs. Ranjana Khurana(Owner) and found that the owner /occupier have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rule, 2010 and the said premises is fit for occupancy class “ Assembly” Group D (**For first floor only**) with effect from 12/05/2022 for a period of three years in accordance of with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010. Conditions mentioned below.

Issued on 12/05/2022 at New Delhi by.


(Atul Garg)
Director
Delhi Fire Service


10/5/2022

Copy to:

1. The Owner/Occupier, Playgue Club And Lounge, Vishal Enclave, Rajouri Garden, New Delhi.110027.**Online Application No.2022032103885 dated 21/03/2022.**
2. Dy. Health Officer, West Zone, SDMC, Public Health Department, Vishal Enclave, New Delhi.(dhowestzone@gmail.com)
3. The Joint Commissioner of Police, Licensing Unit,1st floor, Police Station, Defence Colony, New Delhi(addlep.lic-dl@nic.in)

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall be used strictly as per Building Bye Laws.
7. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form ‘J’ [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
8. The owner/occupier shall submit a declaration every year in the form ‘K’ provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1. Name & address of the building : The Playguc club & lounge C-7, First floor, Rajouri Garden, New Delhi-110027.
2. Type of Occupancy : Assembly
3. Type of Case : New
4. Details of previous NOC : Nil
5. Fire Safety directives letter No : Nil
6. Date of inspection : 25/04/2022
7. Name of the Inspecting Officers :DO(West) & ADO(MN)
8. Name and designation of officers from the building side : Mrs. Ranjana Khurana (Owner)
9. Year of Construction :2012 (As per MHA portal)
10. Applicant's letter No. : Online Application No. 2022032103885 dated 21/03/2022

The said restaurant is running at First Floor in a Building comprised of Basement +Ground +03 Upper Floors.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	BBL /NBC Requirement	Provided at site	Remarks MR/NMR
1	Access to building			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	09 mts NA NA	Provided Directly accessible from the road NA	MR NA NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> • Upper Floors • Basements 	02 NA	Provided NA	MR NA
	b. Width of staircases			
	<ul style="list-style-type: none"> • Upper Floors • Basements 	1.5m each NA	Provided NA	MR NA
	c. Protection of exits			
	<ul style="list-style-type: none"> • Fire check door • Pressurization 	NR NR	NR NR	NR NR
	e. No. of continuous staircases to terrace	01	Provided	MR
	f. Width of Corridor	NA	NA	NA
	g. Door Size	1.5 mts X 2	Provided	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 	NR NR NR NR NR	NR NR NR NR NR	NR NR NR NR NR
4	Smoke Management System.			
	<ul style="list-style-type: none"> • Basements • Upper floors 	30 a/c per hour 12 a/c per hour	NR provided	NR MR
5	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers • Types • IS marking 	06 CO ₂ , ABC type ISI marked	Provided Provided Provided	MR MR MR

6	First-Aid Hose Reels.			
	• Total numbers on each floor	01	Provided	MR
	• Length of hose reel hose	30m	Provided	MR
	• Nozzle diameter	05mm	Provided	MR
7	Automatic fire detection and alarming system.			
	• Type of detectors	NA	Provided	NA
	• Location of Main Panel	NA	Provided	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	Provided	NA
	• Hooters' Location	NA	Provided	NA
8	MOEFA	Required	Provided	MR
9	Public Address System.	N/A	N/A	N/A
10	Automatic Sprinkler System.			
	• Basement	NA	NA	NA
	• Upper Floor	NA	Provided	NA
	• Sprinkler above false ceiling	NA	NA	NA
11	Internal Hydrants			
	• Size of riser/down-comer	100mm	Provided	MR
	• Number of hydrants per floor	01	Provided	MR
	• Hose Box	01	Provided	MR
12	Yard Hydrants.			
	• Total number of hydrants	NR	NR	NR
	• Hose Box	NR	NR	NR
13	Pumping Arrangements.			
	• Ground Level			
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey Pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/ Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level			
	➤ Discharge of pump	450 lpm	Provided	MR
	➤ Head of the pump	40MH	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	Required	Provided	MR
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	20,000 ltrs	Provided	MR
15	Exit Signage.	Required	Provided	MR

16	Provision of Lifts.			
	• Pressurization of Lift Shaft	NR	NR	NR
	• Pressurization of Lift lobby	NR	NR	NR
	• Communication In lift Car	NR	NR	NR
	• Fireman's Grounding Switch	NR	NR	NR
	• Lift Signage	NR	NR	NR
17	Standby power supply	Required	Provided	MR
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were checked and found functional at the time of inspection. The Shortcomings issued by this department vide Letter no. F6/DFS/MS/WZ/2022/EH/09 Dated 07.01.2022 & F6/DFS/MS/WZ/2022/EH/177 Dated 11.02.2022 have been complied.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010 is recommended.

79/ADO/MN
26/4/2022



26/4/2022

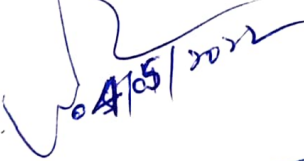
Signature of the Inspecting Officer
Name: - M. K. Chattopadhyay
Designation: - DO (West)


26/4/2022

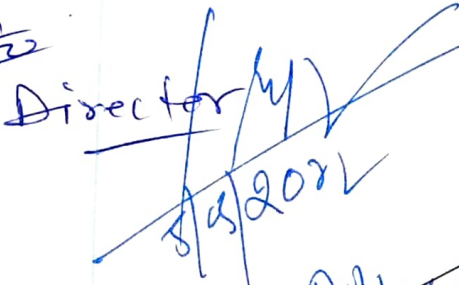
Signature of the Inspecting Officer
Name: - Sarabjeet Singh
Designation: - ADO (MN)

459/DO/COO
Fr-26/4/2022



DO (WZ)



26/4/2022




Director (WZ)
5/5/2022


DO (West)


6/5/22


ADO (MN)