

432

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No. F6/DFS/MS/EH/SZ/2022/ 159

Dated: 06/06/2022

FIRE SAFETY CERTIFICATE

Certified that the **M/s. KFC Restaurants (Sapphire Foods India Ltd.)** located at **Plot No. 2/14, Block-2, West Patel Nagar, New Delhi - 110008, , running at upper ground floor only** of a building comprised of basement, stilt, upper ground plus three upper floors, owned/occupied by Sh. Sanjay Purohit have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officers concerned of Fire Service on 23.05.2022 in presence of Ms. Shyali, Manager and the building/premises is fit for occupancy class Assembly **(Restaurant) running at Upper Ground floor Only** with effect from 06/06/2022 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules 2010, printed below.

Issued on 06/06/2022 at New Delhi by.


(Anil Gang)
Director
Delhi Fire Service

Conditions for the validity of Fire Safety Certificate: -

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non-functional of fire safety measures shall be at the risk & responsibility of the management.
3. The trained firefighting staffs should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. All the means of escapes /exits shall not be locked/bolted/blocked at any time for safe evacuation of the occupants in case of any emergency.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form "J" [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in

SPECTION REPORT

1. Name & address of the building : KFC (A unit of Sapphire Foods India Pvt. Ltd.), Plot No. 2/14, Block- 2, West Patel Nagar, New Delhi- 110008
2. Type of Occupancy : Assembly (Restaurant)
3. Building Composition : The said restaurant running at upper ground floor of a building comprised of basement, stilt, upper ground plus three upper floors. (Basement & upper floors are other property).
4. Type of Case : New Case
5. Details of previous NOC : Nil
6. Fire Safety directives letter No : Nil
7. Date of inspection : 23.05.2022
8. Name of the Inspecting Officers : Vedpal Chhikara, DO (SW) & P.V. Rathee, ADO (SRD)
9. Name and designation of officers from the building side : Ms. Shyali, Manager
9. Year of Construction : Before 2010, & Restaurant is functional from 2014
10. Applicant's letter No. : Online Application ID 2022051009923 dated 11.05.2022

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement as per NBC/UBBL	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	6 mts	06 mts	MR
	• Gate width	NA	Direct accessible to main road	MR
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	-	-	-
	• Upper Floors	02 Nos.	04 Nos.	MR Restaurant running at UGF only
	• Basements	NA	NA.	NA
	b. Width of staircases	-	-	-
	• Upper Floors	1.50 mts Each	1.50 & 2.10(iron made)..89 & .83 mts.	MR, Restaurant running at UGF only
	• Basements	NA	NA	NA
	c. Protection of exits	-	-	-
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	e. No. of continuous staircases to terrace	NA	NA	NA
	g. Width of Corridor	NA	NA	NA
	h. Door Size	1.5 mts each	2.0 , 1.50 & .89 mts	MR, Restaurant running at UGF only
3	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	Smoke Management System.			
	• Basements	NA	NA	NA
	• Upper floors	N/A	N/A	N/A
5	Fire Extinguishers			
	• Total numbers	08	Provided	MR
	• Types	ABC & CO ₂ type	Provided	MR

	• IS marking	ISI marked	Provided	MR
6	First-Aid Hose Reels.			
	• Total numbers on each floor	01 No.	Provided	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7	Automatic fire detection and alarming system.			
	• Type of detectors	Required	Provided	MR
	• Location of Main Panel	N/A	NA	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	At exits	N/A
8	MOEFA	Required	Provided	MR
9	Public Address System.	N/A	N/A	N/A
10	Automatic Sprinkler System.			
	• Basement	N/A	N/A	NA
	• Upper Floor	N/A	Provided	MR
	• Sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	• Size of riser/down-comer	100 mm	Provided	MR
	• Number of hydrants per floor	01 No.	Provided	MR
	• Hose Box	01 No	Provided	MR
12	Yard Hydrants.			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13	Pumping Arrangements.			
	• Ground Level	---	---	---
	➤ Discharge of main Pump	NA	NA	NA
	➤ Head of Main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey Pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Starting/ Manual stopping	Required	Provided	MR
	➤ Pump House Access Terrace level	-----	-----	-----
	➤ Discharge of terrace pump	450 LPM	Provided	MR
	➤ Head of the terrace pump	40 mts	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	NA	NA	NA
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	Provided	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	20000 lts	Provided 20000 lts	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	NA	NA	NA

N/13


	• Lift Signage	NA	NA	NA
17	Standby power supply	NA	NA	NA
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	NA	NA	NA
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	NA	N/A
	• Batter backup	N/A	NA	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A


The fire protection systems provided in the building were test/checked at random and found satisfactory at the time of inspection.

Note:- The total covered area of restaurant is 233 Sq mtr. of upper ground floor, as per NBC part 4, 2016, sitting capacity comes 129 persons (i.e $233/1.8 = 129$).


If agreed in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the Rules, it is recommended to grant fire safety certificate under Rule 35 of Delhi Fire Service Act- 2007 & Rules- 2010.


DFA/ ~~DF~~ is put up for approval & signature please

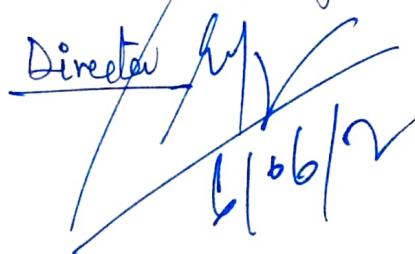

 31/5/2022
 Signature of the Inspecting Officer
 Name- Vedpal Chhikara
 Divisional Officer (SW)


 31/5/22
 Signature of the Inspecting Officer
 Name- P.V. Rathee Divisional
 Asstt. Div. Officer (S.Rd)

Dy. C.O (S2)


 2/6 ?


 6/6/2022


 6/6/22

Dy. SW