

C/S8

FORM 'H'
FORM FOR ISSUING FIRE SAFETY CERTIFICATE
[Refer sub - rule (1) of rule 35]
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI

No.F6 DFS/MS/SZ/2022/HTL/44

Dated: 07/06/2022

FIRE SAFETY CERTIFICATE

Certified that Smaash Entertainment Pvt. Ltd located at, Anchor No 9, First floor Radisson Blu Hotel Plot No.4, Sector-13 Dwarka, New Delhi-110075, in a building comprised of 3 Basement + Ground + 10 Upper Floors (FSC issued to hotel vide letter no F6/DFS/MS/2022/SW/HOTEL/02 Dated 14/01/2021) owned/ occupied by **Smaash Entertainment Pvt. Ltd** have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rule, 2010 and verified by the team of officers concerned of this department on 25/05/2022 in the presence of Sh. Anil Sharma (Director Engineering) and found that the said building that the premises is fit for occupancy class " Assembly" Group D (Restaurant & Bar and Video parlor/ Games) (**First Floor**) with effect from 07/06/2022 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 07/06/2022 at New Delhi by.


(Anil Garg)
Director

Delhi Fire Service

Copy to:

1. The Joint Commissioner Police, Licensing, 1st Floor, PS, Defence Colony, N Delhi.
2. The Dy. Health Officer, SDMC Najafgarh Zone, Dhansa Bus stand, New Delhi 110043
3. The Manager Smaash Entertainment Pvt. Ltd located at, Anchor No 9, First floor Radisson Blu Hotel Plot No.4, Sector-13 Dwarka, New Delhi-110075.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall be used as per building bye laws.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.

N-1
INSPECTION REPORT

1. Name & address of the building: Smaash Entertainment Pvt. Ltd located at, Anchor No 9, First floor Radisson Blu Hotel Plot No.4, Sector-13 Dwarka, New Delhi-110075.
2. Type of Occupancy : Class-D (**Assembly At First Floor**)
3. Type of Case : New
4. Details of previous NOC : F6/DFS/MS/2022/SW/HOTEL/02 Dated 14/01/2021(**issued to hotel**)
5. Fire Safety directives Letter No. : F6/DFS/MS /Hotel/BP/2008/1652 Dated 17/06/2008 (**issued to hotel**)
6. Date of inspection : 25/05/2022
7. Name of the Inspecting Officer ; DO/SW & ADO (DWK)
8. Name and designation of Officer
from the building side : Sh. Anil Sharma (Director Engineering)
9. Year of Construction : 2010
10. Applicant's letter No. : 2022010500308 dated 12/05/2022

S No	Minimum standards on fire prevention and fire safety U/R 33	UBBL/NBC Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	09mtrs	Provided	MR
	• Gate width	4.5mtr	Provided	MR
	• Width of internal road	06 mtr	Provided	MR
2.	Number, width, Type & Arrangements of exits(Common With Hotel)			
	a. Number of staircases			
	• Upper floors	02 nos	Provided	MR
	• Basements	NA	Provided	NA
	b. Width of staircases			
	• Upper floors	1.5 mtr	Provided (Old case)	MR(Old case)
	• Basements	NA	Provided	NA
	c. Protection of exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	Required	Provided	MR
	d. No of continuous staircase to terrace	Required	Provided	MR
	e. Width Of Corridor	1.5m	Provided	MR
	f. Door Size	2m & 1.5m	Provided	MR
3.	Compartmentation(Common With Hotel)			
	• Fire check door	Required	Provided	MR
	• Sealing of electrical shafts	NA	Provided	NA
	• Fire Rating of shaft door	NA	Provided	NA
	• Water Curtain	NA	Provided	NA
	• Fire Dampers	NA	Provided	NA
4.	Smoke managements System			
	• Basements	NA	NA	NA
	• Upper floors	12 a/c per hour	Provided by hotel	MR



5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types IS marking 	08 nos. each floor type ABC, CO2 ISI marked	Provided Provided Provided	MR MR MR
6.	First - Aid Hose Reel	Common with hotel		
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	Required 36 m 5 mm	Provided by hotel Provided by hotel Provided by hotel	MR MR MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	Smoke/ Heat Required Required Required Required	Provided Provided Provided Provided Provided	MR MR MR MR MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided by hotel	MR
10.	Automatic Sprinkler System (Common with hotel)			
	<ul style="list-style-type: none"> Basements Upper Floor Sprinkler above false ceiling 	NA Required Required	Provided Provided Provided	NA MR MR
11.	Internal Hydrants: (common with the Hotel)			
	<ul style="list-style-type: none"> Size of riser/down- comer Number of hydrants per floor Hose Box 	150 mm 1 Required	Provided by hotel Provided by hotel Provided by hotel	MR MR MR
12.	Yard Hydrants			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	NA NA	Provided by hotel Provided by hotel	NA NA
13.	Pumping Arrangements: Common with Hotel			
	<ul style="list-style-type: none"> Ground Level Discharge of main pump Head of main pump Number of main pumps Jockey pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Staring/Manual stopping Pump House Access Terrace level Discharge of pump Head of the pump Power supply Auto starting of pump 	NA NA NA NA NA NA NA NA NA NA 900 lpm 40 m Required Required	2850 LPM 90 mtr 2 electric 220 LPM 90 mtrl 2850 LPM 90mtr Provided Provided Provided Provided Provided	NA NA NA NA NA NA NA NA NA MR MR MR MR
14.	Captive water Storage for fire fighting: Common with Hotel			
	<ul style="list-style-type: none"> Under ground tank capacity Draw off connection Fire service inlet Access to tank Overhead Tank capacity 	NA NA NA NA 20, 000 litres	2,00,000 ltr (Provided by hotel) Provided by hotel Provided by hotel Provided by hotel Provided by hotel	NA NA NA NA MR

15	Exit Signage	Required	Provided by hotel	MR
16.	Provision of Lifts Common with Hotel			
	➤ Pressurization of Lift Shaft	NA	Provided by hotel	NA
	➤ Pressurization of lift lobby	NA	Provided by hotel	NA
	➤ Communication in lift Car	NA	Provided by hotel	NA
	➤ Fireman's Grounding Switch	NA	Provided by hotel	NA
	➤ Lift Signage	NA	Provided by hotel	NA
17.	Standby power supply	Required	Provided by hotel	MR
18.	Refuge Area			
	➤ Total area	NA	Provided	NA
	➤ Location	NA	Provided	NA
19.	Fire control room(Common with Hotel)			
	➤ Detector system panel	NA	Provided by hotel	NA
	➤ Flow Switch Panel	NA	Provided by hotel	NA
	➤ PA System Panel	NA	Provided by hotel	NA
	➤ Battery backup	NA	Provided by hotel	NA
	➤ Building Floor Plans	NA	Provided by hotel	NA
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	Provided by hotel	NA

The fire protection systems provided in the building were test checked and found functional at the time of inspection.


Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under Rule 35 of the Delhi Fire Service Rules 2010.


1. The Smaash Entertainment Pvt. Ltd located at, First floor Radisson Blu Hotel Plot No.4, Sector-13 Dwarka, New Delhi-110075.
2. The total covered area for restaurant = 839M²
3. As per part IV, NBC-2016, table no 4.3 under clause 4.4.2.1 the occupant load for dining area and restaurant is 1.8. Accordingly the number of seats come out to be 466 (839/1.8=466.11 say 466) for whole restaurant.
4. The total seating capacity comes out be 466.

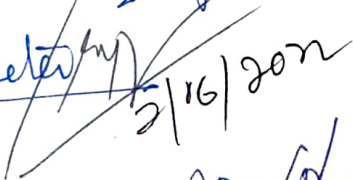
This area is already sanctioned as restaurant, therefore width of Staircases has been considered as 1.5m as per sanctioned plan.

Signature of the Inspecting Officer
 Name: -Sh. Vedpal
 Designation: - DO/SW

Signature of the Inspecting Officer
 Name:- Sh. Udai vir Singh
 Designation ADO/DWK

Dyefo (\$2)

 1/6

C.F.O.

 2/6/2022

Director

 2/16/2022

ADO (Dwarka)

DO/SW

2/6/22