

Cpu

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE  
NEW DELHI- 110 001**

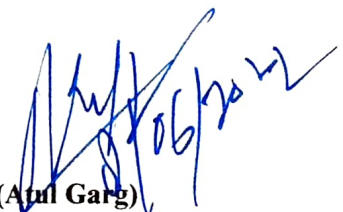
No.F6/DFS/MS/School/2022/NDZ/ 624

Dated: 10/06/2022

**FIRE SAFETY CERTIFICATE**

Certified that the M/s EDMC Primary School located at A-4 Nand Nagri, Delhi-110093, comprised of ground plus one upper floor, owned/occupied by M/s EDMC Primary School have complied with fire prevention and fire safety requirements in accordance with Director of Education Circular Letter No. F16/Estate/CC/Fire Safety/2011 /3298 to 3398 dated 01/03/11 ,and verified by the officer concerned of Fire Service on 25/05/2022 in presence of Mr. Deepak Kumar (HOS) and that the buildings/premises is fit for occupancy class “ **Educational (Group-B)**” with effect from 10/06/2022 for a period of **three** years in accordance with the rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010, printed below.

Issued on 10/06/2022 at New Delhi by

  
(Ajul Garg)  
Director



To,  
The Principal,  
EDMC Primary School,  
A-4, Nand Nagri, Delhi-110093.

- Copy:-
- 1) The Director of Education,  
Udyog Sadan, Plot No.419, FIE,  
Patparganj Industrial Area, Delhi-110092
  - 2) The Ex. Eng. (Elect,)-II,  
Shahdara (North)Zone,  
EDMC, Office of Executive Engineer (Elect)-II,  
MCD Zonal Office Buildings, Keshav Chowk,  
G.T. Road, Near Shyam Lal College.

## CONDITIONS

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
5. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction /unauthorized use of land if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
7. The owner / occupier shall apply for renewal of this Fire Safety Certificate of the Director in Form 'J' [sub rule (1) of rule (37)] along with a copy of this Certificate, Six Months prior to its expiry.

W/19

1. Name & address of the building : EDMC Primary School,  
A-4, Nand Nagri, Delhi-110093
2. Building is comprised of : Ground plus first floor only
3. Type of Occupancy : Educational
4. Type of Case : New (Addition/Alteration)
5. Details of Previous NOC letter : F6/DFS/MS/School/2015/NDZ/1702 dt.16/09/15  
(Ground floor only )
6. Fire Safety direction letter No : F16/Estate/CC/FireSafety/2011/3298to3398 dt-01/03/11
7. Date of Inspection : 25/05/2022
8. Name of the Inspecting officers : ADO Mehmood
9. Name and designation of Officer  
from the building side : Mr. Deepak kumar,(Hos)
10. Year of Construction : 1976 & 2017
11. Applicant's letter No : EDMC/EE(E)-I/SHN/2021-22/D-40 dated-02/05/2022

Sr. No.	Minimum Standards on Fire Prevention and Fire Safety U/R33	Circular Requirement	Provided at Site	Remarks MR/NMR
01	Access to Building			
	• Road width	06 mtr.	06 mtr.	MR
	• Gate width	4.50 mtr	4.50 mtr	MR
	• Width of internal road	N/A	N/A	N/A
02	Number, Width, Type and Arrangement of Exits			
	a. Number of Staircases			
	• Upper floor	01 nos	02 nos.	MR
	• Basement	N/A	N/A	N/A
	b. Width of Staircases			
	• Upper floor	1.50 mtr	1.50 mtr & 1.50 mtr.	MR
	• Basement	N/A	N/A	N/A
	c. Protection of Exits			
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	d. No. of Continuous Staircases to Terrace	01 no.	01 no.	MR
	e. Width of Corridor	1.50 mtr	02 mtr	MR
	f. Door Size	1 mtr.	1 mtr.	MR
03	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire rating of shaft door	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
04	Smoke Management System.			
	• Basement	N/A	N/A	N/A
	• Upper floor	N/A	N/A	N/A
05.	Fire Extinguishers			
	• Total numbers	09 nos.	09 nos.	MR
	• types	ABC /CO <sub>2</sub>	ABC /CO <sub>2</sub>	MR
	• IS marking	ISI marked	ISI marked	MR

27

06	First-aid-Hose Reels.			
	Total numbers on each floor	N/A	N/A	N/A
	• Length of hose reel hose	N/A	N/A	N/A
	• Nozzle diameter	N/A	N/A	N/A
07	Automatic fire detection and alarming system.			
	• Type of detectors	N/A	N/A	N/A
	• Location of main panel	N/A	N/A	N/A
	• Location of repeater panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooter's location	N/A	N/A	N/A
08	MOEFA	N/A	N/A	N/A
09	Public address System.	N/A	N/A	N/A
10	Automatic Sprinkler System.			
	• Basement	N/A	N/A	N/A
	• upper floor	N/A	N/A	N/A
	• sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	• size of riser/down-comer	N/A	N/A	N/A
	• Number of hydrants per floor	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
12	Yard Hydrants.			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13	Pumping Arrangements.			
	• Ground Level	N/A	N/A	N/A
	➤ Discharge of main pump	N/A	N/A	N/A
	➤ Head of Main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey pump out put	N/A	N/A	N/A
14	Captive Water Storage for Fire Fighting.			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	N/A	N/A	N/A
15	Exit Signage.			
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby pump out put	N/A	N/A	N/A
	➤ Standby pump Head	N/A	N/A	N/A
	➤ Auto Starting /Manual stopping	N/A	N/A	N/A
	➤ Pump house access	N/A	N/A	N/A
	• Terrace Level	N/A	N/A	N/A
	➤ Discharge of pump	N/A	N/A	N/A
	➤ Head of the pump	N/A	N/A	N/A
	➤ Power supply	N/A	N/A	N/A
	➤ Auto Starting of pump	N/A	N/A	N/A



16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication in lift car	N/A	N/A	N/A
	• Firemen's grounding switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby Power Supply	N/A	N/A	N/A
18	Refuge Area.			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector system panel	N/A	N/A	N/A
	• Flow switch panel	N/A	N/A	N/A
	• PA system panel	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building Floor plans	N/A	N/A	N/A
20	Special Fire Protection systems for protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested/checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety measures required under the rules, it recommended to grant Fire Safety Certificate under the rule 35 of Delhi Fire Service rules 2010.

*Mehmood*  
3/15/22

Signature of the Inspecting Officer  
Name - Mehmood  
Designation - A.D.O (TP)

DO(ED)

Earlier School was Ground Floor only.  
Now, it is G+1. Submitted fl.

DY. CPO (NDZ)

*AK*  
01/06/2022

*Mehmood*  
3/16/22

CPO *Mehra*  
3/16/2022

Directed by *Mehra*  
3/16/2022

*AK*  
06/06/2022  
A.D.O (TP)

