

c-8

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110001

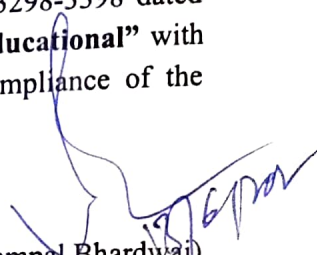
No. F6/DFS/MS/School/2022/ 634

Dated: 13/6/2022

FIRE SAFETY CERTIFICATE

Certified that the **Radhey Krishna Public School** located at **Khasra. No-257/176, Radha Vihar, Near Labour Chowk, Mukand Pur Village, Delhi-110042** comprised of **Ground and First floor only** owned/ occupied by **Radhey Krishna Public School** was issued Fire Safety Certificate by this department vide letter **No.F6/DFS/MS/2018/2766** dated **31.12.2018**. The premises was re-inspected by the officer concerned of this department on **28.05.2022** in presence of **Sh. Madan Sharma (Chairmen)** and observed that all the fire safety arrangements as provided in the premises found in good working condition. The premises have deemed complied with requirements of circular issued by Director of Education vide letter no 3298-3398 dated 01.03.2011 and the building/ premise is fit for occupancy class "**Group B Educational**" with effect from 13/6/22..... for a period of **three years**, subject to compliance of the conditions mentioned below:

Issued on 13/6/22..... at New Delhi by.


(Dharampal Bhardwaj)
Dy.Chief Fire Officer
Ph:-011-23414250
Sh R

Copy to : -

1. The Director, Education, Government of N.C.T of Delhi. Old Sectt. Delhi - 110054.
2. The Chairmen, Radhey Krishna Public School located at Khasra. No-257/176, Radha Vihar Near Labour Chowk, Mukumgpur Village, Delhi-110042.

Conditions for the validity of Fire Safety Certificate:

- 1 All the means of escape/entry/exit shall be kept free from any obstruction.
- 2 All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
- 3 All the staff members must know the correct method of operation of firefighting system.
- 4 The owner / occupier shall submit a declaration **every year** in **Form "K"** provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on <http://delhi.gov.in/wps/wcm/connect/doi/fire/FIRE/Home/Forms>.
- 5 This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
- 6 "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in **Form 'J'** [sub rule (1) of rule 37] along with a copy of this Certificate, **six months** prior to its expiry".

INSPECTION REPORT

1. Name & address of the building : Radhey Krishna Public School, Kh. No-257/176, Radha Vihar Near Labour Chowk, Mukand Pur Village Delhi-110042.
2. Type of Occupancy : Educational
3. Composition of building : Ground +01 upper floor only
4. Type of Case : Renewal
5. Details of previous NOC : F6/DFS/MS/2018/2766 Dated: 31.12.2018
6. Fire Safety directives letter No : Director of Education Letter dated 01.03.2011
7. Date of inspection : 28.05.2021
8. Name of the Inspecting Officers : ADO (RN)
9. Name and designation of officers from the building side : Mr. Madan Sharma (Chairman)
10. Year of Construction : 2015
11. Applicant's letter No. : Online E-mail dated 19.05.2022

Plot Area-2000 Sq.y Covered area --750sq.y No of student—280 nos, Total class room --12nos

| | Minimum Standards on fire prevention and fire safety U/R 33 | Dir. Of Education | Provided at site | Remarks MR/NMR |
|--------------|---|---------------------|---------------------|----------------|
| 1 | Access to building | | | |
| | • Road width | 06m | 06m | MR |
| | • Gate width | Directly Accessible | Directly Accessible | MR |
| | • Width of internal road | NA | NA | NA |
| 2 | Number, Width, Type & Arrangement of Exits | | | |
| | a. Number of staircases | | | |
| | • Upper Floors | 02 | 02 | MR |
| | • Basements | NA | NA | NA |
| | b. Width of staircases | | | |
| | • Upper Floors | 1.50 m | 1.80m & 1.20m | MR |
| | • Basements | NA | NA | NA |
| | c. Protection of exits | | | |
| | • Fire check door | NA | NA | NA |
| | • Pressurization | NA | NA | NA |
| | d. No. of continuous staircases to terrace | NA | 01 | NA |
| | e. Width of Corridor | NA | NA | NA |
| f. Door Size | 1.0m | 1.0m | MR | |
| 3 | Compartmentation. | | | |
| | • Fire check door | NA | NA | NA |
| | • Sealing of electrical shafts | NA | NA | NA |
| | • Fire Rating of shaft door | NA | NA | NA |
| | • Water Curtain | NA | NA | NA |
| | • Fire Dampers | NA | NA | NA |
| 4 | Smoke Management System. | | | |
| | • Basements | 12 a/c per hour | No basement | NA |
| | • Upper floors | 12 a/c per hour | Natural Ventilated | MR |
| 5 | Fire Extinguishers | | | |

| | | | | |
|----|---|---------|--------|-----|
| | • Total numbers | 06nos | 06nos | MR |
| | • Types | ABC/Co2 | ABC--6 | MR |
| | • ISI marking | Yes | Yes | MR |
| 6 | First-Aid Hose Reels. | | | |
| | • Total numbers on each floor | NA | NA | NA |
| | • Length of hose reel hose | NA | NA | NA |
| | • Nozzle diameter | NA | NA | NA |
| 7 | Automatic fire detection and alarming system | | | |
| | • Type of detectors | NA | NA | NA |
| | • Location of Main Panel | NA | NA | NA |
| | • Location of Repeater Panel | NA | NA | NA |
| | • Alternate source of power | NA | NA | NA |
| | • Hooters' Location | NA | NA | NA |
| 8 | MOEFA | NA | NA | NA |
| 9 | Public Address System. | NA | NA | NA |
| 10 | Automatic Sprinkler System. | | | |
| | • Basement | NA | NA | NA |
| | • Upper Floor | NA | NA | NA |
| | • Sprinkler above false ceiling | NA | NA | NA |
| 11 | Internal Hydrants | | | |
| | • Size of riser/down-comer | NA | NA | NA |
| | • Number of hydrants per floor | NA | NA | NA |
| | • Hose Box | NA | NA | NA |
| 12 | Yard Hydrants. | | | |
| | • Total number of hydrants | NA | NA | NA |
| | • Hose Box | NA | NA | NA |
| 13 | Pumping Arrangements. | | | |
| | • Ground Level | | | |
| | ➤ Discharge of main Pump | N/A | N/A | N/A |
| | ➤ Head of Main pump | N/A | N/A | N/A |
| | ➤ Number of main pumps | N/A | N/A | N/A |
| | ➤ Jockey Pump out put | N/A | N/A | N/A |
| | ➤ Jockey pump head | N/A | N/A | N/A |
| | ➤ Standby Pump out put | N/A | N/A | N/A |
| | ➤ Standby Pump Head | N/A | N/A | N/A |
| | ➤ Auto Starting/ Manual stopping | N/A | N/A | N/A |
| | ➤ Pump House Access | N/A | N/A | N/A |
| | • Terrace level | N/A | N/A | N/A |
| | ➤ Discharge of pump | | | |
| | ➤ Head of the pump | NA | NA | NA |
| | ➤ Power Supply | NA | NA | NA |
| | ➤ Auto Starting of pump | NA | NA | NA |
| | | NA | NA | NA |
| 14 | Captive Water Storage for fire fighting. | | | |
| | • Underground tank capacity | NA | NA | NA |
| | ➤ Draw-off connection | NA | NA | NA |

| | | | | |
|----|--|-----|-----|-----|
| | <ul style="list-style-type: none"> ➤ Fire service inlet ➤ Access to tank • Overhead Tank capacity | NA | NA | NA |
| | | NA | NA | NA |
| | | NA | NA | NA |
| 15 | Exit Signage. | NA | NA | NA |
| 16 | Provision of Lifts. | | | |
| | • Pressurization of Lift Shaft | N/A | N/A | N/A |
| | • Pressurization of Lift lobby | N/A | N/A | N/A |
| | • Communication In lift Car | N/A | N/A | N/A |
| | • Fireman's Grounding Switch | N/A | N/A | N/A |
| | • Lift Signage | N/A | N/A | N/A |
| 17 | Standby power supply | N/A | N/A | N/A |
| 18 | Refuge Area. | | | |
| | ➤ Total Area | N/A | N/A | N/A |
| | ➤ Location | N/A | N/A | N/A |
| 19 | Fire Control Room | | | |
| | • Detector System Panel | N/A | N/A | N/A |
| | • Flow Switch Panel | N/A | N/A | N/A |
| | • PA System Panel | N/A | N/A | N/A |
| | • Batter backup | N/A | N/A | N/A |
| | • Building Floor Plans | N/A | N/A | N/A |
| 20 | Special Fire Protection Systems for Protection of special Risks, if any: | N/A | N/A | N/A |

The fire protection systems provided in the building were tested/ checked randomly and found in good working condition at the time of inspection.

Keeping in view the satisfactory compliance of the minimum standards on fire prevention and fire safety required as stipulated in director of education Circular dated 01.03.2011, it is recommended to renewal of fire safety certificate issued vide this department letter of even no. 2766 dated 31.12.2018.

DO (10/4)
 01/06/2022
 10/23

Signature of the Inspecting Officer
 Name :- C.L. Meena
 Designation :- ADO/RN

AAO/R.N
 9/6/2022
 FT letter in prop for safety
 18/6/2022
 9/6/22