

6-21

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI – 110001**

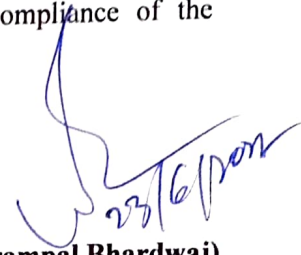
No F 6/DFS/MS/2022/School/WZ/ 688

Dated: 23/06/2022

**FIRE SAFETY CERTIFICATE**

Certified that the **Ryan International School, G-2(Adjacent bldg), Sec-11, Rohini, Delhi-85**, comprised of **Ground + One upper floor** owned/occupied by **Ryan International School** was granted FSC by this department vide letter No. **F.6/DFS/MS/2019/1049 dated 17.05.2019**. The premises was re-inspected by the officer concerned of this department on **03.06.2022** in the presence of **Mr. Abhishek Tirkey** and observed that all the fire prevention and fire safety arrangements as provided in the premises found in good working condition. The premises have deemed complied with requirements of circular issued by **Director of Education letter no 3298-3398 dated 01.03.2011** and the building/ premise is fit for occupancy Group B Educational with effect from ...23/6/2022... for a period of **three years**, subject to compliance of the conditions mentioned below:

Issued on ...23/06/2022... at New Delhi

  
**(Dhrampal Bhardwaj)**  
**Dy.Chief Fire Officer**  
**Tel;-01123414250**

Copy to: -

1. The Director, Education, Government of N.C.T of Delhi. Old Sect. Delhi - 54.
2. The Principal, Ryan International School, G-2(Adjacent bldg), Sec-11, Rohini, Delhi.85.

**Conditions for the validity of Fire Safety Certificate:**

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [http://www.delhi.gov.in/wps/wcm/connect/doi\\_fire/FIRE/Home/Fire+Safety+Acts+and+Ru](http://www.delhi.gov.in/wps/wcm/connect/doi_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/)  
[les/ http://www.delhi.gov.in/wps/wcm/connect/doi\\_fire/FIRE/Home/Forms](http://www.delhi.gov.in/wps/wcm/connect/doi_fire/FIRE/Home/Forms)

**INSPECTION REPORT**

1. Name & address of the building : Ryan International School, G-2(Adjacent bldg), Sec-11, Rohini, Delhi-110085.
2. Type of Occupancy : Educational
3. Type of Case : Renewal (Ground + 01 upper floors)
4. Details of Previous NOC : F.6/DFS/MS/2019/1049 dated 17.05.2019
5. Fire Safety directives letter No : Director of Education Cir. dated 01.03.2011
6. Date of inspection : 03.06.2022
7. Name of Inspecting Officer : A.K.Sharma ADO(Rohini)
8. Name and designation of officers  
From the building side : Mr. Abhishek Tirkey
9. Year of Construction : 2005
10. Applicant's letter No. : Online e-mail dated 09.05.2022.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Director of Education Cir. dated 01.03.2011	Provided at site	Remarks MR/NMR
1.	<b>Access to building</b>			
	• Road width	Accessible	Accessible	MR
	• Gate width	Accessible	4.5m	MR
	• Width of internal road	NA	NA	NA
2.	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	a. Number of staircases			
	• Upper Floors	01	01	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floor	1.5m	1.5m	MR
	• Basements	NA	NA	NA
	c. Protection of exits			
	Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No. of continuous staircases to terrace	NA	01nos.	NA
	e. Width of Corridor	NA	NA	NA
	f. Door Size	1.0m	1.0m	MR
3.	<b>Compartmentation</b>			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	<b>Smoke Management System</b>			
	• Basements	30 a/c per hour	NA	NA
	• Upper floors	12 a/c per hour	Natural ventilated	MR
5.	<b>Fire Extinguishers</b>			
	• Total numbers	04nos.	09nos.	MR
	• Types	ABC/CO2	ABC-09	MR
	• IS marking	ISI marked	Yes	MR
6.	<b>First-Aid Hose Reels</b>			
	• Total numbers on each floor	NA	01 Provided	NA
	• Length of hose reel hose	NA	30m Provided	NA
	• Nozzle diameter	NA	5mm Provided	NA
7.	<b>Automatic fire detection and alarming system</b>			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA

N-19

	<ul style="list-style-type: none"> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooters' Location</li> </ul>	NA	NA	NA
8.	<b>MOEFA</b>	NA	NA	NA
9.	<b>Public Address System</b>	NA	NA	NA
10.	<b>Automatic Sprinkler System</b>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Basement</li> <li>Ground &amp; Upper Floors</li> <li>Sprinkler above false ceiling</li> </ul>	NA	NA	NA
11.	<b>Internal Hydrants</b>	NA	01 DC system	NA
	<ul style="list-style-type: none"> <li>Size of riser/down-comer</li> <li>Number of hydrants per floor</li> <li>Hose Box</li> </ul>	NA	01	NA
		NA	01	NA
12.	<b>Yard Hydrants</b>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Total number of hydrants</li> <li>Hose Box</li> </ul>	NA	NA	NA
13.	<b>Pumping Arrangements</b>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Ground Level</li> <li>➤ Discharge of main Pump</li> <li>➤ Head of Main pump</li> <li>➤ Number of main pumps</li> <li>➤ Jockey Pump out put</li> <li>➤ Jockey pump head</li> <li>➤ Standby Pump out put</li> <li>➤ Standby Pump Head</li> <li>➤ Auto Starting/Manual Stopping</li> <li>➤ Pump House Access</li> </ul>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Terrace level</li> <li>➤ Discharge of pump</li> <li>➤ Head of the pump</li> <li>➤ Power Supply</li> <li>➤ Auto Starting of pump</li> </ul>	NA	450lpm	NA
		NA	Provided	NA
		NA	Provided	NA
		NA	Provided	NA
14.	<b>Captive Water Storage for fire fighting</b>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Underground tank capacity</li> <li>➤ Draw-off connection</li> <li>➤ Fire service inlet</li> <li>➤ Access to tank</li> <li>Overhead Tank capacity</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	5,000ltr	NA
15.	<b>Exit Signage.</b>	Required	Provided	MR
16.	<b>Provision of Lifts.</b>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Pressurization of Lift Shaft</li> <li>Pressurization of Lift lobby</li> <li>Communication In lift Car</li> <li>Fireman's Grounding Switch</li> <li>Lift Signage</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
17.	<b>Standby power supply</b>	NA	NA	NA
18.	<b>Refuge Area.</b>	NA	NA	NA
	<ul style="list-style-type: none"> <li>➤ Total Area</li> <li>➤ Location</li> </ul>	NA	NA	NA
		NA	NA	NA
19.	<b>Fire Control Room</b>	NA	NA	NA
	<ul style="list-style-type: none"> <li>Detector System Panel</li> <li>Flow Switch Panel</li> <li>PA System Panel</li> </ul>	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA

checked randomly ar'  
ds on fire preve  
2011 NBC P  
letter of ever

N-20

	<ul style="list-style-type: none"><li>Battery backup</li><li>Building Floor Plans</li></ul>	NA	NA	NA
v.0.	<b>Special Fire Protection System for Protection of special Risks, if any:</b>	NA	NA	NA

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures required stipulated in **Director of Education Circular**, the FSC issued vide letter no. **F.6/DFS/MS/2019/1049 dated 17.05.2019** is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.

Signature of the Inspecting Officer  
Name Ajay Kumar Sharma  
Designation ADO(Rohini)

DO (NW)

08/06/2022  
Dy CPO (W2)

9/6/2022

ADO Rohini

FT letter is put up for kind perusal and signature please.

Dy CPO (W2)

20/6/2022

21/6/22

rest all