

420

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI

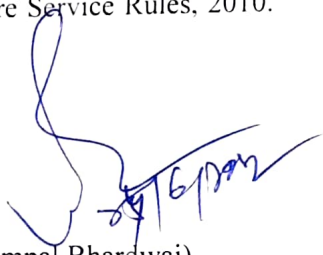
No. F6/DFS/MS/School/WZ/2022/702

Dated: 24/06/2022

FIRE SAFETY CERTIFICATE

Certified that the **The Adarsh Public School** Located at **Kirti Nagar, New Delhi-110015**, comprised of Ground Floor + 03 Upper Floors Owned/Occupied by **The Adarsh Public School** has already issued FSC Vide letter No. F6/DFS/MS/School/2018/WZ/1426 dated: - 19/06/2018 have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire service Act 2007 and Delhi Fire Service Rules 2010, and verified by the officer concerned of this department on 10/06/2022 in the presence of Sh. A.K. Sehgal (Manager) and found that the building / premises is fit for the occupancy class "**Educational**" **Group B** with effect from 24/6/2022 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010. Condition mentioned below.

Issued on 24/06/2022 at New Delhi.


(Dharampal Bhardwaj)
Dy. Chief Fire Officer
West Zone

Copy to:

1. The Principal, The Adarsh Public School located at Kirti Nagar, New Delhi-110015.
2. Director of Education, GNCT of NCT of Delhi, Old Secretariat.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1. Name & address of the building : **The Adarsh School** located at **Kirti Nagar, New Delhi - 110015**
2. Type of Occupancy : Educational (Ground + 3 Upper Floor)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/School/2018/1426 dated 19/06/2018.
5. Fire Safety directives letter No : DOE Circular No. 262-362 dated 17/01/2005
6. Date of inspection : 10/06/2022
7. Name of the Inspecting Officers : Sarabjeet Singh ADO (MN)
8. Name and designation of officers from the building side : Ms. A.K. Sehgal (Manager)
9. Year of Construction : 1998 (As per prev insp. report dated 01/06/2018)
10. Applicant's letter No. : Nil dated 08/02/2022

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Cr. No 262 – 362 dated 17/01/2005 As per prev insp. report dtd. 01/06/2018	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	06 mtr	On Main Road	MR
	• Gate width	4.5 mtr	Provided	MR
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	02	02 Provided	MR
	• Upper Floors	NA	NA	NA
	• Basements			
	b. Width of staircases	1.5 mts	1.35 mtr & one ramp 1.15 mtr	MR (Old Case)
	• Upper Floors	NA	NA	NA
	• Basements			
	c. Protection of exits	NA	NA	NA
	• Fire check door	NA	NA	NA
	• Pressurization			
	e. No. of continuous staircases to terrace	01	Provided	MR
	f. Width of Corridor	1.5 mts	Provided	MR
	g. Door Size	1 mtr	Provided	MR
3	Compartmentation.			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4	Smoke Management System.			
	• Basements	NA	NA	NA
	• Upper floors	NA	NA	NA
5	Fire Extinguishers			
	• Total numbers	10 nos.	Provided	MR
	• Types	CO ₂ , ABC type	Provided	MR
	• IS marking	ISI marked	Provided	MR

6	First-Aid Hose Reels.			
	• Total numbers on each floor	01	Provided	MR
	• Length of hose reel hose	30 mtr	Provided	MR
	• Nozzle diameter	5mm	Provided	MR
7	Automatic fire detection and alarming system.			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8	MOEFA	Required	Provided	MR
9	Public Address System.	Required	Provided	MR
10	Automatic Sprinkler System.			
	• Basement	NA	NA	NA
	• Upper Floor	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11	Internal Hydrants			
	• Size of riser/down-comer	100mm	Provided	MR
	• Number of hydrants per floor	01	Provided	MR
	• Hose Box	01	Provided	MR
12	Yard Hydrants.			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13	Pumping Arrangements.			
	• Ground Level			
	➤ Discharge of main Pump	NA	NA	NA
	➤ Head of Main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey Pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Starting/ Manual stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level			
	➤ Discharge of pump	450 lpm	Provided	MR
	➤ Head of the pump	28 MH	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	NA	NA	NA
	➤ Draw-off connection	NA	NA	NA
	➤ Fire service inlet	Required	Provided	MR
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	10,000 ltr	Provided	MR
15	Exit Signage.	Required	Provided	MR

16 Provision of Lifts.				
	• Pressurization of Lift Shaft	NA	NA	NA
	• Pressurization of Lift lobby	NA	NA	NA
	• Communication In lift Car	NA	NA	NA
	• Fireman's Grounding Switch	NA	NA	NA
	• Lift Signage	NA	NA	NA
17	Standby power supply	Required	Provided	MR
18 Refuge Area.				
	➤ Total Area	NA	NA	NA
	➤ Location	NA	NA	NA
19 Fire Control Room				
	• Detector System Panel	NA	NA	NA
	• Flow Switch Panel	NA	NA	NA
	• PA System Panel	NA	NA	NA
	• Batter backup	NA	NA	NA
	• Building Floor Plans	NA	NA	NA
20	Special Fire Protection Systems for Protection of special Risks, if any:	NA	NA	NA

The fire protection system provided in the building were tested, checked and found functional at the time of inspection.

Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the NOC issued vide letter No. F6/DFS/MS/School/2019/WZ/1426 dated: - 19/06/2018 renewal under rule 35 of the Delhi Fire Service rules 2010 is recommended.

~~DO (w2)~~

~~Signature~~
14/6/2022

Signature of the Inspecting Officer
Name: Sarabjeet Singh
Designation: ADO (MN)

335/20/WZ
17/6/2022

17/6/2022

~~DO (w2)~~

22/6/2022

~~ADP (MN)~~

Sir, F. T is put up for your personal & signature please.

Signature
21/6/2022

~~DO (w2)~~

24/6/2022

ms / cel