



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001



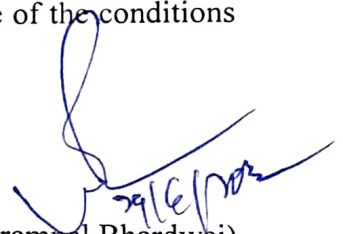
No. F6/DFS/MS/School/WZ/2022/ 729

Dated: 29/06/2022

FIRE SAFETY CERTIFICATE


Certified that the **Gurusharan Convent School** Located at **GH-9, Paschim Vihar (Near Telephone Exchange), New Delhi-110087**, comprised of Basement + Ground + 03 Upper Floors only owned/occupied by **Gurusharan Convent School** was issued Fire Safety Certificate by this department Vide Letter No. **F6/DFS/MS/School/2018/736 Dated 19.04.2018**. The said premise was re-inspected by the officer concerned of this department on 13.06.2022 in the presence of Sh. Harpreet (Accountant) and found that the premises / building have deemed complied with the fire prevention and fire safety requirements in accordance D.O.E., GNCT of Delhi, Circular no.262-362 dated 17.05.2005 and that the premises/building is fit for occupancy class "Educational Building" Group B with effect from 29/06/2022 for a period of **three years**, in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules 2010, printed below.

Issued on 29/06/2022 at New Delhi by.


(Dharampal Bhardwaj)
Dy. Chief Fire Officer
(West Zone)

Copy to: -

1. The Director, Directorate of Education, GNCT of Delhi, Old Secretariat Delhi 110054.
2. The Principal, Gurusharan Convent School, GH-9, Paschim Vihar (Near Telephone Exchange), New Delhi-110087.


29/6/22

Following fire safety directives must be adhered to:-

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional if fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupation, electric installation etc. may be got verified from the concerned authorities.
5. The Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction / unauthorized use of land if any.
6. All comments / directions of licensing Department shall always be permitted and followed.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in
8. The owner / occupier shall apply for renewal of this Fire Safety Certificate to the Director in 'Form J' (sub Rule (1) of Rule 37) along with copy of the certificate, six months prior to its expiry.

INSPECTION REPORT

1. Name & address of the building : **Gurusharan Convert School** Located at **GH-9, Paschim Vihar, New Delhi-110087.**
2. Type of Occupancy : Educational
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/School/2018/WZ/736 dated 19.04.2018
5. Fire Safety directives letter No : D.O.E. Circular No. 262-362 dated 17.01.2005
6. Date of inspection : 13.06.2022
7. Name of the Inspecting Officers : Aman Kumar Lathar, ADO (JWP)
8. Name and designation of officers from the building side : Sh. Harpreet (Accountant)
9. Year of Construction : 2006
10. Applicant's letter No. : 287 dated 04.05.2022

The School building is comprised of Basement, Ground Plus Three Upper Floors.

S. No	Minimum Standards on fire prevention and fire safety U/R 33	D.O.E. Cr. No. 262-362 dated 17.01.2005/ FSC as per dated 19.04.2018	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	06 mts	Provided	MR
	• Gate width	4.5 mts	Provided	MR
	• Width of internal road	N/A	N/A	N/A
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	-----	-----	-----
	• Upper Floors	02	Provided	MR
	• Basements	02	Provided	MR
	b. Width of staircases	-----	-----	-----
	• Upper Floors	1.5 mts each	1.60 mts each	MR
	• Basements	1.5 mts each	1.60 mts each	MR
	c. Protection of exits	-----	-----	-----
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	01	Provided	MR
	g. Width of Corridor	1.5 mts	2.25 mts	MR
	h. Door Size	1.0 mt.	1.25 mts	MR
3	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	Smoke Management System.			

N-19

	<ul style="list-style-type: none"> Basements Upper floors 	30 a/c per hour 12 a/c per hour	Provided N/A	MR N/A
5	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types IS marking 	15 nos. ABC, CO ₂ type ISI marked	Provided Provided Provided	MR MR MR
6	First-Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	01 30 m 5 mm	Provided Provided Provided	MR MR MR
7	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
8	MOEFA	Required	Provided	MR
9	Public Address System.	Required	Provided	MR
10	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Upper floors Sprinkler above false ceiling 	Required N/A N/A	Provided N/A N/A	MR N/A N/A
11	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box 	100 mm 01 01	Provided Provided Provided	MR MR MR
12	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	N/A N/A	N/A N/A	N/A N/A
13	Pumping Arrangements			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/ Manual stopping Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 	--- N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A --- 450, 180 LPM 40 mts Required Required	---- N/A N/A N/A N/A N/A N/A N/A N/A N/A ----- Provided Provided Provided Provided	----- N/A N/A N/A N/A N/A N/A N/A N/A N/A ----- MR MR MR MR

14	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> Underground tank capacity 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Draw-off connection 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Fire service inlet 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Access to tank 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Overhead Tank capacity 	10,000 lts	Provided	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.	Not Applicable		
	<ul style="list-style-type: none"> Pressurization of Lift Shaft 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Pressurization of Lift lobby 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Communication In lift Car 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Fireman's Grounding Switch 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Lift Signage 	N/A	N/A	N/A
17	Standby power supply	Required	Provided	MR
18	Refuge Area.			
	<ul style="list-style-type: none"> Total Area 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Location 	N/A	N/A	N/A
19	Fire Control Room			
	<ul style="list-style-type: none"> Detector System Panel 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Flow Switch Panel 	N/A	N/A	N/A
	<ul style="list-style-type: none"> PA System Panel 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Batter backup 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Building Floor Plans 	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	Required 02 nos. ABC type Fire Extinguishers near electrical panel	Provided	MR

The Fire protection systems provided in the building were checked and found functional at the time of inspection. The Shortcomings issued vide letter no. F6/DFS/MS/School/WZ/2022/87 dated 25.02.2021 are rectified.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety requirements as per D.O.E. Cr. No. 262-362 dated 17.05.2005, renewal of Fire Safety Certificate issued vide letter no. F6/DFS/MS/School/2018/WZ/736 Dated 19.04.2018 is recommended.

Accordingly DFA is put up for approval please.

(Signature)
25/6/22
Aman Kumar Lathar
ADO (JWP)

DO (W)
NO (WEST) 353
DO 22/6/2022
DCS (W2)
MS/CCP
DCS (W2)
F.F. letter is put-up for signature H.
29/6/2022
(Signature)
29/6/22
(Signature)
28/6/22
ADO (JWP)