

c-11

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**


No. F6/DFS/MS/EH/SZ/2022/ 188

Dated: 29/06/2022

**FIRE SAFETY CERTIFICATE**

Certified that the M/s. WYLD Restaurant (a unit of Cuisineur Hospitality), located at First floor, 30B, Old Rajender Nagar, Pusa Road, New Delhi - 110005, running at first floor only of a building comprised of basement, stilt, ground plus three upper floors, owned/occupied by WYLD Restaurant (A unit of Cuisineur Hospitality) have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officers concerned of Delhi Fire Service on 18.06.2022 in presence of Sh. Vikram Handa (Owner) and the building/premises is fit for occupancy class Assembly (Restaurant) at First floor Only with effect from 29/06/2022 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules 2010, printed below.

Issued on 29/06/2022 at New Delhi by.

  
(Atul Garg)  
Director

Delhi Fire Service

Copy to: Authorized Signatory, M/S WYLD Restaurant (A Unit of Cuisineur Hospitality), located at First floor, 30B, Old Rajender Nagar, Pusa Road, New Delhi- 110005 w.r.t. Online Application id 2022050409349 dated 09.05.2022

**Conditions for the validity of Fire Safety Certificate: -**

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non-functional of fire safety measures shall be at the risk & responsibility of the management.
3. The trained firefighting staffs should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. All the means of escapes /exits shall not be locked/bolted/blocked at any time for safe evacuation of the occupants in case of any emergency.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form "J" [ sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)

**INSPECTION REPORT**

1. Name & address of the building : M/s. WYLD Restaurant (A Unit of Cuisineur Hospitality), First floor, 30B, Old Rajender Nagar, Pusa Road, New Delhi.
2. Type of Occupancy : Assembly (Restaurant)
3. Building Composition : Restaurant running at First floor of a building comprised of basement, stilt, ground plus three upper floors, and the building was issued FSC vide letter No. F.6/DFS/MS/SZ/2021/409 dt. 23.08.2021
4. Type of Case : New Case
5. Details of previous NOC : N/A
6. Fire Safety directives letter No : N/A
7. Date of inspection : 18.06.2022
8. Name of the Inspecting Officers : Vedpal Chhikara, DO (SW) & P.V. Rathee, ADO (SRD)
9. Name and designation of officers from the building side : Sh. Vikram Handa (Owner)
9. Year of Construction : 2021
10. Applicant's letter No. : Online Application id 2022050409349 dated 09.05.2022

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement as per NBC/UBBL	Provided at site	Remarks MR/NMR
1	<b>Access to building</b>			
	• Road width	06 mts	Provided	MR
	• Gate width	N/A	N/A	N/A (on road)
	• Width of internal road	N/A	N/A	N/A
2	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	a. Number of staircases	-	-	-
	• Upper Floors	02 Nos.	02Nos.	MR
	• Basements	N/A	N/A	N/A
	b. Width of staircases	-	-	-
	• Upper Floors	2.0 & 1.50 mts	2.0 & 1.50 mts	MR
	• Basements	N/A	N/A	N/A
	c. Protection of exits	-	-	-
	• Fire check door	Required	Provided	MR
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	02	02	MR
	g. Width of Corridor	N/A	N/A	N/A
	h. Door Size	2m & 1.50 m	2.0 & 1.50 mts	MR
3	<b>Compartmentation.</b>			
	• Fire check door	Required	Provided	MR
	• Sealing of electrical shafts	Required	Sealed	MR
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	NA
4	<b>Smoke Management System.</b>			
	• Basements	30 a/c per hour	N/A	N/A
	• Upper floors	12 a/c per hour	Exhaust Fans Provided	MR
5	<b>Fire Extinguishers</b>			
	• Total numbers	Required	Provided	MR
	• Types	ABC & CO <sub>2</sub> type	ABC & CO <sub>2</sub> type	MR
	• IS marking	ISI marked	Provided	MR

6	<b>First-Aid Hose Reels.</b>			
	<ul style="list-style-type: none"> <li>Total numbers on each floor</li> <li>Length of hose reel hose</li> <li>Nozzle diameter</li> </ul>	01 nos. 30 m 5 mm	01 at each floor Provided Provided	MR MR MR
7	<b>Automatic fire detection and alarming system.</b>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooters' Location</li> </ul>	Smoke Required With in restaurant area N/A Required Required With in restaurant area	Provided Provided N/A Provided Provided	MR MR N/A MR MR
8	<b>MOEFA</b>	Required	Provided	MR
9	<b>Public Address System.</b>	N/A	N/A	N/A
10	<b>Automatic Sprinkler System.</b>			
	<ul style="list-style-type: none"> <li>Basement</li> <li>Entire Restaurant</li> <li>Sprinkler above false ceiling</li> </ul>	N/A N/A N/A	N/A Provided N/A	N/A N/A N/A
11	<b>Internal Hydrants</b>	<b>Provided &amp; Maintained by Bldg. management</b>		
	<ul style="list-style-type: none"> <li>Size of riser/down-comer</li> <li>Number of hydrants per floor</li> <li>Hose Box</li> </ul>	100 mm 01 No. 01 No.	Provided Provided Provided	MR MR MR
12	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants</li> <li>Hose Box</li> </ul>	N/A N/A	N/A N/A	N/A N/A
13	<b>Pumping Arrangements.</b>	<b>Provided &amp; Maintained by Bldg. management</b>		
	<ul style="list-style-type: none"> <li>Ground Level                             <ul style="list-style-type: none"> <li>Discharge of main Pump</li> <li>Head of Main pump</li> <li>Number of main pumps</li> <li>Jockey Pump out put</li> <li>Jockey pump head</li> <li>Standby Pump out put</li> <li>Standby Pump Head</li> <li>Auto Starting/ Manual stopping</li> <li>Pump House Access</li> </ul> </li> <li>Terrace level                             <ul style="list-style-type: none"> <li>Discharge of pump</li> <li>Head of the pump</li> <li>Power Supply</li> <li>Auto Starting of pump</li> </ul> </li> </ul>	--- 2280 lpm 60m 01 180 LPM 60m 2280 LPM 60m Required Required ----- 450 LPM 45 mts Required Required	--- Provided Provided Provided Provided Provided 2280 LPM 60 m Provided Provided ----- 900 LPM 45 mts Provided Provided	--- MR MR MR MR MR MR MR MR MR ----- MR MR MR MR
14	<b>Captive Water Storage for fire fighting.</b>	<b>Provided &amp; Maintained by Bldg. management</b>		
	<ul style="list-style-type: none"> <li>Underground tank capacity</li> <li>Draw-off connection</li> <li>Fire service inlet</li> <li>Access to tank</li> <li>Overhead Tank capacity</li> </ul>	1,00,000 lts Required Required Required 10,000 lts	Provided Provided Provided Provided Provided	MR MR MR MR MR
15	<b>Exit Signage.</b>	Required	Provided	MR


16	<b>Provision of Lifts.</b>			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	Required	Provided	MR
	• Fireman's Grounding Switch	Required	Provided	MR
	• Lift Signage	Required	Provided	MR
17	<b>Standby power supply</b>	Required	Provided	MR
18	<b>Refuge Area.</b>			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	<b>Fire Control Room</b>			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A


The fire protection systems provided in the building were test/checked at random and found satisfactory at the time of inspection.


Note:- The total covered area of restaurant as per MHA CAF portal is 387 Sq mtr., so sitting capacity comes  $(387/1.8 = 215)$  215 persons.


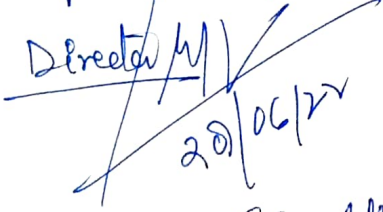
If agreed in view of the substantial compliance of the minimum standards on fire prevention and fire safety required under the Rules, it is recommended to grant fire safety certificate under Rule 35 of Delhi Fire Service Act- 2007 & Rules- 2010.





Accordingly, DFA is put up for approval & signature please.

  
 Signature of the Inspecting Officer  
 Name- Vedpal Chhikara  
 Divisional Officer (SW)

  
 Signature of the Inspecting Officer  
 Name- P.V. Rathee Divisional  
 Asstt. Div. Officer (S.Rd)

Dy. C.F.O. (S2)   
 27/6

G.F.O.   
 27/6/2022  
 Director   
 29/06/22

  
 DIRECTOR/DFS   
 29/06/22  
 FT letter is put up for sign   
 29/6/22  
 D.O(S.W)  
 uploaded   
 29/06/2022