

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No. F6/DFS/MS/EH/SZ/2022/ 201

Dated: 13/7/22

FIRE SAFETY CERTIFICATE

Certified that the M/s. Jubilant Foodworks Ltd. (Domino's Pizza), Shop. No. 1, Plot No.- 22B, Pusa Road, Bara Bazar, Rajender Nagar, New Delhi., running at Ground floor only of a building comprised of basement, stilt, ground plus three upper floors. owned/occupied by M/s. Jubilant Foodworks Limited. have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officers concerned of Delhi Fire Service on 01.07.2022 in presence of Sh. Danish Siddiqui (Manager) and the building/premises is fit for occupancy class Assembly (Restaurant) at Ground floor Only with effect from 13/7/22 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules 2010, printed below.

Issued on 13/7/22 at New Delhi by.

(Atul Gang)
Director
Delhi Fire Service.

Copy to:- Authorized Signatory, M/S Jubilant Foodworks Limited (Domino's Pizza), located at Ground floor, 22B, Old Rajender Nagar, Pusa Road, New Delhi- 110005, w.r.t. Online Application id 20220509909746 dated 10.05.2022

Conditions for the validity of Fire Safety Certificate: -

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non-functional of fire safety measures shall be at the risk & responsibility of the management.
3. The trained firefighting staffs should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. All the means of escapes /exits shall not be locked/bolted/blocked at any time for safe evacuation of the occupants in case of any emergency.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form "J" [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in

N-72

INSPECTION REPORT

1. Name & address of the building : M/s. Jubilant Foodworks Ltd. (Domino's Pizza), Shop. No. 1, Plot No.- 22B, Pusa Road, Bara Bazar, Rajender Nagar, New Delhi.
2. Type of Occupancy : Assembly (Restaurant)
3. Building Composition : The said restaurant is running at ground floor of a building comprised of basement, stilt, ground plus three upper floors.
4. Type of Case : New Case
5. Details of previous NOC : N/A
6. Fire Safety directives letter No : N/A
7. Date of inspection : 01.07.2022
8. Name of the Inspecting Officers : Vedpal Chhikara, DO (SW) & P.V. Rathee, ADO (SRD)
9. Name and designation of officers from the building side : Sh. Danish Siddiqui, Manager
9. Year of Construction : Before 2017
10. Applicant's letter No. : Online Application id 20220509909746 dated 10.05.2022

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement as per NBC/UBBL	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	06 mts	Provided	MR
	• Gate width	N/A	Directly Assessable	N/A
	• Width of internal road	N/A	N/A	N/A
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	-	-	-
	• Upper Floors	02 nos.	02 nos.	Restaurant running at GF only
	• Basements	N/A	N/A	Restaurant running at GF only
	b. Width of staircases	-	-	-
	• Upper Floors	1.5 mts each	3.40, 1.70 mts (iron made)(stilt to GF) & 1.40 mts (stilt to Terrace)	Restaurant running at GF only
	• Basements	N/A	N/A	Restaurant running at GF only
	c. Protection of exits			
	• Fire check door	-	-	-
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	N/A	N/A	N/A
	g. Width of Corridor	N/A	N/A	N/A
	h. Door Size	1.5 mts each	1.80 & 1.60 mts	MR
3	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	Smoke Management System.			
	• Basements	30 a/c per hour	N/A	N/A
	• Upper floors	12 a/c per hour	Exhaust fan provided	MR
5	Fire Extinguishers			
	• Total numbers	04	Provided	MR
	• Types	CO ₂ , ABC type	Provided	MR

B

Nr-4
N-13

	• IS marking	ISI marked	Provided	MR
6	First-Aid Hose Reels.		Provided 02 nos	MR
	• Total numbers on each floor	01	Provided	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7	Automatic fire detection and alarming system.			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	N/A	N/A
8	MOEFA	Required	Provided	MR
9	Public Address System.	N/A	N/A	N/A
10	Automatic Sprinkler System.			
	• Basement	N/A	N/A	N/A
	• Entire Restaurant	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	• Size of riser/down-comer	01	Provided	MR
	• Number of hydrants per floor	01	Provided	MR
	• Hose Box	01	Provided	MR
12	Yard Hydrants.			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13	Pumping Arrangements.			
	• Ground Level	---	---	---
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey Pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/ Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level	-----	-----	-----
	➤ Discharge of pump	450 LPM	Provided	MR
	➤ Head of the pump	40 mts	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	20000 lts	20,000 lts	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			

N/14


	<ul style="list-style-type: none"> Pressurization of Lift Shaft Pressurization of Lift lobby Communication In lift Car Fireman's Grounding Switch Lift Signage 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
17	Standby power supply	Required	Provided	MR
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	Required	Two ABC type fire extinguisher found provided near elect. panel	MR

The fire protection systems provided in the building were test/checked at random and found satisfactory at the time of inspection.

Note:- The total covered area of restaurant as per MHA CAF portal is 192.3 Sq mtr.. so sitting capacity comes $(192.3/1.8 = 107)$ 107 persons.

If agreed in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the Rules, it is recommended to grant fire safety certificate under Rule 35 of Delhi Fire Service Act- 2007 & Rules- 2010.

DFA is put up for approval & signature please

 4/7/22

Signature of the Inspecting Officer
Name- Vedpal Chhikara
Divisional Officer (SW)

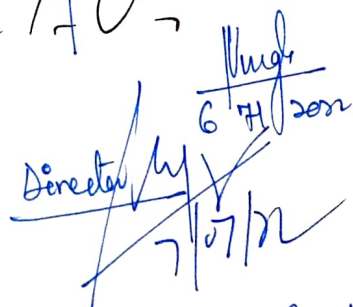
 4/7/22

Signature of the Inspecting Officer
Name- P.V. Rathee Divisional
Asstt. Div. Officer (S.Rd)

 (S2)


5/7

CFO


6/7/2022
7/7/22

