



FORM 'H'
FORM FOR ISSUING FIRE SAFETY CERTIFICATE
[Refer sub - rule (1) of rule 35]
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI


No. F6/DFS/MS/SZ/2022/ 316

Dated: 20/07/2022

FIRE SAFETY CERTIFICATE

Certified that the building of YWCA of Delhi Hostel building located at Sector 10, Dwarka New Delhi - 110075 owned / occupied by **Young Women's Christian Association of Delhi** comprised of , Basement, ground + four upper floors was issued FSC by this department vide Letter No. F6/DFS/MS/2017/South/172 Dated 08/02/2017. The premises was re inspected by the officers concerned of this department on 29/06/2022 in the presence of. Ms. Ruby Rajeev (Admin Manager) and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rule, 2010 and that the premises is fit for occupancy class "Residential Building" Group A-5 with effect from 20/07/2022 for a period of **five years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 20/07/2022 at New Delhi by.


(Anil Garg)
Director
Delhi Fire Service.

Copy to:

1. Ms. Ruby Rajeev (Admin Manager) YWCA of Delhi Hostel building located at Sector 10, Dwarka New Delhi - 110075.
2. The Joint Director (Building) DDA, Vikas Sadan, INA, Delhi-110023.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall be used as per building bye laws.
7. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry. www.dfs.delhigovt.nic.in.
8. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1. Name & address of the building: YWCA of Delhi Hostel Building located at Sector 10, Dwarka New Delhi-110075.
2. Type of Occupancy : Educational/ Hostel (Basement + Ground+ 4 U.F)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/2017/South/172 Dated 08/02/2017
5. Fire Safety directives Letter No. : F6/DFS/MS/BP/2010/3271 Dated 30/11/10
6. Date of inspection : 29/06/2022
7. Name of the Inspecting Officer : Uday vir singh, ADO (DWK)
8. Name and designation of Officer
from the building side : Ms. Ruby Rajeev (Admin Manager)
9. Year of Construction : 2016
10. Applicant's letter No. : Email Dated 23/06/2022

S No	Minimum standards on fire prevention and fire safety U/R 33	As per N/7	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	9 mtr	Provided	MR
	• Gate width	6 mtr	Provided	MR
	• Width of internal road	06 mtr	Provided	MR
	2. Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	3 Nos.	3 Nos.	MR
	• Basements	04 Nos. + 1 Ramp	Provided	MR
	b. Width of staircases			
	• Upper floors	1.5 m	Provided	MR
	• Basements	1.5 m&2m	Provided	MR
	c. Protection of exits			
	• Fire check door	Required	Provided in basement	MR
	• Pressurization	NA	NA	NA
	• No of continuous staircase to terrace	03 Nos.	Provided	MR
	e. Width Of Corridor	1.5m	Provided	MR
	f. Door Size	01mtr	Provided	MR
3.	Compartmentation			
	• Fire check door	Required	Provided in basement	MR
	• Sealing of electrical shafts	Required	Provided	MR
	• Fire Rating of shaft door	2 Hrs. rating	Provided	MR
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke managements System			
	• Basements	Required	Provided	MR
	• Upper floors	NA	NA	NA

(Signature)


5.	Fire Extinguishers			
	• Total numbers	22 nos.	Provided	MR
	• Types	ABC & CO ₂	Provided	MR
	• IS marking	ISI marked	ISI marked	MR
6.	First-Aid Hose Reels			
	• Total numbers on each floor	02 Nos.	Provided	MR
		30 m	Provided	MR
	• Length of hose reel hose	05 mm	Provided	MR
	• Nozzle diameter			
7.	Automatic fire detection and alarming system			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10	Automatic Sprinkler System			
	• Basements	Required	Provided	MR
	• Upper Floor	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11	Internal Hydrants:			
	• Size of riser/down- comer	100 mm	Provided	MR
	• Number of hydrants per floor	06 Nos.	Provided	MR
	• Hose Box	Required	Provided	MR
12	Yard Hydrants			
	• Total number of hydrants	4	Provided	MR
	• Hose Box	4	Provided	MR
13	Pumping Arrangements:			
	• Ground Level	NA	NA	NA
	• Discharge of main pump	NA	NA	NA
	➤ Head of main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto starting/Manual stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level			
	➤ Discharge of pump	900 lpm	Provided	MR
	➤ Head of the pump	40 mtr	Provided	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR
14	Captive water Storage for fire fighting:			
	• Under ground tank capacity	NA	NA	NA
	➤ Draw off connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	25000 ltrs	Provided	MR
15	Exit Signage	Required	Provided	MR


16


16	Provision of Lifts	NA	NA	NA
	➤ Pressurization of Lift Shaft	Required	Provided	MR
	➤ Pressurization of lift lobby	Required	Provided	MR
	➤ Communication in lift Car	Required	Provided	MR
	➤ Fireman's Grounding Switch	Required	Provided	MR
	➤ Lift Signage	Required	DG set	MR
17	Standby power supply			
18	Refuge Area	NA	NA	NA
	➤ Total area	NA	NA	NA
	➤ Location			
19	Fire control room	NA	NA	NA
	➤ Detector system panel	Required	Provided	MR
	➤ Flow Switch Panel	Required	Provided	MR
	➤ PA System Panel	Required	Provided	MR
	➤ Battery backup	Required	Provided	MR
	➤ Building Floor Plans	Required	Provided	MR
20	Special Fire Protection Systems for Protection of special Risks, if any;	Required	ABC, Fire extinguisher provided near electric panel	MR

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rules the NOC issued vide letter F6/DFS/MS/2017/South/172 Dated 08/02/2017 renewal under Rule 37 of the Delhi Fire Service Rules 2010 is recommended.



 Signature of the Inspecting Officer
 Name Udai Vir Singh
 Designation ADO/DWK

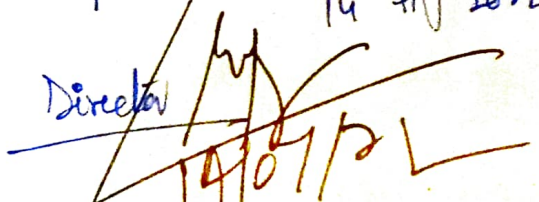

 12/7/22


 12/7/22


 13/7




 14/7/2022


 Director
 14/07/22