

C.31

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110001

No F 6 / DFS / MS / 2022 / School / WZ / 776


Dated: 22/7/22

FIRE SAFETY CERTIFICATE

Certified that **Bhagat International School** located at **Kh. No. 26/8, Md. Pur Majri (Rama Vihar), Delhi-110081** running on Ground+ first floor only in a building comprising Ground and two upper floors owned/occupied by **Bhagat International School** was issued FSC by this department vide letter No **F-6/DFS/MS/2018/School/63** dated 09.01.2018. The building was inspected by the officer concerned of this department on 08.07.2022 in the presence of Smt. Kavita (Principal), and observed that all the fire prevention and fire safety arrangements as provided in the building found in good working condition. The premises have deemed complied with the requirements under DOE circular No. 3298-3398 dated 01.03.2011 and the building/ premise is fit for occupancy **Group B Educational (For Ground+First floor only)** with effect from ...22/7/22... for a period of **three years** and subject to compliance of the conditions mentioned below.

Issued on22/7/22... at New Delhi

Yours faithfully


(Dharampal Bhardwaj)
Dy. Chief Fire Officer
WEST ZONE

Copy to : -

1. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, Delhi-54.
2. Principal, Bhagat International School, Kh. No. 26/8, Md. Pur Majri (Rama Vihar), Delhi-81.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. The second floor should not be used for school activity.
6. This certificate cannot be treated in any case for regularizations of unauthorized construction.
7. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
8. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on WWW.dfs.Delhigovt.nic.in

INSPECTION REPORT

1. Name & address of the building : Bhagat International School located at Kh. No. 268, Md. Pur Majri (Rama Vihar), Delhi-81.
2. Type of Occupancy : Educational
3. Building Comprised : (Gr.+ Two Upper Floors)
4. Type of Case : Renewal (Gr.+ First floor only)
5. Details of Previous NOC : F6/DFS/MS/2018/School/63 dated- 09/01/2018
6. Fire Safety directives letter No : DOE Circular dated 01/03/2011.
7. Date of inspection : 08/07/2022
8. Name of Inspecting Officer : ADO, R.K.Sinha
9. Name and designation of officers
From the building side : Smt. Kavita (Principal)
10. Year of Construction : 2006 & 2011
11. Applicant's letter No. : E mail id , Dated-01/07/2022

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	DOE Circular Requirement	Provided at site	Remarks MR/NMR
1.	Access to building			
	• Road width	6.0 m	6.0 m	MR
	• Gate width	4.5 m	4.5 m	MR
	• Width of internal road	NA	NA	NA
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	02	03	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floor	1.50 m each	1.70 m, 1.50 m & 1.20 m	MR
	• Basements			
	c. Protection of exits			
		NA	NA	NA
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
		NA	NA	NA
	d. No. of continuous staircases to terrace	NA	NA	NA
	e. Width of Corridor	Required	Provided	MR
		NA	NA	NA
	f. Door Size			
		1.00 m	1 m	MR
3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke Management System			
	• Basements	30 a/c per hour	NA	NA

R

	<ul style="list-style-type: none"> Upper floors 	12 a/c per hour	Natural Ventilated	MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers 	09	11	MR
	<ul style="list-style-type: none"> Types 	ABC/Co2	ABC/Co2	MR
	<ul style="list-style-type: none"> IS marking 	Yes	Yes	MR
6.	First-Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor 	NA	NA	NA
	<ul style="list-style-type: none"> Length of hose reel hose 	NA	NA	NA
	<ul style="list-style-type: none"> Nozzle diameter 	NA	NA	NA
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detectors 	NA	NA	NA
	<ul style="list-style-type: none"> Location of Main Panel 	NA	NA	NA
	<ul style="list-style-type: none"> Location of Repeater Panel 	NA	NA	NA
	<ul style="list-style-type: none"> Alternate source of power 	NA	NA	NA
	<ul style="list-style-type: none"> Hooters' Location 	NA	NA	NA
8.	MOEFA	NA	NA	NA
9.	Public Address System	NA	NA	NA
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement 	NA	NA	NA
	<ul style="list-style-type: none"> Ground Floor 	NA	NA	NA
	<ul style="list-style-type: none"> Sprinkler above false ceiling 	NA	NA	NA
11.	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer 	NA	NA	NA
	<ul style="list-style-type: none"> Number of hydrants per floor 	NA	NA	NA
	<ul style="list-style-type: none"> Hose Box 	NA	NA	NA
12.	Yard Hydrants			
	<ul style="list-style-type: none"> Total number of hydrants 	NA	NA	NA
	<ul style="list-style-type: none"> Hose Box 	NA	NA	NA
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> Ground Level 			
	<ul style="list-style-type: none"> ➤ Discharge of main Pump 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Head of Main pump 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Number of main pumps 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Jockey Pump out put 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Jockey pump head 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Standby Pump out put 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Standby Pump Head 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Auto Starting/Manual Stopping 	NA	NA	NA
		NA	NA	NA

14

MR

	<ul style="list-style-type: none"> ➤ Pump House Access 	NA	NA	NA
	<ul style="list-style-type: none"> • Terrace level 	-	-	-
	<ul style="list-style-type: none"> ➤ Discharge of pump 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Head of the pump 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Power Supply 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Auto Starting of pump 	NA	NA	NA
14.	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> • Underground tank capacity 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Draw-off connection 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Fire service inlet 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Access to tank 	NA	NA	NA
	<ul style="list-style-type: none"> • Overhead Tank capacity 	NA	NA	NA
15.	Exit Signage.			
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> • Pressurization of Lift Shaft 	NA	NA	NA
	<ul style="list-style-type: none"> • Pressurization of Lift lobby 	NA	NA	NA
	<ul style="list-style-type: none"> • Communication In lift Car 	NA	NA	NA
	<ul style="list-style-type: none"> • Fireman's Grounding Switch 	NA	NA	NA
	<ul style="list-style-type: none"> • Lift Signage 	NA	NA	NA
17.	Standby power supply			
18.	Refuge Area.			
	<ul style="list-style-type: none"> ➤ Total Area 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Location 	NA	NA	NA
19.	Fire Control Room			
	<ul style="list-style-type: none"> • Detector System Panel 	NA	NA	NA
	<ul style="list-style-type: none"> • Flow Switch Panel 	NA	NA	NA
	<ul style="list-style-type: none"> • PA System Panel 	NA	NA	NA
	<ul style="list-style-type: none"> • Battery backup 	NA	NA	NA
	<ul style="list-style-type: none"> • Building Floor Plans 	NA	NA	NA
20.	Special Fire Protection System for Protection of special Risks, if any:	NA	NA	NA

[Handwritten signature]

N/18

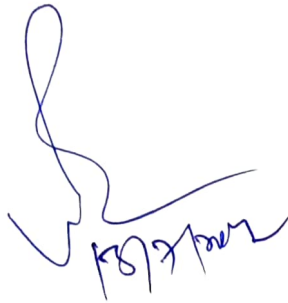
--	--	--	--	--

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures required under DOE circular dated 01/03/2011, it is recommended to renew the Fire Safety Certificate issued vide letter no. F6/DFS/MS/2018/School/63 for Ground and First floor only.

~~DO (MS)~~ On 11/11

~~DO (MS)~~



18/7/2018

~~ADO/BW~~ F-T letter is put up for signi plan

~~DO (MS)~~


19/7/2018


MS/ cell


ADO (B.W.)
12/7/2018

Signature of Inspecting Officer

Name : Rajeev Kumar Sinha

Designation : ADO/B.W.


ADO (B.W.)
14/7/2018