



c-38



**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI**

No. F6/DFS/MS/School/WZ/2022 / 814

Dated: 29/07/2022

FIRE SAFETY CERTIFICATE

Certified that the **Shri Hanuman Sanskrit Mahavidyalaya**, Located at **F-487/3, Raghubir Nagar, New Delhi-110027**, comprised of Ground + 02 Upper Floors only was issued FSC vide letter No. F6/DFS/MS/WZ/2019/838 dated 16/04/2019. The premises was re-inspected by the officer concerned of this department on 19/07/2022 in the presence of Sh. Sunil kumar Chaudhary (Officiating HOS) found that all the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have therefore deemed complied with the fire prevention & fire safety requirements in accordance DOE Circular No. F16/Estate/CC/Fire safety/2011/3298 to 3398 dated 01/03/2011 that the building/premises is fit for the occupancy class **"Educational" Group B** with effect from 29/07/2022 for a period of three years subject to the Condition mentioned below.

Issued on 29/7/2022 at New Delhi.

(Dharampal Bhardwaj)
Dy. Chief Fire Officer
West Zone

Copy to:

1. The Principal, Shri Hanuman Sanskrit Maha Vidyalaya, Located at F-487/3, Raghubir Nagar, New Delhi-110027.
2. Director of Education, GNCT of NCT of Delhi, Old Secretariat.

Following fire safety directives must be adhered to:-


1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1. Name & address of the building : Shri Hanuman Sanskrit Maha Vidyalaya, Located at F-487/3, Raghubir Nagar, New Delhi-110027.
2. Type of Occupancy : Educational (Ground + 02 Upper Floor)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/WZ/2019/838 dated 16/04/2019
5. Fire Safety directives letter No : 3298-3398 dated 01/03/2011
6. Date of inspection : 19/07/2022
7. Name of the Inspecting Officers : Sarabjeet Singh, ADO (MN)
8. Name and designation of officers from the building side : Sh. Sunil kumar Chaudhary (Officiating HOS)
9. Year of Construction : 1998 (As per previous insp. report dtd.- 06/04/2019)
10. Applicant's letter No. : Letter No. S.H.S.M.V/22/52 dated 01/07/2022

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	As Per DOE 3298-3398 dated 01/03/2011	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	Accessible	Provided	MR
	• Gate width	Accessible	3m Provided	MR(Old case)
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	02	Provided	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floors	1.5m	105cms, 110cms Provided	MR (old case)
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	e. No. of continuous staircases to terrace	01	Provided	MR
	f. Width of Corridor	1.5m	Provided	MR
	g. Door Size	1 m	Provided	MR(Old case)
3	Compartmentation.			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4	Smoke Management System.			
	• Basements	NA	NA	NA
	• Upper floors	NA	NA	NA
5	Fire Extinguishers			
	• Total numbers	10 nos.	Provided	MR
	• Types	CO ₂ , ABC type	Provided	MR
	• IS marking	ISI marked	Provided	MR
6	First-Aid Hose Reels.			
	• Total numbers on each floor	01	Provided	MR
	• Length of hose reel hose	30m	Provided	MR
	• Nozzle diameter	5mm	Provided	MR

2/20

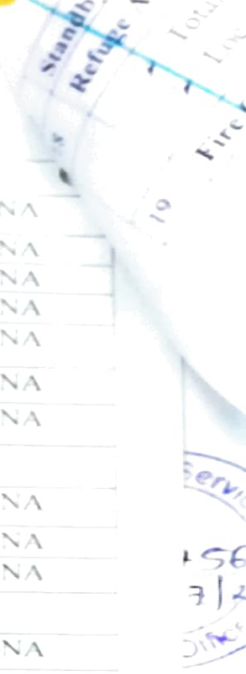

Automatic fire detection and alarming system.				
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8	MOEFA	NA	NA	NA
9	Public Address System.	NA	NA	NA
10 Automatic Sprinkler System.				
	• Basement	NA	NA	NA
	• Upper Floor	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11 Internal Hydrants				
	• Size of riser/down-comer	NA	NA	NA
	• Number of hydrants per floor	NA	NA	NA
	• Hose Box	NA	NA	NA
12 Yard Hydrants.				
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13 Pumping Arrangements.				
	• Ground Level			
	➤ Discharge of main Pump	NA	NA	NA
	➤ Head of Main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey Pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Starting/ Manual stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level			
	➤ Discharge of pump	450 lpm	Provided	MR
	➤ Head of the pump	40 m	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14 Captive Water Storage for fire fighting.				
	• Underground tank capacity	NA	NA	NA
	➤ Draw-off connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	10,000 Ltrs	Provided	MR
15	Exit Signage.	Required	Provided	MR
16 Provision of Lifts.				
	• Pressurization of Lift Shaft	NA	NA	NA
	• Pressurization of Lift lobby	NA	NA	NA
	• Communication In lift Car	NA	NA	NA
	• Fireman's Grounding Switch	NA	NA	NA
	• Lift Signage	NA	NA	NA

Service
456
3/2
DIN



17	Standby power supply	NA	NA	NA
18	Refuge Area.			
	• Total Area	NA	NA	NA
	• Location	NA	NA	NA
19	Fire Control Room			
	• Detector System Panel	NA	NA	NA
	• Flow Switch Panel	NA	NA	NA
	• PA System Panel	NA	NA	NA
	• Batter backup	NA	NA	NA
	• Building Floor Plans	NA	NA	NA
20	Special Fire Protection Systems for Protection of special Risks, if any:	NA	NA	NA

The fire protection systems provided in the building were test checked and found functional at the time of inspection. The shortcomings issued by this department vide letter no F6/DFS/MS/School/WZ/2022/131 dated 23/03/2022 & F6/DFS/MS/School/WZ/2022/317 dated 16/06/2022 have been complied.

In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rules the NOC issued vide letter no. F6/DFS/MS/School/2018/WZ/2365 dated 18/10/2018 renewal under DOE Circular no. F16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01/03/2011 issued by Directorate of Education, Govt. OF NCT of Delhi, is recommended

~~D.O (west)~~

~~Signature~~
20/7/2022

Signature of the Inspecting Officer
Name: - Sarabjeet Singh
Designation: - ADO (MN)

231/ADO/MN
20/7/2022
D.O (WEST) 595
DATED 20/7/2022

~~D.O (WZ)~~
20/7/2022

msj/ell

~~ADO (MN)~~

Sir, F T is put up for your personal & signature please!

~~Dy (PO/WZ)~~
29/7/2022

~~Signature~~
25/7/2022

msj/ell