

C-28

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110001

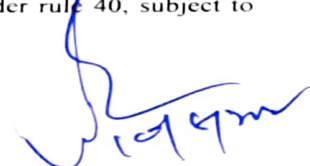
No. F6/DFS/MS/2022 /School/ 875

Dated: 10/08/2022

FIRE SAFETY CERTIFICATE

Certified that the **Savita Public School** located at **Opp. Gali No.03, Main Road, Wazirabad Village, Delhi-110084** comprised of **Ground plus 01 & Half floors only** owned/ occupied by **Savita Public School** was issued Fire Safety Certificated vide this office letter no. **F-6/DFS/MS/2017/School/WZ/139** dated **03.02.2017**. The premise was re-inspected by the officer concerned of this department on **29.07.2022** in the presence of **Sh. Varun Tyagi** and observed that all the fire prevention and fire safety arrangements as provided in the premise found in good working condition. The premise have therefore deemed complied with the requirements under rule 33 of the Delhi Fire Service Rules, 2010 and the building premise is fit for occupancy under **Educational "Group B"** with effect from **10/08/2022** for a period of **three years** in accordance with the rule 36 unless renewed under rule 37 or sooner cancelled under rule 40, subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on **10/08/2022** at New Delhi


(Dharampall Bhardwaj)
Dy. Chief Fire Officer
Ph.-011-23414250

Copy to: -

1. The Director, Education, Government of N.C.T of Delhi, Old Sectt. Delhi - 110054.
2. The Principal, Savita Public School located at Opp. Gali No. 3, Main Road, Wazirabad Village, Delhi-110084.

Conditions for the validity of Fire Safety Certificate:

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection.
3. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
4. All the staff members must know the correct method of operation of firefighting system.
5. The owner / occupier shall submit a declaration **every year** in **Form "K"** provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on <http://delhi.gov.in/wps/wcm/connect/doi/fire/FIRE/Home/Forms>.
6. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
7. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in **Form 'J'** [sub rule (1) of rule 37] along with a copy of this Certificate, **six months** prior to its expiry".

N/19

INSPECTION REPORT

N/A	N/A	1. Name & address of the building	Savita Public School at Opp. Gali No. 3, Main Road, Wazirabad Village, Delhi-110084
N/A	N/A	2. Type of Occupancy	: Educational
N/A	N/A	3. Composition of building	: Ground + 01 & Half floor only
N/A	N/A	4. Type of Case	: Renewal
		5. Details of previous NOC	: F6/D.F.S/MS/2017/School/WZ/139 Dated 03.02.2017
		6. Fire Safety directives letter No.	: Director of Education Letter dated 01.03.2011/ NBC Part 4
		7. Date of inspection	: 29.07.2022
		8. Name of the Inspecting Officers	: ADO (RN)
		9. Name and designation of officers from the building side	: Sh. Varun Tyagi
		10. Year of Construction	: 2000
		11. Applicant's letter No.	: S.P.S/D.F.S/07-2022 dated: 25.07.2022

Plot Area-2000sq m Covered area --750sq m No of student 450 nos, No of class room --20nos

	Minimum Standards on fire prevention and fire safety U/R 33	Director of Education dated 01.03.2011 & NBC Requirement	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	6m	6m	MR
	• Gate width	4.5m	3.86m	MR(old case)
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	02	03	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floors	1.50 m	1.27m, 92cm & 1.37m	MR(Old case)
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No. of continuous staircases to terrace	01	02	MR
	e. Width of Corridor	Required	90cm	MR
	f. Door Size	1.0m	95cm	MR(Old case)
3	Compartmentation.			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4	Smoke Management System.			
	• Basements	30 a/c per hour	No basement	NA
	• Upper floors	12 a/c per hour	Natural Ventilated	MR

5	Fire Extinguishers	06nos	07nos	MR
	• Total numbers	ABC/Co2	ABC-07	MR
	• Types	Yes	Yes	MR
	• ISI marking			
6	First-Aid Hose Reels.	01	01	MR
	• Total numbers on each floor			MR
	• Length of hose reel hose	30m	30m	MR
	• Nozzle diameter	5mm	5mm	
7	Automatic fire detection and alarming system			NA
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8	MOEFA	NA	NA	NA
9	Public Address System.	NA	NA	NA
10	Automatic Sprinkler System.			NA
	• Basement	NA	NA	NA
	• Upper Floor	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11	Internal Hydrants			NA
	• Size of riser/down-comer	NA	NA	NA
	• Number of hydrants per floor	NA	NA	NA
	• Hose Box	NA	NA	NA
12	Yard Hydrants.			NA
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13	Pumping Arrangements.			
	• Ground Level			
	➤ Discharge of main Pump	NA	NA	NA
	➤ Head of Main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey Pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Starting. Manual stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level			
	➤ Discharge of pump	450lpm	450 lpm	MR
	➤ Head of the pump	30m	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	NA	NA	NA

N/21

MR
MR
M

	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	5,000ltr	5,000ltr	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were test checked and found in working conditions at the time of inspection.

Keeping in view the satisfactory compliance of the minimum standards on fire prevention and fire safety required as stipulated in NBC art 4, the FSC issued vide letter of even no.139 dated: 03.02.2017 renewed under rule 37 of the Delhi Fire Service rules 2010 is recommended.

~~DO (NW)~~


~~4/8/2022~~

~~Dy. Insp. (W2)~~

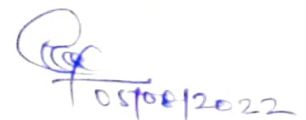
~~ADO/R-N~~



As approved, F.T. letter is put up for your signature pl.


03/08/2022

Signature of the Inspecting Officer
Name :- C.I. Meena
Designation :- ADO/RN


03/08/2022

cont. --- P.T.O