



490

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001



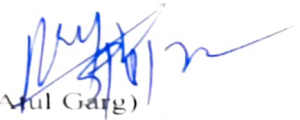
No. F6/DFS/MS/WZ/2022/BNQT/ 44

Dated: 08/08/2022

FIRE SAFETY CERTIFICATE

Certified that the **M/s. Augusthuc Banquet (A unit of Symphony Celebrations Pvt. Ltd.)** located at D-11, Udyog Nagar, New Delhi- 110041, comprised of Basement, Ground plus two upper floors, owned / occupied by **M/s Symphony Celebrators Pvt. Ltd.** with store in basement, Banquet halls on ground and first floor & restaurant on 2nd floor was granted fire safety certificate by this office vide letter No. F.6/DFS/MS/Banquets/2019/WZ/1122 dated 24.05.2019. The banquet hall was re-inspected by the officer concerned of this department on 04/07/2022 in the presence of Sh. Sanjay Gupta (Owner) and found that the management of banquet have closed the use of restaurant on 2nd floor and using as banquet hall & have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the building / premises is fit for occupancy class **Assembly (Group - D) (for Ground plus Two Floors only)** with effect from 08/8/2022 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of conditions, under rule 38 of the Delhi Fire Service Rules, 2010, printed overleaf.

Issued on 08/08/2022 at New Delhi.


(Anil Garg)
Director
9- 5/8

Copy to: -

1. Sh. Sanjay Gupta, M/s. Augusthuc Banquet, D-11, Udyog Nagar, New Delhi- 41.
2. The DHO, Rohini Zone, MCD, Sector- 05, Rohini, New Delhi. – Kindly make sure that temporary structure is not used in any circumstances.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided there in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. The basement shall be used strictly as per the provision of unified building bye laws.
6. This certificate cannot be treated in any case for regularizations of unauthorized construction.
7. "The owner / Occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
8. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.Delhigovt.nic.in.
9. This FSC is valid for ground plus two upper floors only. Temporary structure & Rooms shall always be remain sealed as seen during inspection. If it is opened/used in future, Fire Safety Certificate will be null & void.

INSPECTION REPORT

1. Name & address of the building: M/s. Augusthue Banquet (A unit of Symphony Celebrations Pvt. Ltd.) D-11, Udyog Nagar, New Delhi- 110041.
2. Type of Occupancy : Banquet (Assembly)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/2019/1122 Dated 24.05.2019 (with store in basement, Banquet halls on ground and first floor & restaurant on 2nd floor)
5. Fire Safety directives Letter No. : F6/DFS/MS/2000/1728 dated 25.09.2000
6. Date of inspection : 04.07.2022
7. Name of the Inspecting Officer : M. K. Chattopadhyay, DO(West), Aman Kumar Lathar, ADO (JWP)
8. Name and designation of Officer from the building side : Sh. Sanjay Gupta (Owner)
9. Year of Construction : 2002
10. Applicant's letter no. : Online application no. 2022042408162

The said banquet hall is running at ground, first & second floor in a building comprised of basement, ground plus two upper floors.

S No	Minimum standards on fire prevention and fire safety U/R 33	Requirements as per Clause 35 (VI) of DFS Act- 2007	Provided at site	Remarks MR/NMR
1.	Access of building			
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	06 m 05 m NA	Provided Provided NA	MR MR NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases <ul style="list-style-type: none"> Upper floors Basements b. Width of staircases <ul style="list-style-type: none"> Upper floors Basements c. Protection of exits <ul style="list-style-type: none"> Fire check door Pressurization d. No of continuous staircase to terrace	03 04 Old case Old case Required NA 01 1.5 mts Old case	Provided 06 1.82, 1.81 & 1.5 mts 1.82, 1.81, 1.72, 1.26, 1.25 & 0.72 mts Provided NA Provided Provided GF FF- 2.7, 2.4 & 1.26 mts, SF- 2.8, 2.0 mts	MR MR MR MR MR NA MR MR
3.	Compartmentation			
	<ul style="list-style-type: none"> Fire check door Sealing of electrical shafts Fire Rating of shaft door Water Curtain Fire Dampers 	Required Required NA NA NA	Provided Provided NA NA NA	MR MR NA NA NA
4.	Smoke managements System			
	<ul style="list-style-type: none"> Basements Upper floor 	Required Required	Provided Provided	MR MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types IS marking 	28 nos. ABC, CO ₂ & WCO ₂ ISI marked	Provided Provided Provided	MR MR MR

6.	First – Aid Hose Reels			
	• Total numbers on each floor	02	Provided	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detectors	Smoke & Heat	Provided	MR
	• Location of Main Panel	Ground Floor	Provided	MR
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	Required	Provided	MR
	• Hooters' Location	At each floor	Provided	MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10	Automatic Sprinkler System			
	• Basements	Required	Provided	MR
	• Upper Floor	Required	Provided	MR
	• Sprinkler above false ceiling	NA	NA	NA
11	Internal Hydrants			
	• Size of riser/down- comer	100 mm	Provided	MR
	• Number of hydrants per floor	2	Provided	MR
	• Hose Box	2	Provided	MR
12	Yard Hydrants			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13	Pumping Arrangements			
	• Ground Level			
	• Discharge of main pump	2280 lpm	Provided	MR
	➤ Head of main pump	40 m	Provided	MR
	➤ Number of main pumps	1	Provided	MR
	➤ Jockey pump out put	180 lpm	Provided	MR
	➤ Jockey pump head	40 m	Provided	MR
	➤ Standby Pump out put	2280 lpm	Provided	MR
	➤ Standby Pump Head	40 m	Provided	MR
	➤ Auto Staring/Manual stopping	Required	Provided	MR
	➤ Pump House Access	Required	Provided	MR
	• Terrace level			
	➤ Discharge of pump	900 lpm	Provided	MR
	➤ Head of the pump	40 m	Provided	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR
14	Captive water Storage for fire fighting			
	• Underground tank capacity	50,000 ltrs	Provided	MR
	➤ Draw of connection	Required	Provided	MR
	➤ Fire service inlet	Required	Provided	MR
	➤ Access to tank	Required	Provided	MR
	• Overhead Tank capacity	10,000 Ltrs	20,000 lts	MR
15	Exit Signage	Required	Provided	MR
16	Provision of Lifts			
	➤ Pressurization of Lift Shaft	NA	NA	NA
	➤ Pressurization of lift lobby	NA	NA	NA
	➤ Communication in lift Car	NA	NA	NA
	➤ Fireman's Grounding Switch	NA	NA	NA
	➤ Lift Signage	NA	NA	NA
17	Standby power supply	Required	Provided	NA
18	Refuge Area			MR
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA

N/36

19	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans	NA	NA	NA
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA

The fire protection systems provided in the building were checked and found functional at the time of inspection.

Note: All the shortcomings pointed out by this department in earlier inspection vide this office letter No. F.6/DFS/MS/WZ/2022/BNQT/92 dated 10.06.2022 have been complied with by the management. Previously this department has renewed Fire safety certificate for the above Banquet vide this department letter No. F.6/DFS/MS/2019/1122 Dated 24.05.2019 for store in basement, Banquet halls on ground and first floor & restaurant on 2nd floor. Now the management of banquet have closed the use of restaurant on 2nd floor and using as banquet hall.

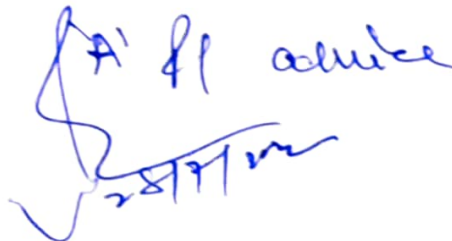
In view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F.6/DFS/MS/2019/1122 Dated 24.05.2019, renewal under rule 37 of the Delhi Fire Service rules 2010 is recommended.

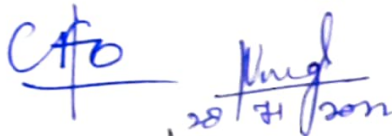
DFA is put up for approval & signature please.



M.K. Chattopadhyay
DO (West)


Aman Kumar Lathar
ADO (JWP)


DCF (WZ)



A. K. Acharya

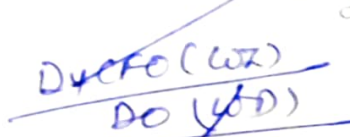

CTO


Director

1 - We can consider as mentioned at A, as both the occupancy are falling under assembly.

2 - Ask them to remove temporary store 2 rooms on terrace before the due date.


CPO


DCF (WZ)
DO (WZ)

29/7/22

