



438

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001**

No. F6/DFS/MS/2022/WZ/School/882

Dated: 11/8/2022

FIRE SAFETY CERTIFICATE

Certified that the **P. D. Model Sr. Sec. School** located at **88, Paschimi Friends Enclave, Sector-6, Sultan puri Road, Delhi-110086**, comprised of **Ground + 02 upper floors** has already been issued FSC by this department vide letter No. **F.6/DFS/MS/School/2018/133** dated **22.01.2018**. The premises was re-inspected by the officer concerned of this department on **01.08.2022** in the presence of **Sh. Ashu (Manager)** and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with DOE cir. dated 01.03.2011/NBC Part-IV Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy class **Educational (Group -B)** with effect from 11/8/2022 for a period of **three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subjected to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 11/8/2022 at New Delhi by


(Dhrampal Bhardwaj)
Dy.Chief Fire Officer
Tel;-01123414250

Copy to :-

1. The Director, Education, Government of N.C.T of Delhi. Old Sect. Delhi – 54.
2. The Principal, P. D. Model Sr. Sec. School located at 88, Paschimi Friends Enclave, Sector-6, Sultan puri Road, Delhi-110086_

Conditions for the validity of fire safety certificate:

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on
8. All the means of escape shall be kept free of any obstruction all the time to evacuate the occupant, in a safe manner, in the event of emergency.

http://www.delhi.gov.in/wps/wcm/connect/doiit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules
/ http://www.delhi.gov.in/wps/wcm/connect/doiit_fire/FIRE/Home/Forms

2/18

INSPECTION REPORT

1. Name & address of the building : P. D. Model Sr. Sec. School located at 88, Paschimi Friends Enclave, Sector-6, Sultan puri Road, Delhi-110086
2. Type of Occupancy : Educational
3. Type of Case : Renewal (Ground + 02 upper floor)
4. Details of Previous NOC : F.6/DFS/MS/School/2018/133 dated 22.01.2018.
5. Fire Safety directives letter No : NBC Part-IV/ DOE Circular dated 01.03.2011
6. Date of inspection : 01.08.2022
7. Name of Inspecting Officer : A.K.Sharma ADO(Rohini)
8. Name and designation of officers
From the building side : Sh. Ashu (Manager)
9. Year of Construction : 1994 & 2013
10. Applicant's letter No. : Online e-mail dated 04.07.2022.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	DOE Cir. dated 01.03.2011/NB C Part-IV	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	<ul style="list-style-type: none"> Accessible Accessible NA 	<ul style="list-style-type: none"> Accessible 4.5m NA 	<ul style="list-style-type: none"> MR MR NA
2.	Number, Width, Type & Arrangement of Exits			
Q	d. Number of staircases			
	<ul style="list-style-type: none"> • Upper Floors • Basements 	<ul style="list-style-type: none"> 02 NA 	<ul style="list-style-type: none"> 02 NA 	<ul style="list-style-type: none"> MR NA
	e. Width of staircases			
	<ul style="list-style-type: none"> • Upper Floor • Basements 	<ul style="list-style-type: none"> 1.5m NA 	<ul style="list-style-type: none"> 1.60m & 2 x 1.35m NA 	<ul style="list-style-type: none"> MR NA
	f. Protection of exits			
	Fire check door			
	<ul style="list-style-type: none"> • Pressurization 	<ul style="list-style-type: none"> NA NA 	<ul style="list-style-type: none"> NA NA 	<ul style="list-style-type: none"> NA NA
	d. No. of continuous staircases to terrace	01	01	MR
	e. Width of Corridor	1.50m	1.50m	MR
	f. Door Size	1.0m	1.0m	MR
3.	Compartmentation			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 	<ul style="list-style-type: none"> NA NA NA NA NA 	<ul style="list-style-type: none"> NA NA NA NA NA 	<ul style="list-style-type: none"> NA NA NA NA NA
4.	Smoke Management System			
	<ul style="list-style-type: none"> • Basements • Upper floors 	<ul style="list-style-type: none"> 30 a/c per hour 12 a/c per hour 	<ul style="list-style-type: none"> NA NA 	<ul style="list-style-type: none"> NA NA
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers • Types • IS marking 	<ul style="list-style-type: none"> 13nos. ABC/CO2 ISI marked 	<ul style="list-style-type: none"> 15nos. ABC/CO2 Yes 	<ul style="list-style-type: none"> MR MR MR
6.	First-Aid Hose Reels			
	<ul style="list-style-type: none"> • Total numbers on each floor • Length of hose reel hose • Nozzle diameter 	<ul style="list-style-type: none"> 02 30mm 5m 	<ul style="list-style-type: none"> Provided Provided Provided 	<ul style="list-style-type: none"> MR MR MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> • Type of detectors • Location of Main Panel 	<ul style="list-style-type: none"> NA NA 	<ul style="list-style-type: none"> NA NA 	<ul style="list-style-type: none"> NA NA

2/19

Spec
Prot
Account
four


	<ul style="list-style-type: none"> • Location of Repeater Panel • Alternate source of power • Hooters' Location 	NA	NA	NA
8.	MOEFA	NA	NA	NA
9.	Public Address System	NA	NA	NA
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> • Basement • Ground & Upper Floors • Sprinkler above false ceiling 	NA	NA	NA
11.	Internal Hydrants			
	<ul style="list-style-type: none"> • Size of riser/down-comer • Number of hydrants per floor • Hose Box 	NA	NA	NA
12.	Yard Hydrants			
	<ul style="list-style-type: none"> • Total number of hydrants • Hose Box 	NA	NA	NA
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> • Ground Level ➤ Discharge of main Pump ➤ Head of Main pump ➤ Number of main pumps ➤ Jockey Pump out put ➤ Jockey pump head ➤ Standby Pump out put ➤ Standby Pump Head ➤ Auto Starting/Manual Stopping ➤ Pump House Access 	NA	NA	NA
	<ul style="list-style-type: none"> • Terrace level ➤ Discharge of pump ➤ Head of the pump ➤ Power Supply ➤ Auto Starting of pump 	450lpm	450lpm	MR
		40m	40m	MR
		Required	Provided	MR
		Required	Provided	MR
14.	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> • Underground tank capacity ➤ Draw-off connection ➤ Fire service inlet ➤ Access to tank • Overhead Tank capacity 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		10,000ltr	10,000ltr	MR
		Required	Provided	MR
15.	Exit Signage.			
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication In lift Car • Fireman's Grounding Switch • Lift Signage 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
17.	Standby power supply	NA	NA	NA
18.	Refuge Area.			
	<ul style="list-style-type: none"> ➤ Total Area ➤ Location 	NA	NA	NA
		NA	NA	NA
19.	Fire Control Room			
	<ul style="list-style-type: none"> • Detector System Panel • Flow Switch Panel • PA System Panel • Battery backup 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA

N/20

• Building Floor Plans	NA	NA	NA
Special Fire Protection System for Protection of special Risks, if any:	NA	NA	NA


Accordingly, the fire protection systems provided in the building were tested/ checked randomly and found in working condition at the time of inspection.

Keeping in view the satisfactory compliance of the minimum standards on fire prevention and fire safety required as stipulated in DOE cir. dated 01.03.2022/NBC Part-4, and removal of shortcomings issued vide letter no. 203 dated 04.05.2022, the FSC issued vide letter no. F.6/DFS/MS/School/2018/133 dated 22.01.2018, renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended.



Signature of the Inspecting Officer
 Name Ajay Kumar Sharma
 Designation ADO(Rohini)


DO (NW)

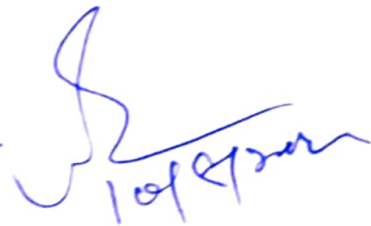

 03/02/2022

~~Dy CPO (w2)~~ 

~~ADO~~ / Rohini

FT letter is put up for kind perusal and
 signature please.


 05/08/22

~~Dy CPO (w2)~~ 

mes/ cell