



E-139

6

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

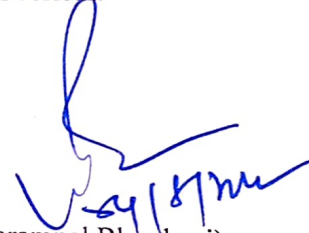
No. F6/DFS/MS/EH/WZ/2022/ 934

Dated: 24/8/2022

FIRE SAFETY CERTIFICATE

Certified that the M/s. Clue Boom Lounge & Bar (A unit of Westernised Food Matrix Pvt. Ltd) Located at 2nd & 3rd floor of property no 27, NWA club Road, West Punjabi Bagh, New Delhi-110026 in a building comprised of Basement + Ground + 3 upper floors was issued FSC vide letter no. F6/DFS/MS/2019/WZ/1627 dated 16/08/2019 (3rd floor) & F6/DFS/MS/2015/WZ/1252 dated 15/07/2015 (for 2nd & 3rd floor). The premises was re-inspected by the officer concerned of this department on 16-08-2022 in the presence of Sh. Ankur Bhatia found that the said building have deemed complied with fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire service Rules, 2010 & found that the said building is fit for occupancy class "Assembly" Group D with effect from 24/8/2022 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010 conditions mentioned Overleaf.

Issued on 24/8/2022 at New Delhi by.


(Dharampal Bhardwaj)
Dy. Chief Fire Officer
West Zone
etc

Copy to: -

1. The owner/ Occupier, M/S Clue Boom Lounge & Bar (A unit of Westernised Food Matrix Pvt. Ltd) Located at 27, 2nd & 3rd floor, NWA club Road, West Punjabi Bagh, New Delhi-110026.
2. The Dy. Health Officer, SDMC, West Zone, Vishal Enclave, Rajouri Garden, New Delhi - 110027.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall be used as per building bye laws.
7. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
8. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.

N/24

INSPECTION REPORT

1. Name & address of the building	M/S Clue Boom Lounge & Bar (A unit of Westernised Food Matrix Pvt. Ltd) Located at 27, 2 nd & 3 rd floor, NWA club Road, West Punjabi Bagh, New Delhi-110026.
2. Type of Occupancy	Assembly
3. Type of Case	Renewal
4. Details of previous NOC	F6/DFS/MS/2019/WZ/1627 dated 16/08/2019 (for 3 rd floor) F6/DFS/MS/2015/WZ/1252 dated 15/07/2015 (for 2 nd & 3 rd floor)
5. Fire Safety directives letter No	NIL
6. Date of inspection	16/08/2022
7. Name of the Inspecting Officers	Sarabjeet Singh, ADO (MN)
8. Name and designation of officers from the building side	Sh. Ankur Bhatia (Partner)
9. Year of Construction	2009 (As per Prev. Insp. report dated 26/07/2019)
10. Applicant's letter No.	Online Application ID No. 2022072615239 dated 26/07/2022

The said restaurant is running at 2nd & 3rd floor in a building comprised of Basement + Ground + 03 upper floors.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	BBL /NBC Requirement/ As per prev. Insp. Rep. dated.- 26/07/2019 & 23/06/2015	Provided at site	Remarks MR/NMR
1	Access to building			
	<ul style="list-style-type: none"> Road width 	9 m	Provided	MR
	<ul style="list-style-type: none"> Gate width 	NA	On Main Road	MR
	<ul style="list-style-type: none"> Width of internal road 	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> Upper Floors 	02	Provided	MR
	<ul style="list-style-type: none"> Basements 	NA	Provided	MR
	b. Width of staircases			
	<ul style="list-style-type: none"> Upper Floors 	1.5m & 1m	1.55m & 1.1m Provided (reduced to 90 cm at turning.)	MR(Old case)
	<ul style="list-style-type: none"> Basements 	NA	NA	NA
	c. Protection of exits			
	<ul style="list-style-type: none"> Fire check door 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Pressurization 	NA	NA	NA
	e. No. of continuous staircases to terrace	NA	NA	NA
	f. Width of Corridor	NA	NA	NA
	g. Door Size	2m & 1m	2 m,1.5 m(including door frame)	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> Fire check door 	NA	NA	NA
	<ul style="list-style-type: none"> Sealing of electrical shafts 	NA	NA	NA
	<ul style="list-style-type: none"> Fire Rating of shaft door 	NA	NA	NA
	<ul style="list-style-type: none"> Water Curtain 	NA	NA	NA
	<ul style="list-style-type: none"> Fire Dampers 	NA	NA	NA
4	Smoke Management System.			
	<ul style="list-style-type: none"> Basements 	NA	NA	NA
	<ul style="list-style-type: none"> Upper floors 	12 a/c per hour	Provided	MR

81

5	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types IS marking 	06 CO ₂ , ABC type ISI marked	Provided Provided Provided	MR MR MR
6	First-Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	02 30m 5mm	Provided Provided Provided	MR MR MR
7	Automatic fire detection and alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	Smoke & Heat Required Required Required Required	Provided Provided Provided Provided Provided	MR MR MR MR MR
8	MOEFA	Required	Provided	MR
9	Public Address System.	NR	NR	NR
10	Automatic Sprinkler System.			
	<ul style="list-style-type: none"> Basement Upper Floor Sprinkler above false ceiling 	NR NR NA	NR Provided NA	NR NR NA
11	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box 	100 mm 02 01	Provided Provided Provided	MR MR MR
12	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	NR NR	NR NR	NR NR
13	Pumping Arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/ Manual stopping Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 	2280 LPM 50 MH 01 180 LPM 50 MH 2280 LPM 50 MH Required Required 900 LPM 40 m Required Required	Provided Provided Provided Provided Provided Provided Provided Provided Provided Provided Provided Provided Provided	MR MR MR MR MR MR MR MR MR MR MR MR MR
14	Captive Water Storage for fire fighting.			
	<ul style="list-style-type: none"> Underground tank capacity Draw-off connection Fire service inlet Access to tank 	50,000 ltr N/A Required Required	Provided at terrace N/A Provided Provided	MR N/A MR MR


N/26

	Overhead Tank capacity	10,000 ltrs	Provided	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	• Pressurization of Lift Shaft	NR	NR	NR
	• Pressurization of Lift lobby	NR	NR	NR
	• Communication In lift Car	Required	Provided	MR
	• Fireman's Grounding Switch	Required	Provided	MR
	• Lift Signage	Required	Provided	MR
17	Standby power supply	Required	Provided	MR
18	Refuge Area.			
	➤ Total Area	NA	NA	NA
	➤ Location	NA	NA	NA
19	Fire Control Room			
	• Detector System Panel	NA	NA	NA
	• Flow Switch Panel	NA	NA	NA
	• PA System Panel	NA	NA	NA
	• Batter backup	NA	NA	NA
	• Building Floor Plans	NA	NA	NA
20	Special Fire Protection Systems for Protection of special Risks, if any:	NA	NA	NA

The fire protection systems provided in the building were test checked and found functional at the time of inspection.


In view of the deemed compliance of minimum standards on fire prevention and fire safety required under the rules the FSC issued vide letter no. F6/DFS/MS/2019/WZ/1627 dated 16/08/2019 & letter no. F6/DFS/MS/2019/WZ/1252 dated 15/07/2015 renewal under rule 35 of the Delhi Fire Service Rules 2010 is recommended.

~~Do (cust)~~


22/8/2022


Signature of the Inspecting Officer
Name: - Sarabjeet Singh
Designation: - ADO (MN)

639/DO/WP
Dt-23/8/2022


23/8/2022

DFS (WZ)

Kindly
May be seen before issue.


24/8/2022

~~Director~~

24/8/22


Jain