

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001**

No. F6/DFS/MS/2022/WZ/School/ 1111

Dated: 7/10/22

**FIRE SAFETY CERTIFICATE**

Certified that the **Decent Public School, H-Block, Sector-3, Rohini, Delhi-110085**, comprised of **Ground + 03 upper floors** has already been issued FSC by this department vide letter No. **F.6.DFS/MS/2019/1703 dated 29.08.2019**. The premises was re-inspected by the officer concerned of this department on **28.09.2022** in the presence of **Mr. Anubhav Gupta (Vice-Principal)** and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy class **Educational 'Group B'** with effect from 7/10/22 for a period of **three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subjected to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on ...7/10/22... at New Delhi by

  
**(Dhrampal Bhardwaj)**  
**Dy.Chief Fire Officer**  
**Tel;-01123414250**

Copy to :-

1. The Principal, Decent Public School, H-Block, Sector-3, Rohini, Delhi-110085.
2. The Director, Education, Government of N.C.T of Delhi. Old Sect. Delhi - 54.

**Conditions for the validity of fire safety certificate:**

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on
8. All the means of escape shall be kept free of any obstruction all the time to evacuate the occupant, in a safe manner, in the event of emergency.

[http://www.delhi.gov.in/wps/wcm/connect/doit\\_fire/FIRE/Home/Fire+Safety+Acts+and+Rules](http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules)  
/ [http://www.delhi.gov.in/wps/wcm/connect/doit\\_fire/FIRE/Home/Forms](http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms)

n/10

**INSPECTION REPORT**

1. Name & address of the building : Decent Public School, H-Block, Sector-3, Rohini, Delhi-110085.
2. Type of Occupancy : Educational
3. Type of Case : Renewal (**Ground + 03 upper floors**)
4. Details of Previous NOC : F.6.DFS/MS/2019/1703 dated 29.08.2019.
5. Fire Safety directives letter No : NBC Part-IV.
6. Date of inspection : 28.09.2022.
7. Name of Inspecting Officer : A.K.Sharma ADO(Rohini)
8. Name and designation of officer  
From the building side : Mr. Anubhav Gupta (Vice-Principal)
9. Year of Construction : 2003
10. Applicant's letter No. : Online e-mail dated 23.09.2022.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1.	<b>Access to building</b>			
	<ul style="list-style-type: none"> <li>• Road width</li> <li>• Gate width</li> <li>• Width of internal road</li> </ul>	<ul style="list-style-type: none"> <li>Accessible</li> <li>Accessible</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>Accessible</li> <li>4.5m</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> <li>NA</li> </ul>
2.	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	d. Number of staircases			
	<ul style="list-style-type: none"> <li>• Upper Floors</li> <li>• Basements</li> </ul>	<ul style="list-style-type: none"> <li>02</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>02</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>NA</li> </ul>
	e. Width of staircases			
	<ul style="list-style-type: none"> <li>• Upper Floor</li> <li>• Basements</li> </ul>	<ul style="list-style-type: none"> <li>1.5m</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>1.5m</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>NA</li> </ul>
	f. Protection of exits			
	Fire check door	NA	NA	NA
	<ul style="list-style-type: none"> <li>• Pressurization</li> </ul>	NA	NA	NA
	d. No. of continuous staircases to terrace	01	02	MR
	e. Width of Corridor	1.5m	Provided	MR
	f. Door Size	1.0m	1.0m	MR
3.	<b>Compartmentation</b>			
	<ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Sealing of electrical shafts</li> <li>• Fire Rating of shaft door</li> <li>• Water Curtain</li> <li>• Fire Dampers</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>
4.	<b>Smoke Management System</b>			
	<ul style="list-style-type: none"> <li>• Basements</li> <li>• Upper floors</li> </ul>	<ul style="list-style-type: none"> <li>30 a/c per hour</li> <li>12 a/c per hour</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>Natural ventilated</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>MR</li> </ul>
5.	<b>Fire Extinguishers</b>			
	<ul style="list-style-type: none"> <li>• Total numbers</li> <li>• Types</li> <li>• IS marking</li> </ul>	<ul style="list-style-type: none"> <li>17nos.</li> <li>ABC/CO2</li> <li>ISI marked</li> </ul>	<ul style="list-style-type: none"> <li>18nos.</li> <li>ABC-18</li> <li>Yes</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> <li>MR</li> </ul>
6.	<b>First-Aid Hose Reels</b>			
	<ul style="list-style-type: none"> <li>• Total numbers on each floor</li> <li>• Length of hose reel hose</li> <li>• Nozzle diameter</li> </ul>	<ul style="list-style-type: none"> <li>01</li> <li>30mm</li> <li>5m</li> </ul>	<ul style="list-style-type: none"> <li>Provided</li> <li>Provided</li> <li>Provided</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> <li>MR</li> </ul>
7.	<b>Automatic fire detection and alarming system</b>			
	<ul style="list-style-type: none"> <li>• Type of detectors</li> <li>• Location of Main Panel</li> <li>• Location of Repeater Panel</li> <li>• Alternate source of power</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>	<ul style="list-style-type: none"> <li>NA</li> <li>NA</li> <li>NA</li> <li>NA</li> </ul>

2/11

Special  
Protec  
Unit

	• Hooters' Location	NA	NA	NA
8.	<b>MOEFA</b>	NA	NA	NA
9.	<b>Public Address System</b>	NA	NA	NA
10.	<b>Automatic Sprinkler System</b>			
	• Basement	NA	NA	NA
	• Ground & Upper Floors	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11.	<b>Internal Hydrants</b>			
	• Size of riser/down-comer	100mm	100mm	MR
	• Number of hydrants per floor	01	01	MR
	• Hose Box	01	01	MR
12.	<b>Yard Hydrants</b>			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13.	<b>Pumping Arrangements</b>			
	• Ground Level			
	➤ Discharge of main Pump	950lpm	Provided	MR
	➤ Head of Main pump	40m	Provided	MR
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey Pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Starting/Manual Stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level			
	➤ Discharge of pump	450lpm	450lpm	MR
	➤ Head of the pump	40m	40m	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14.	<b>Captive Water Storage for fire fighting</b>			
	• Underground tank capacity	NA	NA	NA
	➤ Draw-off connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	10,000ltr	10,000ltr	MR
		Required	Provided	MR
15.	<b>Exit Signage.</b>			
16.	<b>Provision of Lifts.</b>			
	• Pressurization of Lift Shaft	NA	NA	NA
	• Pressurization of Lift lobby	NA	NA	NA
	• Communication In lift Car	NA	NA	NA
	• Fireman's Grounding Switch	NA	NA	NA
	• Lift Signage	NA	NA	NA
17.	<b>Standby power supply</b>	NA	NA	NA
18.	<b>Refuge Area.</b>			
	➤ Total Area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	<b>Fire Control Room</b>			
	• Detector System Panel	NA	NA	NA
	• Flow Switch Panel	NA	NA	NA
	• PA System Panel	NA	NA	NA
	• Battery backup	NA	NA	NA
	• Building Floor Plans	NA	NA	NA

N/12

**Special Fire Protection System for Protection of special Risks, if any:**

NA


NA

NA

Accordingly, the fire protection systems provided in the building were tested/ checked randomly and found in working condition at the time of inspection.

Keeping in view the satisfactory compliance of the minimum standards on fire prevention and fire safety required as stipulated in NBC Part-4, and removal of shortcomings issued vide letter no. 604 dated 22.09.2022, the FSC issued vide letter no. F.6.DFS/MS/2019/1703 dated 29.08.2019, renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

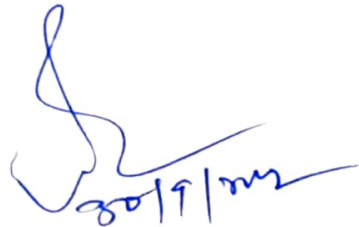
  
29/9/22

Signature of the Inspecting Officer  
Name Ajay Kumar Sharma  
Designation ADO(Rohini)

~~DO (NW)~~


  
29/09/2022

~~By Do (W3)~~

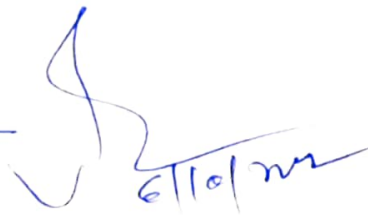
  
30/9/22

~~ADO (Rohini)~~

FT letter is put up for kind perusal and signature please.

  
8/10/22

~~DeFo (W2)~~

  
6/10/22

~~MS/ all~~