



G-29

70

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001

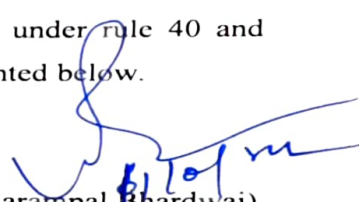
No. F6/DFS/MS/School/WZ/2022/ 1140

Dated: 12/10/2022

FIRE SAFETY CERTIFICATE

Certified that the **M. S. Memorial Public School** Located at **E-106, Saini Vihar, Laxmi Park, Nangloi, Delhi-110041**, comprised of Ground + 03 Upper Floor was issued Fire Safety Certificate by this department Vide Letter No. F6/DFS/MS/School/2016/WZ/1244 Dated 08.08.2016. The said premise was re-inspected by the officer concerned of this department on 20.09.2022 in the presence of Sh. Rajeev Saini (Owner) and found that the premises / building have deemed complied with the fire prevention and fire safety requirements in accordance with D.O.E Cr. No. 3298-3398 dated 01.03.2011/NBC (Part-IV) and that the premises/building is fit for occupancy class "Educational Building" Group B with effect from 12/10/2022 for a period of **three years** in accordance with rule 36 unless renewal under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the DFS rules, 2010., printed below.

Issued on 12/10/2022 at New Delhi by.


(Dharampal Bhardwaj)
Dy. Chief Fire Officer
(West Zone)

Copy to: -

1. The Director, Directorate of Education, GNCT of Delhi, Old Secretariat Delhi – 110054.
2. The Principal, M. S. Memorial Public School, E-106, Saini Vihar, Laxmi Park, Nangloi, Delhi-110041

Following fire safety directives must be adhered to:-

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional if fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupation, electric installation etc. may be got verified from the concerned authorities.
5. The Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction / unauthorized use of land if any.
6. All comments / directions of licensing Department shall always be permitted and followed.
7. The owner /occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in
8. The owner / occupier shall apply for renewal of this Fire Safety Certificate to the Director in 'Form J' (sub Rule (1) of Rule 37) along with copy of the certificate, six months prior to its expiry.
9. Ms. Shilpa Saini, Manager of M. S. Memorial Public School have submitted an undertaking alongwith photograph that one room on terrace floor is sealed by brick wall & the same will not be opened in future. If it is opened, FSC will be null & void.

INSPECTION REPORT

1. Name & address of the building : **M. S. Memorial Public School, Located at E-106, Saini Vihar, Laxmi Park, Nangloi, New Delhi-110041.**
2. Type of Occupancy : Educational (G + 03 Upper Floor only)
3. Type of Case : Renewal
4. Details of previous NOC : F-6/DFS/MS/School/2016/WZ/1244 dated 08.08.2016
5. Fire Safety directives Letter No : NBC Part-IV
6. Date of inspection : 20.09.2022
7. Name of the Inspecting Officer : Aman Kumar Lathar, ADO (JWP)
8. Name and designation of Officer
from the building side : Sh. Rajeev Saini (Owner)
9. Year of Construction : 2006 & 2013-14
10. Applicant's letter No. : email dated 02.09.2022

S No	Minimum standards on fire prevention and fire safety U/R 33	NBC Requirement /as per FSC dated 08.08.2016	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	Accessible	Provided	MR
	• Gate width	Accessible	Provided	MR
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	01	03	MR(Old Case)
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper floors	1.5 m	1.6 m, 1.2 m & 1.10 m	MR(Old Case)
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	01	Provided	MR
	e. Width Of Corridor	1.5mtr	Provided	MR
	f. Door Size	1mtr	Provided	MR
3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke managements System			
	• Basements	NA	NA	NA
	• Upper floors	NA	NA	NA
5.	Fire Extinguishers			
	• Total numbers	09 nos.	12 nos.	MR
	• Types	ABC & CO ₂	Provided	MR
	• IS marking	ISI marked	Provided	MR

6	First Aid Hose Reels				
	• Total numbers on each floor	01	Provided		MR
	• Length of hose reel hose	30m	Provided		MR
	• Nozzle diameter	5mm	Provided		MR
7	Automatic fire detection and alarming system				
	• Type of detectors	NA	NA		NA
	• Location of Main Panel	NA	NA		NA
	• Location of Repeater Panel	NA	NA		NA
	• Alternate source of power	NA	NA		NA
	• Hooters' Location	NA	NA		NA
8	MOI FA	NA	NA		NA
9	Public Address System	NA	NA		NA
10	Automatic Sprinkler System				
	• Basements	NA	NA		NA
	• Upper floor	NA	NA		NA
	• Sprinkler above false ceiling	NA	NA		NA
11	Internal Hydrants:				
	• Size of riser/down-comer	NA	NA		NA
	• Number of hydrants per floor	NA	NA		NA
	• Hose Box	NA	NA		NA
12	Yard Hydrants				
	• Total number of hydrants	NA	NA		NA
	• Hose Box	NA	NA		NA
13	Pumping Arrangements:				
	• Ground Level	NA	NA		NA
	• Discharge of main pump	NA	NA		NA
	➤ Head of main pump	NA	NA		NA
	➤ Number of main pumps	NA	NA		NA
	➤ Jockey pump out put	NA	NA		NA
	➤ Jockey pump head	NA	NA		NA
	➤ Standby Pump out put	NA	NA		NA
	➤ Standby Pump Head	NA	NA		NA
	➤ Auto Starting/Manual stopping	NA	NA		NA
	➤ Pump House Access	NA	NA		NA
	• Terrace level				
	➤ Discharge of pump	450 lpm	Provided		MR
	➤ Head of the pump	40Mtr	Provided		MR
	➤ Power supply	Required	Provided		MR
	➤ Auto starting of pump	Required	Provided		MR
14	Captive water Storage for fire fighting:				
	• Under ground tank capacity	NA	NA		NA
	➤ Draw off connection	NA	NA		NA
	➤ Fire service inlet	NA	NA		NA
	➤ Access to tank	NA	NA		NA
	• Overhead Tank capacity	10,000 ltrs.	Provided		MR
15	Exit Signage	Required	Provided		MR
16	Provision of Lifts				
	➤ Pressurization of Lift Shaft	NA	NA		NA
	➤ Pressurization of lift lobby	NA	NA		NA
	➤ Communication in lift Car	NA	NA		NA
	➤ Fireman's Grounding Switch	NA	NA		NA
	➤ Lift Signage	NA	NA		NA
17	Standby power supply	NA	NA		NA
18	Refuge Area				
	➤ Total area	NA	NA		NA
	➤ Location	NA	NA		NA
19	Fire control room				
	➤ Detector system panel	NA	NA		NA
	➤ Flow Switch Panel	NA	NA		NA
	➤ PA System Panel	NA	NA		NA
	➤ Battery backup	NA	NA		NA

N/A

N/A
N/A

N/A
N/A

N/A
N/A

20. Building Floor Plans
Special Fire Protection Systems for
Protection of special Risks, if any:

The fire protection systems provided in the building were checked and found functional at the time of inspection. The shortcoming issued vide letter no. F6/DFS/MS/School/WZ/2022/202 dated 04.05.2022 are rectified.

Note:-One room constructed on terrace floor has been sealed by the school management & photo of the same enclosed.

In view of the deemed compliance of the minimum standards on fire prevention and fire safety requirements under the rules, renewal of Fire safety Certificate is recommended under rule 37 of the Delhi Fire service Rules 2010 under the DFS Act 2007.

Accordingly DFA is prepared put up for approval please.

[Signature]
26/09/22

Aman Kumar Lathar
ADO (JWP)

~~DDW~~

~~[Signature]~~
28/9

~~DFS (w2)~~

~~[Signature]~~
29/9/22

~~MS/MS~~

F.F. letter is put-up for signature M.

~~DFS (w2)~~

~~[Signature]~~
10/10/22

[Signature]
30/09/22
ADO (JWP)

~~MS/MS~~

D.O. WEST/.../39
DATE: 2.09/2022