



C-6

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No. F6/DFS/MS/School/WZ/2022/ 1190

Dated: 25/10/2022

FIRE SAFETY CERTIFICATE

Certified that the **Vikram Public School, F-279, Agar Nagar, Prem Nagar-III, Kirari, Delhi-110086**, comprised of building Ground + 02 upper floors school is running in **Ground + 01 upper floor & 2nd floor** use for residential purpose owned/ occupied by **Vikram Public School** have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officer concerned of fire service on dated **07.10.2022** in the presence of **Mr. Jagminder Singh (Owner)** and that the building/ premise is fit for occupancy "**Group B Educational**" with effect from 25/10/2022 for a period of **three years**, in accordance with the rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 25/10/2022 at New Delhi by


(Atul Garg)
DIRECTOR
Ph; 011-23414000

Copy to:

1. The Principal Vikram Public School, F-279, Agar Nagar, Prem Nagar-III, Kirari, Delhi-110086.
 2. The Director of Education, GNCT of Delhi Old Secretariat, Delhi-110054
- Conditions for validity of Fire Safety Certificate;**

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on
8. All the means of escape shall be kept free of any obstruction all the time to evacuate the occupant, in a safe manner, in the event of emergency.

http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/
http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms

INSPECTION REPORT

1. Name & address of the building : Vikram Public School, F-279, Agar Nagar, Prem Nagar-III, Kirari, Delhi-110086.
2. Type of Occupancy : Educational
3. Type of Case : New Case (Ground + 02 upper floors, school running is Gr.+01 upper floor, 2nd floor use for residential purpose)
4. Details of Previous NOC : NA
5. Fire Safety directives letter No : NBC Part-IV
6. Date of inspection : 07.10.2022
7. Name of Inspecting Officer : A.K.Sharma ADO(Rohini)
8. Name and designation of officers
From the building side : Mr. Jagminder Singh (Owner)
9. Year of Construction : 2006
10. Applicant's letter No. : Online e-mail dated 21.07.2022.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none"> Road width 	6.0m	6.0m	MR
	<ul style="list-style-type: none"> Gate width 	4.5m	4.5m	MR
	<ul style="list-style-type: none"> Width of internal road 	NA	NA	NA
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> Upper Floors 	02	02	MR
	<ul style="list-style-type: none"> Basements 	NA	NA	NA
	b. Width of staircases			
	<ul style="list-style-type: none"> Upper Floor 	1.5m	1.5m & 1.80m	MR
	<ul style="list-style-type: none"> Basements 	NA	NA	NA
	c. Protection of exits			
	Fire check door			
	<ul style="list-style-type: none"> Pressurization 	NA	NA	NA
		NA	NA	NA
	d. No. of continuous staircases to terrace	02	02	MR
	e. Width of Corridor	NA	NA	NA
	f. Door Size	1.0m	1.0m	MR
3.	Compartmentation			
	<ul style="list-style-type: none"> Fire check door 	NA	NA	NA
	<ul style="list-style-type: none"> Sealing of electrical shafts 	NA	NA	NA
	<ul style="list-style-type: none"> Fire Rating of shaft door 	NA	NA	NA
	<ul style="list-style-type: none"> Water Curtain 	NA	NA	NA
	<ul style="list-style-type: none"> Fire Dampers 	NA	NA	NA
4.	Smoke Management System			
	<ul style="list-style-type: none"> Basements 	30 a/c per hour	NA	NA
	<ul style="list-style-type: none"> Upper floors 	12 a/c per hour	Natural ventilated	MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers 	08nos.	08nos.	MR
	<ul style="list-style-type: none"> Types 	ABC/CO2	ABC-08	MR
	<ul style="list-style-type: none"> IS marking 	ISI marked	Yes	MR
6.	First-Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor 	01	Provided	NA
	<ul style="list-style-type: none"> Length of hose reel hose 	30mm	Provided	NA
	<ul style="list-style-type: none"> Nozzle diameter 	5m	Provided	NA
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detectors 	NA	NA	NA
	<ul style="list-style-type: none"> Location of Main Panel 	NA	NA	NA
	<ul style="list-style-type: none"> Location of Repeater Panel 	NA	NA	NA

2/9

	<ul style="list-style-type: none"> • Alternate source of power • Hooters' Location 	NA	NA	NA
8.	MOEFA	NA	NA	NA
9.	Public Address System	NA	NA	NA
10.	Automatic Sprinkler System	NA	NA	NA
	<ul style="list-style-type: none"> • Basement • Ground & Upper Floors • Sprinkler above false ceiling 	NA	NA	NA
		NA	NA	NA
11.	Internal Hydrants	NA	NA	NA
	<ul style="list-style-type: none"> • Size of riser/down-comer • Number of hydrants per floor • Hose Box 	NA	NA	NA
		NA	NA	NA
12.	Yard Hydrants	NA	NA	NA
	<ul style="list-style-type: none"> • Total number of hydrants • Hose Box 	NA	NA	NA
		NA	NA	NA
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> • Ground Level ➤ Discharge of main Pump ➤ Head of Main pump ➤ Number of main pumps ➤ Jockey Pump out put ➤ Jockey pump head ➤ Standby Pump out put ➤ Standby Pump Head ➤ Auto Starting/Manual Stopping ➤ Pump House Access 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
	<ul style="list-style-type: none"> • Terrace level ➤ Discharge of pump ➤ Head of the pump ➤ Power Supply ➤ Auto Starting of pump 	450LPM	450LPM	MR
		40M	40M	MR
		Required	Provided	MR
		Required	Provided	MR
14.	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> • Underground tank capacity ➤ Draw-off connection ➤ Fire service inlet ➤ Access to tank • Overhead Tank capacity 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		10,000ltr	10,000ltr	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication In lift Car • Fireman's Grounding Switch • Lift Signage 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
17.	Standby power supply	NA	NA	NA
18.	Refuge Area.			
	<ul style="list-style-type: none"> ➤ Total Area ➤ Location 	NA	NA	NA
		NA	NA	NA
19.	Fire Control Room			
	<ul style="list-style-type: none"> • Detector System Panel • Flow Switch Panel • PA System Panel • Battery backup • Building Floor Plans 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA

2/3

Special Fire Protection System for
Protection of special Risks, if any:

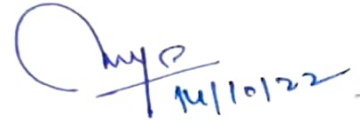
NA

NA

NA


The fire protection systems provided in the building were test checked and found functional at the time of inspection.

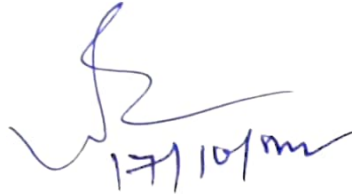
Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rule 2010.

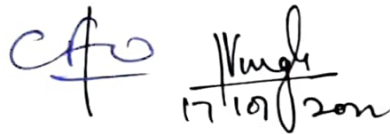

14/10/22

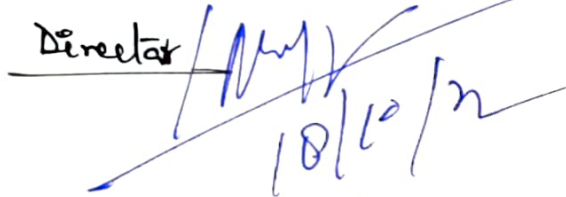
Signature of the Inspecting Officer
Name Ajay Kumar Sharma
Designation ADO(Rohini)


DO (SVD)


14/10/2022

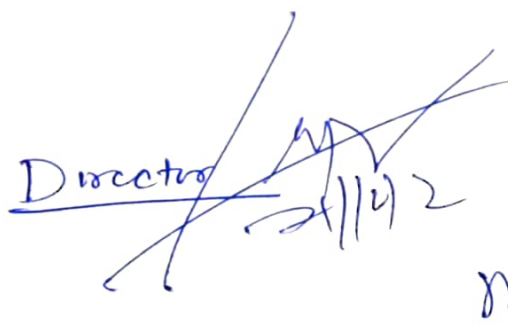

17/10/2022

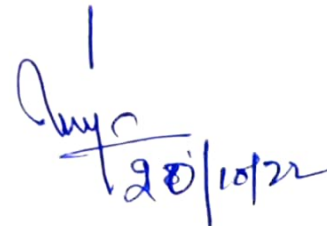

17/10/2022


18/10/22


18/10/22

FT letter is put up for kind perusal and
Signature please


21/10/22


20/10/22

