

C-44

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI – 110001**

No F 6/DFS/MS/2022/School/WZ/ 1233

Dated: 15/11/2022

FIRE SAFETY CERTIFICATE

Certified that the **Bhawani Public School, A-26, Kailash Vihar, Sultan Puri, Delhi-86**, comprised of Ground + 03 upper floor (School is running at ground + 01 upper floor) owned/occupied by **Bhawani Public School**, was granted FSC by this department vide letter No. **F.6/DFS/MS/2018/School/1349 dated 08.06.2018**. The premises was re-inspected by the officer concerned of this department on **27.10.2022** in the presence of **Mr. Amrish (Principal)** and observed that all the fire prevention and fire safety arrangements as provided in the premises found in good working condition. The premises have deemed complied with requirements of circular issued by **Director of Education letter no 3298-3398 dated 01.03.2011** and the building/ premise is fit for occupancy **Group B Educational** with effect from ~~....15/11/2022~~ **15/11/2022** for a period of **three years**, subject to compliance of the conditions mentioned below:

Issued on **15/11/2022** at New Delhi


(Dhrampal Bhardwaj)
Dy.Chief Fire Officer
Tel;-01123414250

Copy to: -

1. The Director, Education, Government of N.C.T of Delhi. Old Sect. Delhi - 54.
2. The Principal, Bhawani Public School, A-26, Kailash Vihar, Sultan Puri, Delhi-86.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on
8. All the means of escape shall be kept free of any obstruction all the time to evacuate the occupant, in a safe manner, in the event of emergency.

http://www.delhi.gov.in/wps/wcm/connect/doiit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/
http://www.delhi.gov.in/wps/wcm/connect/doiit_fire/FIRE/Home/Forms

2/19

INSPECTION REPORT

- Name & address of the building : Bhawani Public School, A-26, Kailash Vihar, Sultan Puri, Delhi-86
- Type of Occupancy : Educational
- Type of Case : Renewal (Gr.+ 03 upper floor (school is running on Gr.+ 01 upper floor))
- 4. Details of Previous NOC : F.6/DFS/MS/2018/School/1349 dated 08.06.2018.
- 5. Fire Safety directives letter No : Director of Education Cir dated 08.06.2018
- 6. Date of inspection : 27.10.2022
- 7. Name of Inspecting Officer : A.K.Sharma ADO(Rohini)
- 8. Name and designation of officers
From the building side : Mr. Amrish (Principal)
- 9. Year of Construction : 2010 & 2016
- 10. Applicant's letter No. : Online e-mail dated 30.09.2022.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Director of Education	Provided at site	Remarks MR/NMR
1.	Access to building			
	• Road width	Accessible	Accessible	MR
	• Gate width	Accessible	4.5m	MR
	• Width of internal road	NA	NA	NA
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	01	02	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floor	1.5m	1.0m & 0.75m	MR(Old case)
	• Basements	NA	NA	NA
	c. Protection of exits			
	Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No. of continuous staircases to terrace	01	01	MR
	e. Width of Corridor	NA	NA	NA
	f. Door Size	1.0m	1.0m	MR
3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke Management System			
	• Basements	30 a/c per hour	NA	NA
	• Upper floors	12 a/c per hour	Natural ventilated	MR
5.	Fire Extinguishers			
	• Total numbers	04nos.	04nos.	MR
	• Types	ABC/CO2	ABC/CO2	MR
	• IS marking	ISI marked	Yes	MR
6.	First-Aid Hose Reels			
	• Total numbers on each floor	NA	NA	NA
	• Length of hose reel hose	NA	NA	NA
	• Nozzle diameter	NA	NA	NA
7.	Automatic fire detection and alarming system			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA

	<ul style="list-style-type: none"> Hooters' Location 	NA	NA	NA
8.	MOEFA	NA	NA	NA
9.	Public Address System	NA	NA	NA
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement 	NA	NA	NA
	<ul style="list-style-type: none"> Ground & Upper Floors 	NA	NA	NA
	<ul style="list-style-type: none"> Sprinkler above false ceiling 	NA	NA	NA
11.	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer 	NA	NA	NA
	<ul style="list-style-type: none"> Number of hydrants per floor 	NA	NA	NA
	<ul style="list-style-type: none"> Hose Box 	NA	NA	NA
12.	Yard Hydrants			
	<ul style="list-style-type: none"> Total number of hydrants 	NA	NA	NA
	<ul style="list-style-type: none"> Hose Box 	NA	NA	NA
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> Ground Level 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Discharge of main Pump 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Head of Main pump 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Number of main pumps 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Jockey Pump out put 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Jockey pump head 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Standby Pump out put 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Standby Pump Head 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Auto Starting/Manual Stopping 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Pump House Access 	NA	NA	NA
	<ul style="list-style-type: none"> Terrace level 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Discharge of pump 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Head of the pump 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Power Supply 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Auto Starting of pump 	NA	NA	NA
14.	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> Underground tank capacity 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Draw-off connection 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Fire service inlet 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Access to tank 	NA	NA	NA
	<ul style="list-style-type: none"> Overhead Tank capacity 	NA	NA	NA
15.	Exit Signage.	NA	NA	NA
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of Lift Shaft 	NA	NA	NA
	<ul style="list-style-type: none"> Pressurization of Lift lobby 	NA	NA	NA
	<ul style="list-style-type: none"> Communication In lift Car 	NA	NA	NA
	<ul style="list-style-type: none"> Fireman's Grounding Switch 	NA	NA	NA
	<ul style="list-style-type: none"> Lift Signage 	NA	NA	NA
17.	Standby power supply	NA	NA	NA
18.	Refuge Area.			
	<ul style="list-style-type: none"> ➤ Total Area 	NA	NA	NA
	<ul style="list-style-type: none"> ➤ Location 	NA	NA	NA
19.	Fire Control Room			
	<ul style="list-style-type: none"> Detector System Panel 	NA	NA	NA
	<ul style="list-style-type: none"> Flow Switch Panel 	NA	NA	NA
	<ul style="list-style-type: none"> PA System Panel 	NA	NA	NA
	<ul style="list-style-type: none"> Battery backup 	NA	NA	NA
	<ul style="list-style-type: none"> Building Floor Plans 	NA	NA	NA

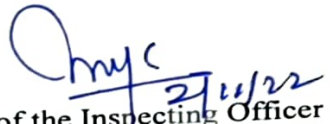
Special Fire Protection
The fire time

NA
NA
NA
NA
NA
NA

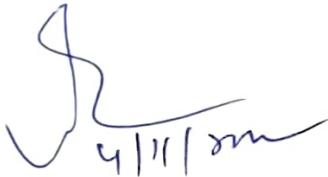
Special Fire Protection System for Protection of special Risks, if any:	NA	NA	NA
---	----	----	----

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures required stipulated in **Director of Education Circular**, the FSC issued vide letter no. **F.6/DFS/MS/2018/School/1349 dated 08.06.2018** is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.


Signature of the Inspecting Officer
Name **Ajay Kumar Sharma**
Designation **ADO (Rohini)**

DO (NW) on m/Rest
dy (FO/W2



4/11/22

~~Att of Rohini~~

FT letter is put up for kind perusal and
Signature please

DFO (W2)


10/11/22


19/11/22

ms/alt