



C/36



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001

No. F.6/DFS/MS/WZ/School/2022/ 1277


Dated 30/11/2022

FIRE SAFETY CERTIFICATE

Certified that the **Guru Nanak Public School**, located at **2nd floor, Moti Nagar, New Delhi - 110015** is running at 2nd floor in a building comprised of Ground plus Two upper floors & two rooms at terrace (**Another School namely, Bhai Biba Singh Khalsa Sr. Sec. School is running at G+1 upper floor in same building**). The premises was re-inspected by officer concerned of this department on 17/11/2022 in the presence of Sh. Parminder pal Singh (Manager) and observed that all the fire prevention and fire safety arrangements provide in the premises found in good working condition. The premises have therefore complied with Director of Education Circular No. 3298-3398 dated 01/03/2011/NBC (Part-IV) and that the building/premises is fit for occupancy class "Educational" Group-B, (**2nd Floor only**) with effect from 30/11/2022 for a period of three years in accordance with rule 36 unless renewal under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the DFS rules, 2010 conditions printed overleaf.

Issued on 30/11/2022 at New Delhi by


(Atul Garg)
Director
Delhi Fire Service


29/11/2022

Copy to: -

1. The Principal, Guru Nanak Public School, located at 2nd floor, Moti Nagar, New Delhi - 110015.
2. The Directorate of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.



Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.

19/15

INSPECTION REPORT

1. Name & address of the building : Guru Nanak Public School Located at Moti Nagar, New Delhi-110015.
2. Type of Occupancy : Educational 01 Block (2nd floor) in a building Comprised of Ground + 02 upper floors and 2 rooms at terrace (Another School namely Bhai Biba Singh Khalsa Sr. Sec. School) is running G + 1 Upper Floor in same building.
3. Type of Case : New
4. Details of previous NOC : Nil
5. Fire Safety directives letter No : DOE 3298-3398 dated 01/03/2011
6. Date of inspection : 17/11/2022
7. Name of the Inspecting Officers : Sarabjeet Singh (ADO MN)
8. Name and designation of officers from the building side : Sh. Parminder pal Singh (Manager)
9. Year of Construction : Before 2010 (As per prev. insp report dated- 13/11/2019)
10. Applicant's letter No. : Email dated 14/11/2022

* Another School in the name of Bhai Biba Singh Khalsa Sr. Sec. School is running at G + 1 upper Floor in a same building FSC of the same is issued vide letter no. F6/DFS/MS/School/WZ/2022/1113 dated 07/10/2022

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	BBL /NBC Requirement	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	Accessible	4m Provided	MR
	• Gate width	Accessible	Provided on Road	MR
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	02	Provided	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floors	1.5m or less & 0.75 mtr	1 x 125 cm & 1 x 1.20m	MR
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	e. No. of continuous staircases to terrace	NA	NA	NA
	f. Width of Corridor	1.5m	237cm Provided	MR
	g. Door Size	1 mtr	1m Provided (Including door frame)	MR
3	Compartmentation.			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4	Smoke Management System.			
	• Basements	NA	NA	NA
	• Upper floors	NA	NA	NA
5	Fire Extinguishers			
	• Total numbers	04 nos.	Provided	MR

888

N/16

	<ul style="list-style-type: none"> Types IS marking 	CO ₂ , ABC type ISI marked	Provided Provided	MR MR
6	First-Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	01 30 m 5 mm	Provided Provided Provided	MR MR MR
7	Automatic fire detection and alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	NA NA NA NA NA	NA NA NA NA NA	NA NA NA NA NA
8	MOEFA			
		NA	NA	NA
9	Public Address System.			
		NA	NA	NA
10	Automatic Sprinkler System.			
	<ul style="list-style-type: none"> Basement Upper Floor Sprinkler above false ceiling 	NA NA NA	NA NA NA	NA NA NA
11	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box 	NA NA NA	NA NA NA	NA NA NA
12	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	NA NA	NA NA	NA NA
13	Pumping Arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/ Manual stopping Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 	NA NA NA NA NA NA NA NA NA NA 450 lpm 40 m Required Required	NA NA NA NA NA NA NA NA NA NA Provided Provided Provided Provided	NA NA NA NA NA NA NA NA NA NA MR MR MR MR
14	Captive Water Storage for fire fighting.			
	<ul style="list-style-type: none"> Underground tank capacity Draw-off connection Fire service inlet Access to tank Overhead Tank capacity 	NA NA NA NA 10,000 Ltrs	NA NA NA NA Provided	NA NA NA NA MR
15	Exit Signage.			
		Required	Provided	MR

84

Provision of Lifts.


MR
MR
MR
MR
MR

	• Pressurization of Lift Shaft	NA	NA	NA
	• Pressurization of Lift lobby	NA	NA	NA
	• Communication In lift Car	NA	NA	NA
	• Fireman's Grounding Switch	NA	NA	NA
	• Lift Signage	NA	NA	NA
17	Standby power supply	NA	NA	NA
18	Refuge Area.			
	➤ Total Area	NA	NA	NA
	➤ Location	NA	NA	NA
19	Fire Control Room			
	• Detector System Panel	NA	NA	NA
	• Flow Switch Panel	NA	NA	NA
	• PA System Panel	NA	NA	NA
	• Batter backup	NA	NA	NA
	• Building Floor Plans	NA	NA	NA
20	Special Fire Protection Systems for Protection of special Risks, if any:	NA	NA	NA


The fire protection systems provided in the building were test checked and found functional at the time of inspection. The shortcomings issued by this department vide letter no F6/DFS/MS/School/WZ/2022/91 dated 03/03/2022 have been complied.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010.


~~Do (wz)~~

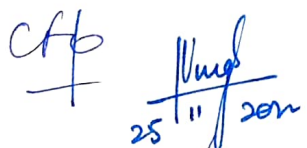

Signature of the Inspecting officer
Name: - Sarabjeet Singh
Designation: - ADO (MN)

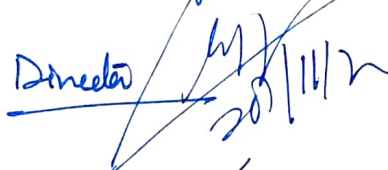
389/ADO/MN
21/11/2022
DO NOTED
DATED 24/11/2022


24/11/2022

~~DOA (wz)~~


25/11/2022

CFP

25/11/2022

Director

20/11/22

