

C-75.

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001


No. F.6/DFS/MS/BANQ/SZ/2022/66

Dated: 09/12/22

FIRE SAFETY CERTIFICATE

Certified that **M/s. Azalea Banquet located at C- 162, Naraina Industrial Area, Phase- I, New Delhi- 110028**, running at **ground floor only** in a building comprised of ground plus two upper floors, was granted FSC vide this department letter No. F6/DFS/MS/SZ/2018/2745 dated 24.12.2018. The banquet hall was re-inspected by the officers concerned of this department on 06.12.2022 in the presence of Mrs. Jasbir Kaur (Manager) and found that the said building have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class Group D 'Assembly Building', (**for Ground Floor Only**) with effect from 09/12/22 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules 2010, printed below.

Issued 09/12/22 at New Delhi by.


(Sunil Chaudhary)
Dy. Chief Fire Officer (SZ)
Delhi Fire Service

Online application Id no. 2022112320570 dated 05.12.2022

Conditions for the validity of Fire Safety Certificate

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupation, electric installation etc. may be got verified from the concerned authorities.
5. The Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction / unauthorized use of land if any.
6. All comments / directions of licensing department shall always be permitted and followed.
7. If the owner/occupier open the wall connected with A-21/17, the FSC will be automatically null & void.
8. The owner /occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in
9. The owner / occupier shall apply for renewal of this **Fire Safety Certificate to the Director in 'Form J' (sub Rule (1) of Rule 37)** along with copy of the certificate, six months prior to its expiry.

INSPECTION REPORT

1. Name & address of the building : M/s. Azalea Banquet, C- 162, Naraina Industrial Area, Phase- I, New Delhi- 110028.
2. Type of Occupancy : Assembly
3. Building Composition : The said banquet hall is running on ground floor of a building Comprised of ground plus two upper floors.
4. Type of Case : Renewal
5. Details of previous NOC : F6/DFS/MS/SZ/2018/2745 dated 24.12.2018
6. Fire Safety directives letter No : F6/DFS/MS/BP/2013/1497 dated 04.06.2013
7. Date of inspection : 06.12.2022
8. Name of the Inspecting Officers : Vedpal Chhikara, DO (SW) & P.V. Rathee, ADO (SRD)
9. Name and designation of officers from the building side : Mrs. Jasbir Kaur (Manager)
9. Year of Construction : 2013
10. Applicant's letter No. : Online application Id No. 2022112320570 dated 05.12.2022

Sr. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement as per FSC dt. 24.12.2018	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	06 mts	Provided	MR
	• Gate width	05 mts	Directly accessible from the road	MR
	• Width of internal road	N/A	N/A	N/A
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	-	-	-
	• Upper Floors	02 nos.	02 nos.	B. hall at GF only
	• Basements	N/A	N/A	N/A
	b. Width of staircases	-	-	-
	• Upper Floors	Old case	1.50, 1.31 mts.	B. hall at GF only
	• Basements	N/A	N/A	N/A
	c. Protection of exits	-	-	-
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	---	01	B. hall at GF only
	g. Width of Corridor	N/A	N/A	B. hall at GF only
	h. Door Size	2.0 mts	Provided (02 Nos.)	MR
3	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	Smoke Management System.			
	• Basements	30 a/c per hour	N/A	N/A
	• Upper floors	12 a/c per hour	Natural ventilation	MR
5	Fire Extinguishers			
	• Total numbers	12	Provided	MR
	• Types	ABC & CO ₂ type	ABC & CO ₂ type	MR
	• IS marking	ISI marked	Provided	MR

6	First-Aid Hose Reels.			
	• Total numbers on each floor	02	Provided	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7	Automatic fire detection and alarming system.			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	N/A	N/A
8	MOEFA	Required	Provided	MR
9	Public Address System.	Required	Provided	MR
10	Automatic Sprinkler System.			
	• Basement	N/A	N/A	N/A
	• Upper Floor / Ground Floor	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	• Size of riser/down-comer	100 mm	Provided	MR
	• Number of hydrants per floor	02 No.	Provided	MR
	• Hose Box	02 No.	Provided	MR
12	Yard Hydrants.			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13	Pumping Arrangements.			
	• Ground Level	---	---	---
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey Pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/ Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level	-----	-----	-----
	➤ Discharge of pump	900 LPM	Provided	MR
	➤ Head of the pump	40 mts	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	20000 lts	20000 lts	MR
15	Exit Signage.	Required	Provided	MR

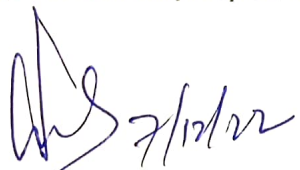

Provision of Lifts. Provided but not commissioned

MR		• Pressurization of Lift Shaft	N/A	N/A	N/A
MR		• Pressurization of Lift lobby	N/A	N/A	N/A
MR		• Communication In lift Car	N/A	N/A	N/A
		• Fireman's Grounding Switch	N/A	N/A	N/A
		• Lift Signage	N/A	N/A	N/A
N A	17	Standby power supply	Required	Provided D.C. set	MR
N A	18	Refuge Area.			
N		➤ Total Area	N/A	N/A	N/A
N		➤ Location	N/A	N/A	N/A
	19	Fire Control Room			
		• Detector System Panel	N/A	N/A	N/A
		• Flow Switch Panel	N/A	N/A	N/A
		• PA System Panel	N/A	N/A	N/A
		• Batter backup	N/A	N/A	N/A
		• Building Floor Plans	N/A	N/A	N/A
	20	Special Fire Protection Systems for Protection of special Risks, if any:	Required	02 ABC type fire extinguishers found Provided near elect. panel	MR

The fire protection systems provided in the building were checked at random and found satisfactory at the time of inspection.

In view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the Rules, the FSC issued vide letter No. F6/DFS/MS/SZ/2018/2745 dated 24.12.2018, renewal under Rule 37 of the Delhi Fire Service Rules 2010 is recommended.

Accordingly, DFA letter is put up for signature please.

Signature of the Inspecting Officer
Name- Vedpal Chhikara
Divisional Officer (SW)

Signature of the Inspecting Officer
Name-P.V. Rathee
Asstt. Div. Officer (S.Rd)

FT.

Dyefo (S2)

ADP (SR)

8/12