

1-1
C-53

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001**


No. F6/DFS/MS/2022/WZ/ 27

Dated: 20/12/22

FIRE SAFETY CERTIFICATE

Certified that the **Handicapped Women Welfare Association, PSP Institutional Area, Madhuban Chowk, Rohini, Delhi-110085**, comprised of **Basement + Ground + 03 upper floors** has already been issued FSC by this department vide letter No. **F.6/DFS/MS/Educational/2017/WZ/1505 dated 18.10.2017**. The premises was re-inspected by the officer concerned of this department on **25.11.2022** in the presence of **Smt. Sanjana Mittal (Dy - Director)** and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy class "**Educational**" with effect from 20/12/22 for a period of **three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subjected to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 20/12/22 at New Delhi by

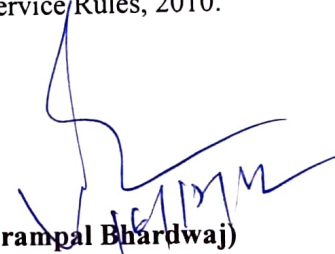
(Dhrampal Bhardwaj)
Dy.Chief Fire Officer
Tel;-01123414250

Copy to :-

1. The Director, Handicapped Women Welfare Association, PSP Institutional Area, Madhuban Chowk, Rohini, Delhi-110085.

Conditions for the validity of fire safety certificate:

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on
8. All the means of escape shall be kept free of any obstruction all the time to evacuate the occupant, in a safe manner, in the event of emergency.

DLC
CM

http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/
http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms

INSPECTION REPORT

1. Name & address of the building : Handicapped Women Welfare Association, PSP Institutional Area, Madhuban Chowk, Rohini, Delhi-110085.
2. Type of Occupancy : Educational
3. Type of Case : Renewal (**Basement + Ground + 03 upper floors**)
4. Details of Previous NOC : F.6/DFS/MS/Educational/2017/WZ/1505 dated 18.10.2017.
5. Fire Safety directives letter No : NA
6. Date of inspection : 25.11.2022
7. Name of Inspecting Officer : A.K.Sharma ADO(Rohini)
8. Name and designation of officers
From the building side : Smt. Sanjana Mittal (Dy - Director)
9. Year of Construction :
10. Applicant's letter No. : Online e-mail dated 02.11.2022.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	UBBL/NBC Requirement	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	<ul style="list-style-type: none"> Accessible Accessible NA 	<ul style="list-style-type: none"> Accessible 4.5m NA 	<ul style="list-style-type: none"> MR MR NA
2.	Number, Width, Type & Arrangement of Exits			
	d. Number of staircases			
	<ul style="list-style-type: none"> • Upper Floors • Basements 	<ul style="list-style-type: none"> 02 02 	<ul style="list-style-type: none"> 02 01 & 01 ramp 	<ul style="list-style-type: none"> MR MR(Old case)
	e. Width of staircases			
	<ul style="list-style-type: none"> • Upper Floor • Basements 	<ul style="list-style-type: none"> 1.50m 1.50m 	<ul style="list-style-type: none"> 1.35m & 1.30m 1.35m & 1.30m ramp 	<ul style="list-style-type: none"> MR(Old case) MR(Old case)
	f. Protection of exits			
	Fire check door	Required	Provided	MR
	<ul style="list-style-type: none"> • Pressurization 	NA	NA	NA
	d. No. of continuous staircases to terrace	01	02	MR
	e. Width of Corridor	NA	NA	NA
	f. Door Size	1.0m	1.0m	MR
3.	Compartmentation			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 	<ul style="list-style-type: none"> NA NA NA NA NA 	<ul style="list-style-type: none"> NA NA NA NA NA 	<ul style="list-style-type: none"> NA NA NA NA NA
4.	Smoke Management System			
	<ul style="list-style-type: none"> • Basements • Upper floors 	<ul style="list-style-type: none"> 30 a/c per hour 12 a/c per hour 	<ul style="list-style-type: none"> Exhaust fan Natural ventilated 	<ul style="list-style-type: none"> MR MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers • Types • IS marking 	<ul style="list-style-type: none"> 15nos. ABC/CO2 ISI marked 	<ul style="list-style-type: none"> 15nos. ABC-15 Yes 	<ul style="list-style-type: none"> MR MR MR
6.	First-Aid Hose Reels			
	<ul style="list-style-type: none"> • Total numbers on each floor • Length of hose reel hose • Nozzle diameter 	<ul style="list-style-type: none"> 02 30mm 5m 	<ul style="list-style-type: none"> Provided Provided Provided 	<ul style="list-style-type: none"> MR MR MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> • Type of detectors • Location of Main Panel • Location of Repeater Panel 	<ul style="list-style-type: none"> NA NA NA 	<ul style="list-style-type: none"> NA NA NA 	<ul style="list-style-type: none"> NA NA NA

	<ul style="list-style-type: none"> • Alternate source of power • Hooters' Location 	NA	NA	NA
8.	MOEFA	NA	NA	NA
9.	Public Address System	NA	NA	NA
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> • Basement • Ground & Upper Floors • Sprinkler above false ceiling 	Required	Provided	MR
		NA	NA	NA
		NA	NA	NA
11.	Internal Hydrants			
	<ul style="list-style-type: none"> • Size of riser/down-comer • Number of hydrants per floor • Hose Box 	100mm	100mm	MR
		02	02	MR
		02	02	MR
12.	Yard Hydrants			
	<ul style="list-style-type: none"> • Total number of hydrants • Hose Box 	NA	NA	NA
		NA	NA	NA
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> • Ground Level ➤ Discharge of main Pump ➤ Head of Main pump ➤ Number of main pumps ➤ Jockey Pump out put ➤ Jockey pump head ➤ Standby Pump out put ➤ Standby Pump Head ➤ Auto Starting/Manual Stopping ➤ Pump House Access 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		180lpm	180lpm	MR
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
	<ul style="list-style-type: none"> • Terrace level ➤ Discharge of pump ➤ Head of the pump ➤ Power Supply ➤ Auto Starting of pump 	450lpm	450lpm	MR
		40m	40m	MR
		NA	NA	NA
		NA	NA	NA
14.	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> • Underground tank capacity ➤ Draw-off connection ➤ Fire service inlet ➤ Access to tank • Overhead Tank capacity 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		5,000ltr	5,000ltr	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication In lift Car • Fireman's Grounding Switch • Lift Signage 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
17.	Standby power supply			
18.	Refuge Area.			
	<ul style="list-style-type: none"> ➤ Total Area ➤ Location 	NA	NA	NA
		NA	NA	NA
19.	Fire Control Room			
	<ul style="list-style-type: none"> • Detector System Panel • Flow Switch Panel • PA System Panel • Battery backup • Building Floor Plans 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA

N/16

Special Fire Protection System for Protection of special Risks, if any:	NA	NA	NA
---	----	----	----


The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. **F.6/DFS/MS/Educational/2017/WZ/1505 dated 18.10.2017** is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010



Signature of the Inspecting Officer
Name Ajay Kumar Sharma
Designation ADO(Rohini)

DO (NW)




07/12/2022



~~ADO~~ / Rohini

FT letter is put up for kind perusal and signature please.

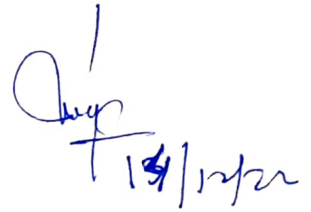

~~DCFO~~ (WZ)



MS/ cell