

C 37



**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001**

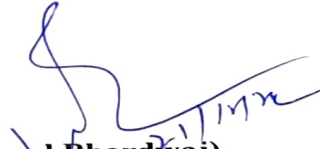
No. F6/DFS/MS/2022/WZ/*School/1347*

Dated: *22/12/2022*

FIRE SAFETY CERTIFICATE

Certified that the **Rohini Educational Society, (Gitarattan Jindal Public School) Sector, 7, Rohini, Delhi-85**, comprised of **Basement + Ground + 03 upper floors** has already been issued FSC by this department vide letter No. **F.6/DFS/MS/2019/1511 dated 23.07.2019**. The premises was re-inspected by the officer concerned of this department on **05.12.2022** in the presence of **Sh. R N. Jindal (Chariman)** and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy class **Educational "Group B"** with effect from *22/12/2022* for a period of **three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subjected to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on *22/12/2022* at New Delhi by


(Dhrampal Bhardwaj)
Dy.Chief Fire Officer
Tel;-01123414250
ole

Copy to :-

1. The Principal, Rohini Educational Society, (Gitarattan Jindal Public School) Sector, 7, Rohini, Delhi-85.
2. The Director, Education, Government of N.C.T of Delhi. Old Sect. Delhi – 54

Conditions for the validity of fire safety certificate:

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on
8. All the means of escape shall be kept free of any obstruction all the time to evacuate the occupant, in a safe manner, in the event of emergency.

http://www.delhi.gov.in/wps/wcm/connect/doi_t_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/ http://www.delhi.gov.in/wps/wcm/connect/doi_t_fire/FIRE/Home/Forms

117

INSPECTION REPORT

1. Name & address of the building : Rohini Educational Society, (Gitarattan Jindal Public School) Sector 7, Rohini, Delhi-85.
2. Type of Occupancy : Educational
3. Type of Case : Renewal (**Basement + Ground + 03 upper floors**)
4. Details of Previous NOC : F.6/DFS/MS/2019/1511 dated 23.07.2019
5. Fire Safety directives letter No : NBC Part-IV
6. Date of inspection : 05.12.2022
7. Name of Inspecting Officer : A.K.Sharma ADO(Rohini)
8. Name and designation of officers
From the building side : Sh. R. N. Jindal (Chariman)
9. Year of Construction : 1988-89
10. Applicant's letter No. : OD No.7883 dated 11.11.2022.


S. No.	Minimum Standards on fire prevention and fire safety U/R 33	NBC-2016 Requirement	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	6.0m	20m	MR
		4.45m	4.5m	MR
		NA	NA	NA
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> Upper Floors Basements 	03	03	MR
		02	02	MR
	b. Width of staircases			
	<ul style="list-style-type: none"> Upper Floor Basements 	1.5m	160m, 1.45m & 1.5m	MR
		1.5m	1.5m & 1.45m	MR
	c. Protection of exits			
	Fire check door			
	<ul style="list-style-type: none"> Pressurization 	NA	NA	NA
		NA	NA	NA
	d. No. of continuous staircases to terrace	01	02	MR
	e. Width of Corridor	NA	NA	NA
	f. Door Size	1.0m	1.0m	MR
3.	Compartmentation			
	<ul style="list-style-type: none"> Fire check door Sealing of electrical shafts Fire Rating of shaft door Water Curtain Fire Dampers 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
4.	Smoke Management System			
	<ul style="list-style-type: none"> Basements Upper floors 	30 a/c per hour	Exhaust fan	MR
		12 a/c per hour	Natural ventilated	MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types IS marking 	32nos.	32nos.	MR
		ABC/CO2	ABC-20/CO2-12	MR
		ISI marked	Yes	MR
6.	First-Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	02	Provided	MR
		30mm	Provided	MR
		5m	Provided	MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel 	NA	NA	NA
		NA	NA	NA

2/19


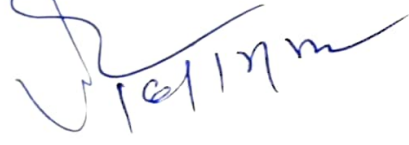
<ul style="list-style-type: none"> PA System Panel Battery backup Building Floor Plans 	NA	NA	NA
	NA	NA	NA
	NA	NA	NA
	NA	NA	NA
Special Fire Protection System for Protection of special Risks, if any:			

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. F.6/DFS/MS/2019/1511 dated 23.07.2019 is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.


 Signature of the Inspecting Officer
 Name Ajay Kumar Sharma
 Designation ADO(Rohini)

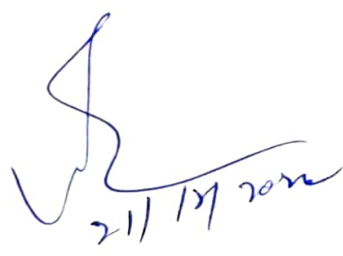
DO (NW)



 13/12/2022
 DCFO (W/S)

 16/12/2022

~~ADO Rohini~~

FT letter is put up for kind perusal and signature please.

DCFO (W/S)


 21/12/2022


 21/12/22

ms/ cell