



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001

7/ 
आजादी का
अमृत महोत्सव

No: F.6/DFS/MS/Cinema/WZ/2023/ 29

Dated: 20/01/2023

FIRE SAFETY CERTIFICATE

Certified that M/s. M2K Cinema Hall, Audi- 1, 2 & 3 (03 Audis/Screen Cinema) running at 3rd Floor of M2K Entertainment Pvt. Ltd. Mall comprised of two basements, ground plus three upper floors located at Plot No. 04, Road No. 44, Community Enter, Pitampura, New Delhi, owned/occupied by M/s. M2K Entertainment Pvt. Ltd., was issued fire safety certificate by this department vide letter No. F.6/DFS/MS/2020/Cinema/54 dated 20.01.2020. The premises was re-inspected by the officers concerned of this department on 10.01.2023 in presence of Mr. (Regional Manager) and found that the M2K Multiplex/Cinema have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi fire service Rules 2010 and that the building/premises is fit for Occupancy Class- D (Assembly- Cinema) with effect from 20/01/2023 for a period of 03 (three) years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules- 2010, printed overleaf.

Issued on 20/01/2023 at New Delhi by.


(Atul Garg)
Director

Copy to: -

1. The Manager, M2K Cinema, 3rd Floor, M2K Entertainment Pvt. Ltd. Mall, Plot No. 04, Road No. 44, Community Center, Pitampura, New Delhi.

Conditions for the validity of fire safety certificate

1. Providing of fire safety measures does not give any guarantee that there will be No fire. These equipments/installation can minimize the losses if maintained in good working condition and handled efficiently in case of fire.
2. All the fire safety and means of escape facilities shall be maintained in good working conditions at all time.
3. The means of escape arrangements shall be kept unlocked & unobstructed for speedy evacuation of occupants in case of an emergency.
4. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
5. The trained staff should be available round the clock.
6. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
7. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
8. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on website www.dfs.delhigovt.nic.in
9. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.

INSPECTION REPORT

1. Name & address of the building: M2K Cinema (M2K Entertainment Pvt. Ltd.), Audi- 1, 2 & 3, 3rd Floor, , Plot No. 04, Road No. 44, Community Center, Pitampura, New Delhi
2. Type of Occupancy : Assembly
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/2020/Cinema/54 dated 20.01.2020 -for Cinema
5. Fire Safety directives Letter No. : F6/DFS/MS/BP/1611 dt. 21.07.2003 -for Mall & F.6/DFS/MS/2004/468 dated 27.02.2004.
6. Date of inspection : 13.01.2023
7. Name of the Inspecting Officer : M.K. Chattopadhyay, DO (West), Sarabjeet Singh, ADO (MN)
8. Name and designation of Officer From the building side : Sh. Sanjay Koul (President)
9. Year of Construction : 2004-05
10. Applicant's email date : Email dated

M2K Cinema (03 Audis) are located at 3rd floor of M/s. M2K Entertainment Pvt Ltd building comprised of two basements, ground plus three upper floors, which is already issued FSC vide letter No. F6/DFS/MS/2023/Cinema/24 dated 17.01.2023.

S No	Minimum standards on fire prevention and fire safety U/R 33	Requirement as per Rule 35(6) of DFS Rules 2010	Provided at site	Remarks MR/NMR
1.	Access of building			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	09 mtrs 5 mtr 6 mts	Provided (24 mts) Provided Provided (Old Case)	MR MR MR
2.	Number, width, Type & Arrangements of exits:			
	a. Number of staircases	-----		
	<ul style="list-style-type: none"> • Upper Floors • Basements 	02 N/A	04 N/A	MR N/A
	b. Width of staircases	-----		
	<ul style="list-style-type: none"> • Upper Floors • Basements 	2x1.5 mts N/A	2x1.68, 2x1.42 mts N/A	MR being old case N/A
	c. Protection of exits			
	<ul style="list-style-type: none"> • Fire check door • Pressurization 	Required N/A	Provided by Mall N/A	MR N/A
	e. No. of continuous staircases to terrace	02 Nos.	Provided	MR
	g. Width of Corridor	Old case	Provided	MR
	h. Door Size	Audi-1 = 2x1.54, 1x1.45 m Audi-2 = 2x1.51, 2x1.59 m Audi-3 = 2x1.49, 1x1.6 m	Provided	MR being old case
3.	Compartmentation			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 	Required Required N/A N/A N/A	Provided Provided N/A N/A N/A	MR MR N/A N/A N/A


4.	Smoke managements System			
	• Basements	Required	Provided by Mall	MR
	• Upper floors	Required	Provided by Mall	MR
5.	Fire Extinguishers			
	• Total numbers	12 nos. each Audi	Main hall-03, Projector room-4, EL S.station-2, AC Room-3	MR
	• Types	ABC & CO ₂	Provided	MR
	• IS marking	ISI marked	Provided	MR
6.	First – Aid Hose Reels -Common with the mall			
	• Total numbers on each floor	01 each Audi	Provided by mall	MR
	• Length of hose reel hose	30 m	Provided by mall	MR
	• Nozzle diameter	5 mm	Provided by mall	MR
7.	Automatic fire detection and alarming system - Common with the mall			
	• Type of detectors	Beam detector	Provided by mall	MR
	• Location of Main Panel	Ground Floor	Provided by mall	MR
	• Location of Repeater Panel	Each Floor	Provided by mall	MR
	• Alternate source of power	Required	Provided by mall	MR
	• Hooters' Location	Appropriate place	Provided by mall	MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System Common with the mall			
	• Basements	Required	Provided	MR
	• Upper Floor	Required	Provided	MR
	• Sprinkler above false ceiling	Required	Provided	MR
11.	Internal Hydrants: Common with the mall			
	• Size of riser/down- comer	150 mm	Provided	MR
	• Number of hydrants per floor	03	Provided 3 at each floor & 1 in each Audi	MR
	• Hose Box	03	Provided by mall	MR
12.	Yard Hydrants			
	• Total number of hydrants	Required	Provided by mall	MR
	• Hose Box	Required	Provided by mall	MR
13.	Pumping Arrangements: Common with the mall			
	• Ground Level			
	• Discharge of main Pump	2850 LPM	Provided by mall	MR
	➤ Head of main pump	60 mts.	Provided by mall	MR
	➤ Number of main pumps	01 No.	Provided by mall	MR
	➤ Jockey pump out put	180 LPM	Provided by mall	MR
	➤ Jockey pump head	60 mts. each	Provided by mall	MR
	➤ Standby Pump out put	2850 LPM	Provided by mall	MR
	➤ Standby Pump Head	60 mts.	Provided by mall	MR
	➤ Auto Staring/Manual stopping	Required	Provided by mall	MR
	➤ Pump House Access	Required	Provided by mall	MR
	• Terrace level	----		
	➤ Discharge of pump	900 LPM	Provided by mall	MR
	➤ Head of the pump	40 mts.	Provided by mall	MR
	➤ Power supply	Required	Provided by mall	MR
	➤ Auto starting of pump	Required	Provided by mall	MR


14. Captive water Storage for firefighting: Common with the mall			
<ul style="list-style-type: none"> • Underground tank capacity ➤ Draw off connection ➤ Fire service inlet ➤ Access to tank • Overhead Tank capacity 	1,00,000 lts	Provided by mall	MR
	Required	Provided by mall	MR
	Required	Provided by mall	MR
	Required	Provided by mall	MR
	20,000 litres	Provided by mall	MR
15	Exit Signage	Required	Provided
16. Provision of Lifts			
<ul style="list-style-type: none"> ➤ Pressurization of Lift Shaft ➤ Pressurization of lift lobby ➤ Communication in lift Car ➤ Fireman's Grounding Switch ➤ Lift Signage 	Required	Provided by mall	MR
	NA	NA	NA
	Required	Provided by mall	MR
	Required	Provided by mall	MR
	Required	Provided by mall	MR
17.	Standby power supply	Required	Provided by mall
18.	Refuge Area		
	➤ Total area	NA	NA
	➤ Location	NA	NA
19. Fire control room Common with the Mall			
<ul style="list-style-type: none"> ➤ Detector system panel ➤ Flow Switch Panel ➤ PA System Panel ➤ Battery backup ➤ Building Floor Plans 	Required	Provided by mall	MR
	Required	Provided by mall	MR
	Required	Provided by mall	MR
	Required	Provided by mall	MR
	Required	Provided by mall	MR
20.	Special Fire Protection Systems for Protection of special Risks, if any;	Required	ABC type fire extinguishers found provided near LT Panels.





The fire protection systems provided in the building were randomly test checked and found functional at the time of inspection.

In view the deemed compliance of the minimum standards on fire prevention and fire safety required under the rules, the FSC issued vide letter No. F.6/DFS/MS/2020/Cinema/54 dated 20.01 2020, renewal under Rule 35 of the Delhi Fire Service Rules 2010, is recommended.

Accordingly DFA is put up for approval & signature please


 18/11/2023
 Signature of the Inspecting Officer
 M.K. Chattopadhyay
 DO (West Division)


 17/10/2023
 Signature of the Inspecting Officer
 Sarabjeet Singh
 ADO (Moti Nagar)

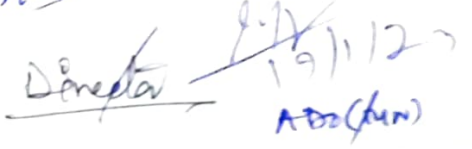

 19/11/2023

 18/11/2023

 19/11/2023
